

State of Iowa Public Drinking Water Program 2005 Annual Compliance Report



Environmental Services Division
Water Quality Bureau
Water Supply Engineering & Operations Sections

June 2006

Iowa Department of Natural Resources
Jeffrey R. Vonk, Director



Table of Contents

Introduction	1
2005 Report Highlights	1
Compliance with Health-Based Standards	1
Compliance with Monitoring & Reporting Requirements	2
The National Public Drinking Water Program: An Overview	3
The IDNR Drinking Water Program Components	4
Iowa's Public Water Supply Systems	6
Definition of a PWS	6
Number of Iowa Systems	6
System Size	6
System Source Water	6
Population Served by Source Water Type	7
Maximum Contaminant Levels and Maximum Residual Disinfectant Levels	8
Acute Contaminants	8
Coliform Bacteria, including fecal and <i>E. coli</i>	8
Nitrate & Nitrite	9
Chlorine Dioxide	9
Chronic (non-acute) Contaminants	9
Total Coliform Bacteria	9
Inorganic Chemicals	10
Organic Chemicals	10
Radionuclides	11
Disinfectants	11
Action Level and Treatment Technique Requirements	12
Lead & Copper Action Levels	12
Treatment Techniques: Surface Water Treatment Rule, Interim & LT1 Enhanced SWTR	13
Turbidity	13
Residual Disinfectant (minimum)	13
CT Ratio	14
Disinfection Byproduct Precursor Removal	14
Violation Data for Health-Based Standards: MCL, MRDL, AL, and TT	15
Major Monitoring & Reporting Violations	17
Major Monitoring & Reporting Violation Data	18
Monitoring & Reporting Compliance Rates	19
Enforcement Actions	20
Variances & Exemptions	21
Public Notification, Lead Public Education, and Consumer Confidence Reporting	21
Operator Certification	23
Classification of Systems, Facilities, and Operators	23
Classification Grades	24
Enforcement & Certification Renewal	25
Abbreviations	26
Distribution of Report & Staff Contact Information	27
Appendix A: EPA Violations Summary Report	A-1
Appendix B: Iowa Public Water Supply Violation Data	B-1

Introduction


The Iowa Department of Natural Resources (IDNR) administers the Public Drinking Water Program in Iowa under delegation of authority from the United States Environmental Protection Agency (EPA). The 1996 re-authorized Safe Drinking Water Act (SDWA) requires that each state that has been granted primary implementation authority prepare an annual report on violations of national primary drinking water regulations within the state, make the report readily available to the public, and submit it to the EPA. This report fulfills this responsibility in Iowa for the 2005 calendar year, and includes violations of maximum contaminant levels, maximum residual disinfectant levels, treatment technique requirements, major monitoring or reporting requirements, action level exceedances, and operation certification requirements.

The 2005 Report Highlights


Compliance with Health-Based Standards

- No waterborne diseases or deaths were reported from Iowa public water supply systems (PWS) in 2005.
- Over 2.50 million people (of the 2.79M people served by PWS) regularly received water from systems meeting all health-based drinking water standards.

Population served by Iowa systems meeting health-based standards 89%




Population served by Iowa systems with health-based standard violations 11%

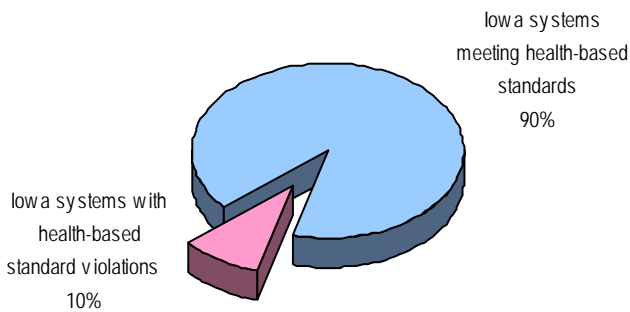


- Health-based drinking water standards were met by 90.0% of the 2,047 regulated public water supplies. There were 198 public water supplies that had 353 violations of a health-based drinking water standard: maximum contaminant level (MCL), maximum residual disinfectant level (MRDL), treatment technique (TT), or action level (AL).
- Eleven of the more than 80 regulated contaminants were found at levels that exceeded the health-based standards during 2005. Those 11 contaminants are listed below, along with the percentage each contributed to the total number of health-based standard violations.

with the percentage each contributed to the total number of health-based standard violations.

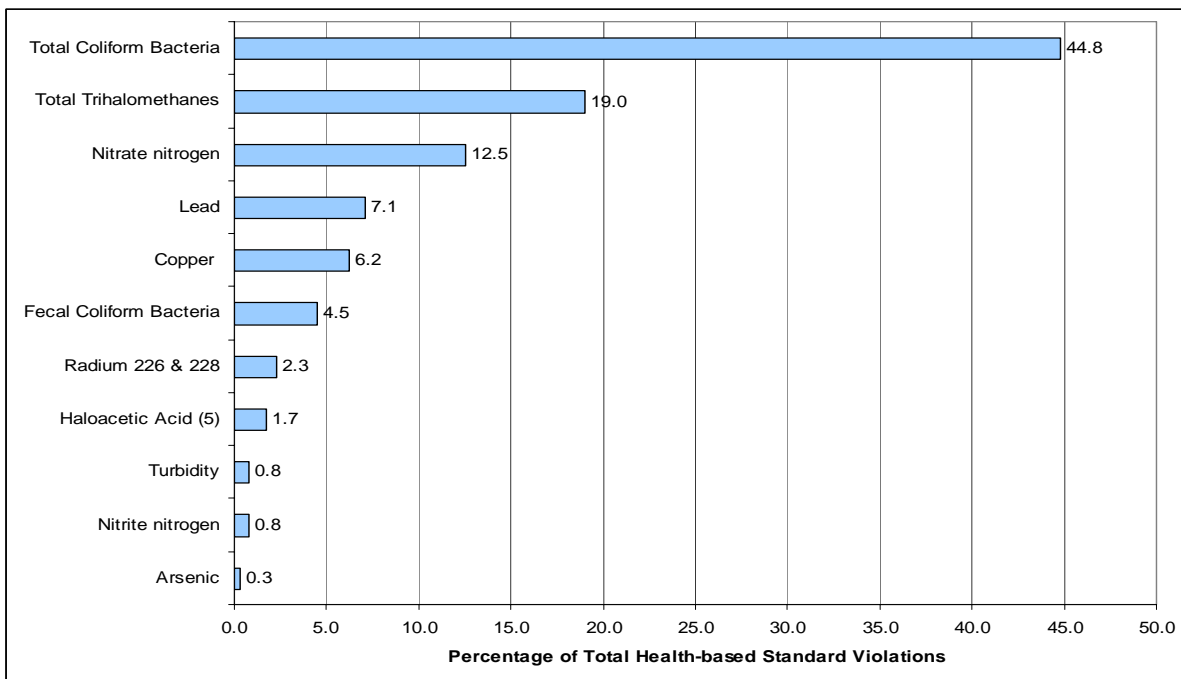

Compliance with Monitoring & Reporting Requirements

- About 2.6 million people regularly received water from Iowa systems that complied with all major monitoring and reporting requirements.
- Major monitoring and reporting requirements were met by 81.2% of the 2,047 regulated public water supply systems.
- There were 938 major monitoring violations in 2005. A major monitoring violation is incurred when a sample is not collected for a specific contaminant. There were 333 systems that had at least one major monitoring violation in 2005. The contaminants for which at least one major monitoring violation was issued are listed below, along with the percentage each contributed to the total number of monitoring violations.

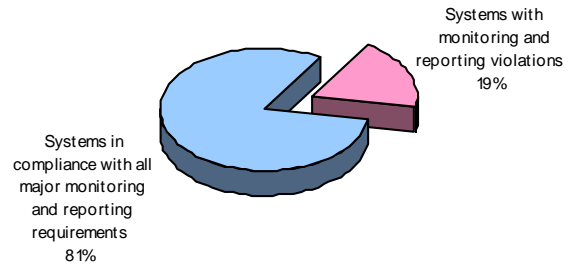


- Coliform bacteria: 38.0%
- Nitrate: 19.1%
- Volatile Organic Compounds: 11.2%
- Metals: 8.5%
- Synthetic Organic Compounds: 5.2%
- Chlorine: 5.0%
- Total Trihalomethanes: 2.6%
- Haloacetic Acids: 2.5%
- Nitrite: 1.8%
- Copper: 1.8%
- Lead: 1.8%
- Other (3 other analytes): 2.5%

- At least one reporting violation was incurred by 81 systems, for a total of 86 reporting violations. These violations were comprised of the following (both the actual number of violations and the percentage of total reporting violations are listed):

- Failure to provide a consumer confidence report: 35 (40.7%)
- Failure to obtain a certified operator: 27 (31.4%)
- Failure to submit the required monthly operation report: 9 (10.4%)
- Failure to meet a compliance schedule: 8 (9.3%)
- Failure to obtain a construction and/or operation permit: 6 (7.0%)
- Failure to conduct Lead public education: 1 (1.2%)

Monitoring & Reporting Violations in 2005

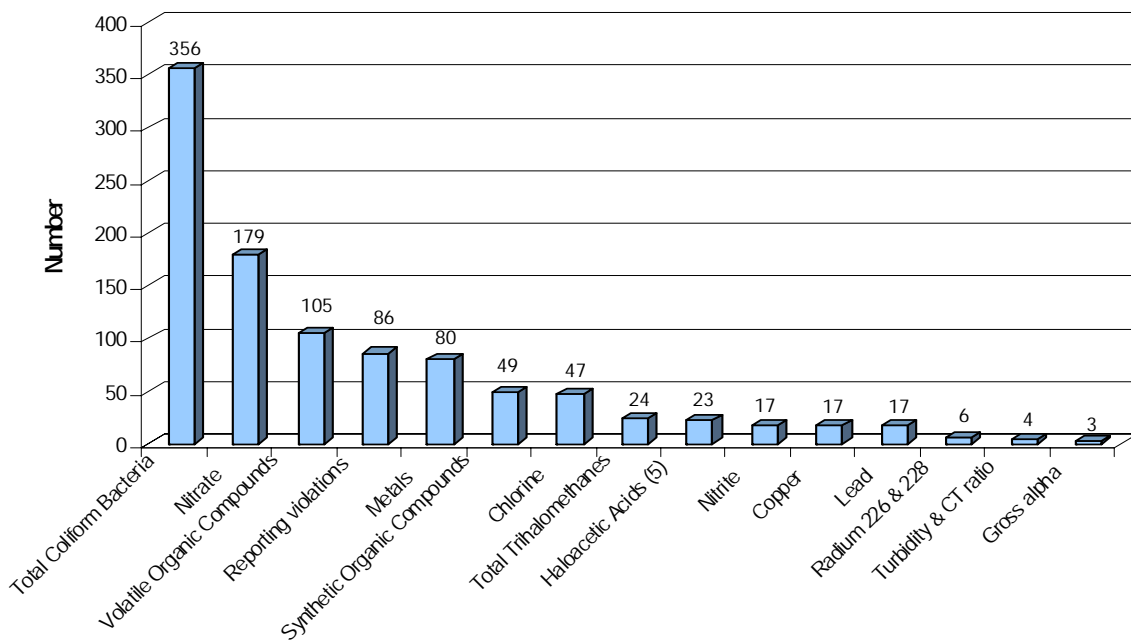

The National Public Drinking Water Program: An Overview

The United States Environmental Protection Agency (EPA) established the Public Water System Supervision Program under authority of the 1974 Safe Drinking Water Act (SDWA), which was most recently amended in 1996.

- To ensure the water is safe for human consumption, EPA sets national limits on allowable contaminant levels in public water supply systems. These limits are known as maximum contaminant levels and maximum residual disinfectant levels.
- Because certain contaminants are difficult to measure, EPA establishes treatment techniques or action levels in lieu of a maximum contaminant level to control unacceptable levels of those specific contaminants in public drinking water.
- EPA specifies how often systems must monitor for contaminants and requires those monitoring results be reported to the state. Generally, the larger the population, the more frequent the monitoring and reporting requirements.
- EPA requires systems to notify the public they serve when violations of the drinking water regulations occur. Public notification must include a clear and understandable explanation of the nature of the violation, potential adverse health effects resulting from the violation, steps the system is taking to correct the violation, and the availability and necessity of using alternative water supplies until the violation is corrected.
- EPA also has requirements for certification of water distribution and water treatment operators, environmental laboratory certification, and development of systems' technical, financial, and managerial capacity, to ensure that systems are properly operated.

The SDWA applies to all 50 States, the District of Columbia, Native American Indian Lands, Puerto Rico, the Virgin Islands, American Samoa, Guam, the Commonwealth of the Northern Mariana Islands and the Republic of Palau.


The SDWA allows States and Territories to seek EPA approval to administer the Public Water Supply Supervision Program within their state or territory, which is called primacy. To receive primacy, States must meet certain requirements set forth in the SDWA regulations, including adoption of drinking water regulations which are at least as stringent as federal regulations, and must demonstrate that the state or territory can enforce the program requirements. Of the states and territories, all but Wyoming and the District of Columbia have primacy. The EPA Regional Offices administer the PWSS programs within those two jurisdictions.

Native American tribes must meet the same requirements as a state in order to receive primacy. The three public water supplies operated by Native American tribes in Iowa have not received primacy and are overseen directly by EPA: Winn-A-Vegas Casino in Sloan; CasinOmaha in Onawa; and, the Sac & Fox Community in Tama.

EPA regional offices report to the states any enforcement actions taken by EPA within their jurisdiction. All SDWA data for a state is stored in an automated database called the Safe Drinking Water Information System (SDWIS). This database currently contains an inventory of public water supply systems and violation records.

The IDNR Drinking Water Program Components

The Iowa public drinking water program has the following responsibilities, conducted by staff located centrally in Des Moines (Water Supply and Region 5), as well as in six other cities around the state: Manchester (Region 1), Mason City (Region 2), Spencer (Region 3), Storm Lake (Satellite Office 3A), Atlantic (Region 4), and Washington (Region 6). The offices are shown on the map at the right.

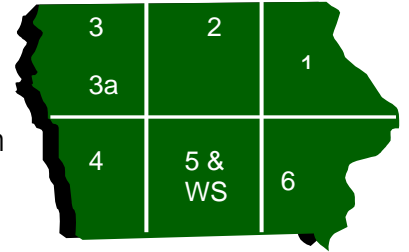

On-Site Inspection

- conducts site surveys for well and treatment facility placement,
- inspects every public water supply system in the state at least every five years (three years for surface water CWS), which includes examination of the operation and maintenance of the entire system,
- provides technical assistance to water supply operators,
- responds to complaints from the public,
- provides emergency response to spills that may threaten water resources

Operation Permitting

- issues the operation permits for each system at least every three years, which lists the system-specific monitoring and operation requirements,
- monitors the compliance by each system with the drinking water program requirements,
- prepares violation notices, compliance schedules and enforcement actions

Construction Permitting

- issues construction permits for projects,
- reviews preliminary engineering reports, viability assessments and source water protection plans,
- assists systems and consulting engineers in selecting various treatment technologies for specific water quality problems.

Water Allocation and Use Permitting

- allocates and tracks the withdrawal of water from Iowa's aquifers and surface waters,
- issues and renews water use permits that are effective for ten years, and
- reviews water conservation plans.

Drinking Water Operator Certification

- evaluates applicants qualifications to determine eligibility for examination,
- certifies operators that successfully complete a written exam,
- renews certification of operators that earn continuing education units,

Environmental Laboratory Certification

- certifies laboratories that analyze samples,
- contracts with the University Hygienic Laboratory to inspect environmental laboratories every two years and check the accuracy of annual proficiency testing samples.

Drinking Water State Revolving Loan Program


- makes loans to drinking water systems for construction of drinking water sources, treatment, storage and distribution systems to ensure public health and provide safe drinking water,
- makes loans for implementation of source water protection projects,
- scores and ranks applications based on whether the projects addresses health risks, rule compliance, infrastructure needs, and source water protection including criteria for loan eligibility.

Iowa also provides a variety of assistance to public water systems through the following four programs:

- **Capacity Development** The department continues to employ a capacity development strategy (also called viability assessment) to improve the financial, technical, and managerial capabilities of all water systems. New systems must be viable when they first serve water to the public. Existing systems are required to conduct self-assessments based upon various performance factors.
- **Source Water Protection** The first step in a multiple-barrier approach to drinking water protection is preventing contamination of drinking water sources. Iowa continues to perform source water assessments for new public water sources, but the primary emphasis of the Source Water Protection program focuses on the implementation of local and regional source water protection activities and projects. Iowa also coordinates with regional and local governmental and non-governmental entities to provide source water protection assistance and education to interested communities. All existing public water supplies had a source water delineation and contaminant source inventory completed by the IDNR's Geological Survey Section (groundwater systems) or other providers (for surface water systems) by July 2004. The systems then use this base document to develop their system-specific source water protection plans. As of May 2005, 115 systems have approved final source water protection plans.
- **Public Water System Security** The department provides information, consultation, and training to public water systems and operators regarding drinking water security.
- **Technical Assistance Contracts** The department administers contracts for projects that provide technical assistance to water operators and to systems serving less than 10,000 persons.

The number of public water supply systems in Iowa declined slightly in 2005 from the previous year but continues the overall increasing trend, as indicated below. Any system that was active for a single day during the year is included in that year's total.

Number of Regulated Iowa PWSs from 1996 - 2005

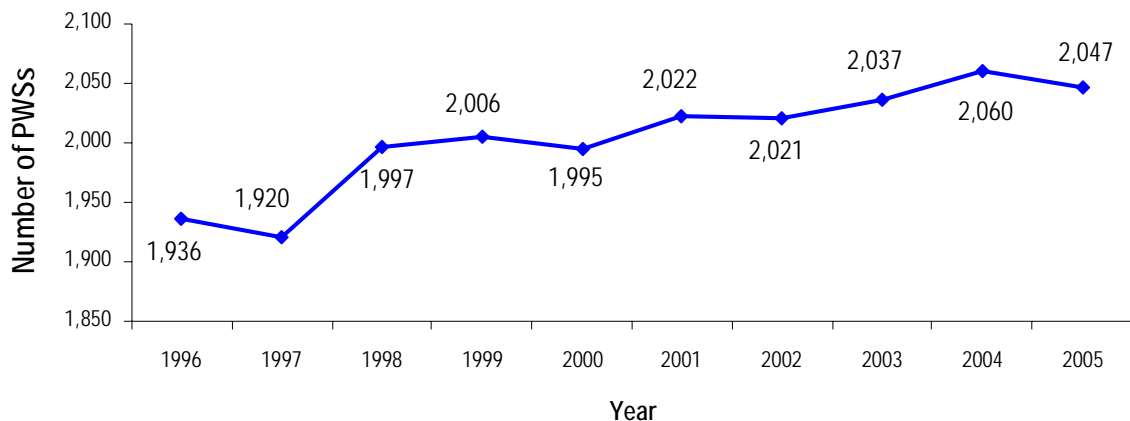

Iowa's Public Water Supply Systems

Definition of a PWS

A public water supply system is a system that provides water to the public for human consumption. The system must have at least 15 service connections or regularly serve an average of at least 25 individuals daily at least 60 days out of the year. An example of a system that is not a public water supply (a private water supply) would be a well serving a farmstead or rural home with 6 residents.

A public water supply system (PWS) is either a community water system, a non-transient non-community system, or a transient non-community system.

- A **community water system (CWS)** is a PWS that meets the above definition for year-round residents. Examples of CWSs include municipalities, subdivisions, and mobile home parks.
- A **non-transient non-community water system (NTNC)** is a PWS that regularly serves at least 25 of the same people four hours or more per day, for four or more days per week, for 26 or more weeks per year. Examples of these systems are schools, day-care centers, factories, and offices. Other service-oriented businesses, such as hotels, resorts, hospitals, and restaurants, are classified as NTNCs if they employ 25 or more people and are open for 26 or more weeks of the year.
- A **transient non-community water system (TNC)** is a PWS other than a CWS or NTNC that regularly serves at least 25 individuals daily at least 60 days out of the year. Examples of TNCs are convenience stores, bars, restaurants with fewer than 25 employees, golf courses, camps, parks, and recreation areas.

Public Water Supply Systems in Iowa

Number of Systems

In 2005, over 2.65 million Iowans were served by community public water supplies, or 90.6% of the total state population (2000 census), with the remaining 9.4% of the population served by private water supplies. Iowa's 2,047 public water supply systems in 2005 included 1,153 CWS, 142 NTNC, and 752 TNC systems.

System Size

Iowa is a small-system state, as indicated in the following table, with 94% of our systems each serving fewer than 3,300 people.

Population Served	EPA Classification	Number of PWS	Percentage of Total PWS
25 – 500	Very Small	1,468	71.7
501 – 3,300	Small	454	22.2
3,301 – 10,000	Medium	82	4.0
10,001 – 100,000	Large	40	1.9
Over 100,000	Very Large	3	0.2
Total		2,047	100.0

System Source Water

Iowa's drinking water is obtained from three sources:

- Groundwater from deep or shallow wells,
- Surface water from rivers, lakes, and reservoirs, and
- Groundwater that is under the direct influence of surface water as determined through testing by the presence of insects, bacteria, algae, pathogens, and/or significant and relatively rapid shifts in physical and chemical water characteristics.


Since a PWS can use any combination of water sources in its system, the PWS is classified by the source that is most vulnerable to contamination. Surface water systems are most vulnerable to contamination, followed by influenced groundwater systems. As indicated in the following tables, 92% Iowa's systems are served by groundwater sources, which serve 57% of the population. Surface water and influenced groundwater sources are used in the remaining 8% of systems, yet they serve 43% of the population.

Source of Water	Number of PWS	Percentage of Total PWS	Percentage of Total Population Served
Surface water	140	6.8	33.5
Influenced Groundwater	26	1.3	9.5
Groundwater	1,881	91.9	57.0

Systems using surface water or influenced groundwater sources have more complex operational and monitoring requirements than do groundwater systems, because of the greater treatment requirements of their source water.


System Source Water in Iowa:

The vast majority of Iowa's systems are supplied by groundwater.

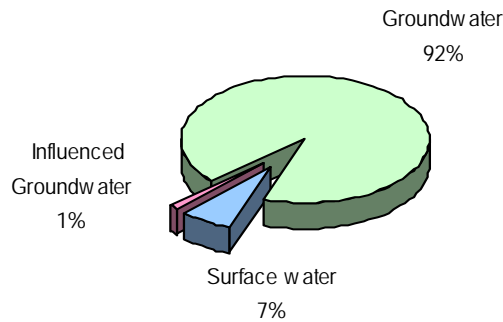

Population Served by the various Source Waters:

Even though 92% of Iowa's systems use groundwater, only 57% of the state's population is served by groundwater systems. The more populated areas of the state are generally served by surface water or influenced groundwater sources.

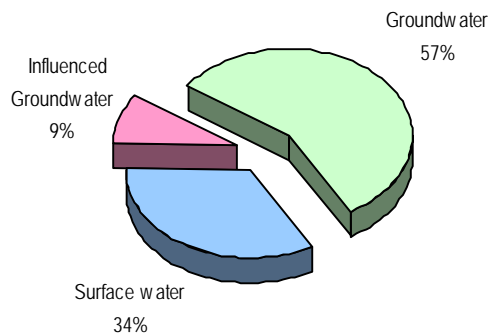

Maximum Contaminant Levels (MCLs) and Maximum Residual Disinfectant Levels (MRDLs)

All systems classified as public water supplies are required to test periodically for coliform bacteria, nitrate, and nitrite. Inorganic and organic chemical testing are only required in community and non-transient non-community systems. With the exception of chlorine, chloramines, and chlorine dioxide, the contaminants are regulated by a specific maximum contaminant level (MCL). An MCL is defined as the maximum permissible level of a contaminant in water that is delivered to any user of a PWS. Chlorine, chloramines, and chlorine dioxide are regulated by a maximum residual disinfectant level (MRDL), defined as the level of a disinfectant added for water treatment that may not be exceeded at the consumer's tap without an unacceptable possibility of adverse health effects.

With both the MCL and MRDL, if the drinking water meets that limit for a specific contaminant, it is considered to be safe.

In this section, the requirements for each group of contaminants are described, including the type of violation, common sources of contamination, specific health effects, how a violation is incurred, and how the system returns to compliance. The rules pertaining to MCLs and MRDLs are listed in the Iowa Administrative Code 567—Chapters 40, 41, 42, and 43.

Contaminants posing an immediate risk to human health (Acute)

There are five regulated contaminants that may pose an immediate, or acute, risk to human health if they are found in drinking water: fecal coliform bacteria, *E. coli*, nitrate, nitrite, or chlorine dioxide.

Coliform Bacteria, including fecal coliform bacteria and *E. coli*—567 IAC 41.2(1)

Sources of Contamination: Total coliform bacteria are common in the environment and are generally not harmful themselves. Fecal coliform bacteria and *E. coli* are generally not harmful themselves, but their presence in drinking water is serious because they usually are associated with sewage or animal waste. The presence of these bacteria in drinking water generally is a result of a problem with water treatment or the pipes which distribute the water, and indicates that the water may be contaminated with organisms that can cause disease (pathogens).

Health Effects: At greatest risk are children, pregnant women, infants, elderly persons, and persons with compromised immune systems. Disease symptoms may include diarrhea, cramps, nausea, headaches, and fatigue. Chlorinating the drinking water will provide disinfection. Boiling water in the home is also an effective method of sterilizing the drinking water.

Acute MCL: When total coliform bacteria are present in any sample, that sample is also analyzed for fecal coliform bacteria or *E. coli*. Any confirmed fecal coliform bacteria or *E. coli* sample is a violation of the MCL for total coliform bacteria. To meet this MCL, all drinking water samples must be free of these bacteria.

Violation: A PWS incurs a violation when the MCL is exceeded in any one monthly or quarterly compliance period. A violation of the acute coliform bacteria MCL is an acute violation and public notification must be started within 24 hours of notification of the violation.

Compliance Achieved: The system returns to compliance when all analytical results are below the MCL for a period of six consecutive months, and all required samples are collected as directed.



Nitrate and Nitrite—567 IAC 41.3

Source of Contamination: Nitrate and nitrite contamination can occur from several sources: the natural decay of organic materials such as leaves and crop residue, use of commercial fertilizers, contamination by human sewage and wastes from farm animals, and the nitrification of ammonia in the treatment and distribution system.

Health Effects: Excessive levels of nitrate and nitrite in drinking water can cause serious illness and sometimes death in infants less than six months of age. Nitrate converts to nitrite, which interferes with the oxygen-carrying capacity in the child's blood (methemoglobinemia or blue-baby syndrome). This is an acute disease because symptoms can develop rapidly in infants. In most cases, health deteriorates over a period of days. Symptoms include shortness of breath and blueness of the skin. Expert medical advice should be sought immediately if these symptoms occur. Boiling the water will only concentrate nitrates in drinking water, and should not be attempted. Alternative sources of water should be used, such as Food and Drug Administration (FDA) approved bottled drinking water with low levels of nitrate clearly listed on the packaging.



Acute MCL: The MCL for nitrate is 10 mg/L as N and the MCL for nitrite is 1.0 mg/L as N.

Violation: A system incurs a violation when the MCL is exceeded in any one compliance period, assigned either as a monthly, quarterly, or annual requirement. Violation of the nitrate or nitrite MCL is an acute violation.

Compliance Achieved: The system returns to compliance when all analytical results are below the MCL for a period of six consecutive months, and all required samples are collected as directed.

Chlorine Dioxide—567 IAC 41.6

Source: Chlorine dioxide is a chemical added to drinking water for the purposes of microbial disinfection and oxidation of dissolved organic carbon (to reduce formation of disinfection byproducts).

Health Effects: Some infants and young children who drink water containing chlorine dioxide in excess of the MRDL could experience nervous system effects. Similar effects may occur to the fetuses of pregnant women who drink water containing chlorine dioxide in excess of the MRDL. Some people may experience anemia. Violations of the chlorine dioxide standard within the distribution system may harm human health based on short-term exposures. Certain groups, including fetuses, infants, and young children, may be especially susceptible to nervous system effects from excessive chlorine dioxide exposure.

Acute MRDL: The MRDL for chlorine dioxide is 0.8 mg/L as ClO₂, and only applies to those systems using chlorine dioxide in their treatment processes. An acute MRDL occurs when too much of the chlorine dioxide is applied during the treatment process at the treatment plant.

Violation: A system incurs an acute violation when the daily monitoring results in the distribution system exceed the MRDL on the day following an elevated chlorine dioxide level at the entry to the distribution system.

Compliance Achieved: The system returns to compliance when the analytical results are below the MRDL for a period of six consecutive months, and all required samples are collected as directed.

Contaminants posing a long-term risk to human health (chronic or non-acute)

Total Coliform Bacteria—567 IAC 41.2(1)

Source of Contamination: Total coliform bacteria are common in the environment and are generally not harmful themselves, but their presence in drinking water is serious because it indicates a pathway of contamination. The presence of these bacteria in drinking water generally is a result of a problem with

water treatment or the pipes which distribute the water, and indicates that the water may be contaminated with organisms that can cause disease.

Health Effects: At greatest risk are children, pregnant women, infants, elderly persons, and persons with compromised immune systems. Disease symptoms may include diarrhea, cramps, nausea, headaches, and fatigue. Chlorinating the drinking water will provide disinfection. Boiling water in the home is also an effective method of sterilizing the drinking water.

Non-Acute MCL: Compliance with the MCL is determined by the presence or absence of total coliform bacteria in a sample. Any confirmed total coliform sample, with no detection of fecal coliform or *E. coli*, is a violation of the MCL for total coliform bacteria. To meet this MCL, all drinking water samples must be free of total coliform bacteria.

Violation: A system incurs a violation when the MCL is exceeded in any one compliance period assigned either as a monthly or quarterly requirement.

Compliance Achieved: The system is returned to compliance when all results are below the MCL for a period of six consecutive months, and all samples are collected as directed.

Inorganic Chemicals—567 IAC 41.3 (not including lead & copper)

Source of Contamination: Inorganic contaminants can leach into drinking water after dissolving from naturally-occurring minerals in the ground, or from runoff from industrial sources or landfills. Chlorite and bromate are byproducts of disinfection.

Health Effects: These contaminants may damage organs such as the kidneys and liver, damage the cardiovascular system and central nervous system, and are sometimes associated with high blood pressure and cancer. High levels of fluoride may cause dental and skeletal fluorosis.

Non-Acute MCL: Compliance with the MCL is determined based upon the sampling frequency:

- For systems collecting a sample every month or quarter, compliance with the MCL is determined using a running annual average.
- For systems collecting a sample annually or longer in frequency, compliance with the MCL is determined using the average of the initial sample and a confirmation sample.

Compliance with the chlorite requirements for systems using chlorine dioxide is determined from both source/entry point and distribution system samples.

Violation: A PWS incurs a violation when the MCL is exceeded in the average of the required samples.

Compliance Achieved: The system is returned to compliance when it has no monitoring or MCL violations for a period of six consecutive months.

Organic Chemicals—567 IAC 41.5

Organic chemicals are classified as a volatile organic chemical [VOC] or a synthetic organic chemical [SOC].

Sources of Contamination: Organic contaminants come from petroleum solvents, paint removers, degreasers, cleaning fluids, pesticides, gasoline, electrical transformers, manufacturing processes, chemical production, byproducts from disinfection, and the production of plastics. Agricultural runoff, improper waste disposal, and improper handling and storage techniques contribute to drinking water contamination via percolation of the contaminant through the soil into the groundwater.

Health Effects: These contaminants may damage organs such as the heart, liver, and kidneys, damage the central nervous and immune systems, and cause cancer.

Non-Acute MCL: Compliance with the MCL is determined based upon the sampling frequency:

- For systems collecting a sample annually or longer in frequency, compliance with the MCL is determined using the average of the initial sample and a confirmation sample.



- For systems collecting a sample every month or quarter, compliance with the MCL is determined using a running annual average.

For contaminants with an established Health Advisory (HA) level but no established MCL, the PWS is required to conduct public notification each quarter in which the HA is exceeded.

Violation: A PWS incurs a violation when the MCL is exceeded in the average of the required samples.

Compliance Achieved: The system is returned to compliance when it has no monitoring or MCL violations for a period of six consecutive months.

Radionuclides—567 IAC 41.8


Source of Contamination: Alpha emitters, which include radium and uranium, occur naturally in certain groundwaters in the state due to the geological formations, particularly in the deeper aquifers. Beta emitters are usually the result of manmade sources or activities.

Non-Acute MCL: Compliance with the MCL is determined from the annual average of four quarters of sampling, either four separately analyzed samples or four temporally composited aliquots.

Health Effects: Radionuclide contaminants may cause cancer.

Violation: A PWS incurs a violation when the MCL is exceeded in the average of the required samples.

Compliance Achieved: The system is returned to compliance when it has no monitoring or MCL violations for a period of six consecutive months.

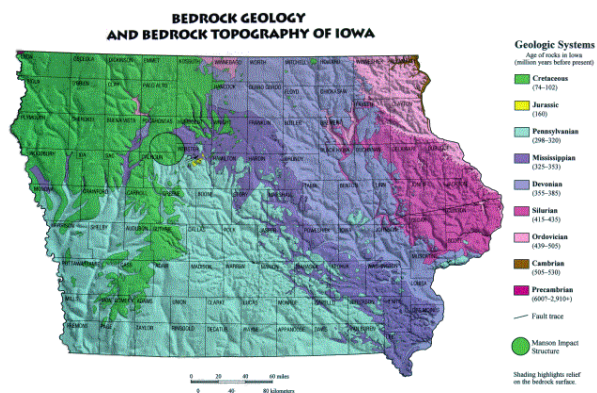


Map courtesy of IDNR Geological Survey

Disinfectants—567 IAC 43.6

Disinfectants are chemicals added to the drinking water during treatment to provide disinfection at the treatment plant and in the distribution system. They are regulated by a maximum residual disinfectant level, MRDL, which is the maximum amount of disinfectant allowed in the system.

Health Effects: Health effects for chlorine and chloramines include irritating effects to the eyes and nose, stomach discomfort, and (chloramine only) anemia. Chlorine dioxide can cause nervous system effects and anemia. Similar effects may occur in fetuses of pregnant women who drink water containing chlorine dioxide in excess of the MRDL.

Non-Acute MRDL: Compliance with the chlorine and chloramine maximum residual disinfectant level (MRDL) is determined from the annual average of twelve months of sampling. Compliance with the chlorine dioxide maximum residual disinfectant level is determined from the comparison of the source/entry point and distribution system samples to the MRDL. Chlorine dioxide can be either an acute (found in the distribution system above the MRDL) or a non-acute health risk (only found at the treatment plant above the MRDL), depending upon the duration and location of the elevated levels in the system.



Violation: A system incurs a violation for chlorine or chloramines when the MRDL is exceeded in the annual average of the required samples. A non-acute violation is incurred for chlorine dioxide when the source/entry point sample exceeds the MRDL for two consecutive days and the distribution system samples are all below the MRDL.

Compliance Achieved: The system is returned to compliance when all results are below the MRDL for a period of six consecutive months, and all samples are collected as directed.

Action Level and Treatment Technique Requirements

Certain systems are required to meet action level and treatment technique requirements. All NTNC and CWS systems are required to comply with the lead and copper action levels. All systems using surface water or influenced groundwater are required to comply with the treatment techniques.

In this section, the requirements for each group of contaminants are described, including the type of violation, common sources of contamination, specific health effects, how a violation is incurred, and how the system returns to compliance. If the drinking water from these systems meets the stated requirements, it is considered to be safe.

Action Level (AL) Requirements

Lead/Copper Action Levels—567 IAC 41.4

Action Level Exceedance: Lead and copper are regulated by action levels (AL) rather than MCL standards. Compliance with the action level is based upon the number of samples collected. The lead action level is exceeded if the concentration of lead in more than 10 percent of tap water samples collected during any monitoring period is greater than 0.015 mg/L (i.e., if the "90th percentile" lead level is greater than 0.015 mg/L). The copper action level is exceeded if the concentration of copper in more than 10 percent of tap water samples collected during any monitoring period is greater than 1.3 mg/L (i.e., if the "90th percentile" copper level is greater than 1.3 mg/L). If the action level at the 90th percentile is exceeded for either lead or copper, it represents a long-term risk to health.

Source of Contamination:

- Lead is a common metal found in lead-based paint, household dust, and certain types of pottery, porcelain, and pewter. It can be found in drinking water due to leaching from lead pipes, from lead solder on indoor plumbing, or from brass faucets and fixtures.
- Copper is often used to plumb residential and commercial structures that are connected to water distribution systems. Leaching of copper from these sources can result in contamination of the drinking water.



Health Effects: Lead builds up in the body over many years and can cause damage to red blood cells and kidneys, as well as damage to the brain, causing mental retardation. Copper at high levels can cause stomach and intestinal distress, liver and kidney damage, and anemia.

Violation: A PWS is out of compliance when the action level is exceeded for either lead or copper in any one compliance period, assigned either as a six-month, annual, or triennial requirement. Once the action level is exceeded, the PWS must collect water quality parameters, develop a corrosion control treatment study, implement steps to control the corrosion in the water, and collect additional samples to demonstrate return to compliance with the action level standard.

Compliance Achieved: A system is returned to compliance when the sample results for two compliance periods are below the action levels for both lead and copper. This can take several years to accomplish due to the time needed to refine corrosion control processes, which is then followed by a year of sampling. Those results must be below the action level before the violation is considered to be compliance achieved.

Treatment Technique Requirements (TT)

EPA established treatment techniques in lieu of MCLs to control unacceptable levels of some contaminants. If a system using surface water or influenced groundwater exceeds the turbidity limit, does not meet the residual disinfectant requirements, or does not meet the disinfection contact time ratio (CT), that system incurs a treatment technique violation. The violation could be either an acute or non-acute violation, depending upon the specific situation.

Surface Water Treatment Rule, Interim Enhanced Surface Water Treatment Rule, and Long-term 1 Enhanced Surface Water Treatment Rule—567 IAC 43.5, 43.9, and 43.10

This rule establishes criteria under which water systems supplied by surface water (SW) or groundwater under the direct influence of surface water (IGW), must filter and disinfect the water during the treatment process. These required treatment techniques are in addition to the other requirements of groundwater systems. All SW/IGW systems have filtration treatment in Iowa.



Treatment Techniques: For purposes of this report, treatment techniques are specified for SW/IGW systems to reduce or remove contaminants that must be monitored at the system and cannot be feasibly or economically measured in a laboratory. The definition of a treatment technique is a treatment process that leads to a reduction in the level of a contaminant sufficient to meet drinking water standards. Examples of treatment techniques for SW/IGW systems are turbidity removal, disinfectant residual maintenance, and sufficient disinfectant contact time.

Turbidity—567 IAC 43.5 and 43.9

Treatment Technique: All SW/IGW systems, regardless of size, must meet the treatment techniques for turbidity. Turbidity (or cloudiness) of drinking water is a measure of the minute particles suspended in the water that can interfere with disinfection and testing for bacteria. It can also prevent maintenance of an effective disinfectant residual throughout the distribution system. Systems are required to remove 99% (2-log) of the *Cryptosporidium* oocysts through filtration. In addition, systems using conventional or direct filtration must meet the following two treatment techniques for turbidity:

- the turbidity level of representative samples of a system's filtered water must be less than or equal to 0.3 NTU in at least 95% of the measurements taken each month, and
- no single sample result may exceed 1 NTU.

Sources of Contamination: The major source of turbidity contamination is soil runoff.

Health Effects: Turbidity by itself has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms such as bacteria, viruses, and parasites such as *Giardia lamblia* and *Cryptosporidium* that can cause symptoms such as nausea, cramps, diarrhea, and associated headaches and can result in death.

Violation: A PWS incurs a treatment technique violation when either standard is exceeded in any month.

Compliance Achieved: A system is returned to compliance when turbidity results consistently meet the standards.

Residual Disinfectant (minimum)—567 IAC 43.5

All SW/IGW systems must provide disinfection to provide inactivation or removal of 99.9% *Giardia lamblia* cysts and 99.99% viruses. The chlorine residual in drinking water is a measure of the amount of available

chlorine in the water. It also allows the maintenance of an effective disinfectant agent throughout the distribution system.

- The disinfectant entering the distribution system cannot be lower than 0.3 mg/L free residual chlorine for more than four hours.
- The disinfectant within the distribution system, measured as total chlorine, combined chlorine, or chlorine dioxide, cannot be undetectable in more than 5% of the samples each month for any 2 consecutive months. This also applies to heterotrophic plate counts (HPC) which can be measured in lieu of disinfectant monitoring. The HPC must be less than or equal to 500 colony forming units per milliliter of sample in order to have acceptable disinfectant residual.

CT Ratio—567 IAC 43.5

All SW/IGW systems must determine their CT value on a daily basis.

- The CT in drinking water is determined by multiplying the disinfectant concentration by the amount of time that the disinfectant is in contact with the water. Each system must achieve a specific CT prior to the treated water entering the water distribution system. The amount of CT required depends on water quality parameters, which include the pH and temperature of the water.
- Insufficient CT can allow disease-causing organisms such as *Giardia lamblia* or viruses to survive and thereby be distributed throughout the system.

Health Effects: CT has no health effects, however, insufficient CT levels can allow disease-causing organisms that can cause symptoms such as nausea, cramps, diarrhea, and associated headaches to survive and enter the distribution system.

Violation: A system incurs a treatment technique violation when the CT ratio or residual disinfectant requirement is insufficient.

Compliance Achieved: A system is returned to compliance when the CT ratio is sufficient and the residual disinfectant requirements have been met. The violation could be returned to compliance in the following month, or the time period could be longer, depending upon the action needed to correct the violation.


Disinfection Byproduct Precursor Removal—567 IAC 43.6

All SW/IGW systems using conventional filtration treatment must determine the removal percentage of disinfection byproduct precursors (organic carbon) on a monthly basis. Failure to remove an adequate percentage is a treatment technique violation. There are alternative compliance criteria that may be used by the system if it is unable to remove the required percentage of total organic carbon. Compliance is determined on running annual average.

Health Effects: Total organic carbon has no health effects, however, it provides a medium for the formation of disinfection byproducts. These byproducts include trihalomethanes and haloacetic acids. Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver, or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Violation: A system incurs a treatment technique violation when the precursor removal percentage is insufficient, and an alternative compliance criteria cannot be used.

Compliance Achieved: A system is returned to compliance when it can meet the precursor removal requirements.



Violation Data for Health-based Standards: MCL, MRDL, AL, and TT

In 2005, approximately 2.50 million people received water served by Iowa public water supply systems that complied with all health-based standards, including MCL, MRDL, AL, and TT standards. In 2005, 89.6% of the population served by community public water supply systems received water that met all drinking water standards adopted by the department. This was a 1.3% improvement from 2004, but didn't meet the 2005 goal of 95 percent. The disinfection byproducts violations of the Stage 1 Disinfectants/Disinfection Byproducts Rule, effective in 2004, occurred in several CWS for the first time in 2005. Without those violations, the compliance rate for CWS would have been 92.9%.


Of the 2,047 regulated PWSs in Iowa, 90.3% were in compliance with all MCL, MRDL, AL, and TT standards. There were 198 PWSs that had at least one violation of an MCL, AL, or TT standard. There were no MRDL violations in 2005. There were 353 violations of eleven contaminants in Iowa in 2005, as indicated in the following table. The most frequent standard that was not met in Iowa is coliform bacteria, which, because all systems must monitor for coliform bacteria at least each quarter, is also the most frequently sampled contaminant in the state.

Analyte	Number of PWS	Number of Violations	Percentage of the Total Number of Violations	Number of Samples Collected in 2005	System Population*
Arsenic	1	1	0.3	252	300
Total Coliform Bacteria	105	158	44.8	52,396	88,626
Fecal Coliform Bacteria	13	16	4.5	1,358	1,007
Copper	19	22	6.2	5,359	12,429
Haloacetic Acids 5 (HAA5)	4	6	1.7	1,290	13,761
Lead	24	25	7.1	5,353	11,205
Nitrate nitrogen	19	44	12.5	3,980	80,437
Nitrite nitrogen	3	3	0.8	551	2,174
Radium 226 & 228	4	8	2.3	170	1,851
Total Trihalomethanes (TTHM)	27	67	19.0	1,292	87,873
Turbidity	2	3	0.8	Not applicable	11,117
Total:	198**	353	100%	72,001	294,967**

* The population for a system with multiple violations in a single category was only included once in this total.


** Each PWS is only included once in the total, even though they may have multiple violations. Likewise, the population of a system is only included once in the system population, even though multiple violations may have occurred in a system.

The number of public water supply systems in compliance with all health-based standards continued a similar trend in 2005 as it has over the past decade, as shown in this chart, with the average compliance rate over the ten-year period at 91.2%. However, the number of regulations that the community systems are required to meet has increased substantially during that same time period.

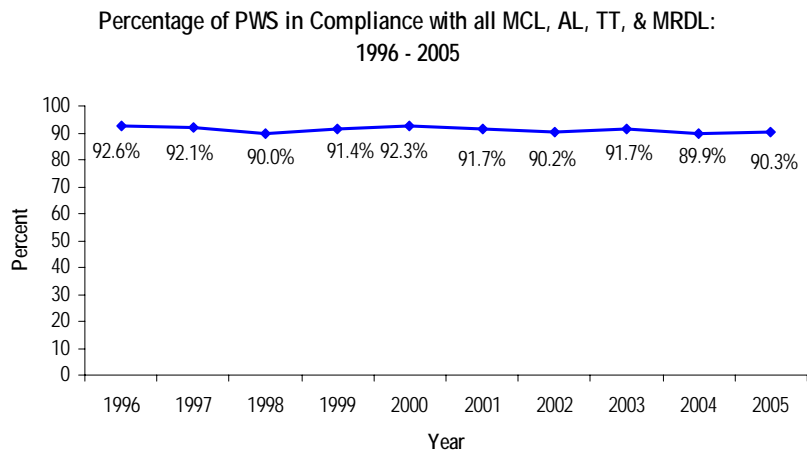


Health-Based Standards Violations: 1996 - 2005

In 2005, both the number of systems with violations of health-based standards and the number of violations decreased from 2004 although increased from 2003. The majority of the violations occurred in coliform bacteria, nitrate, and disinfection byproducts standards.

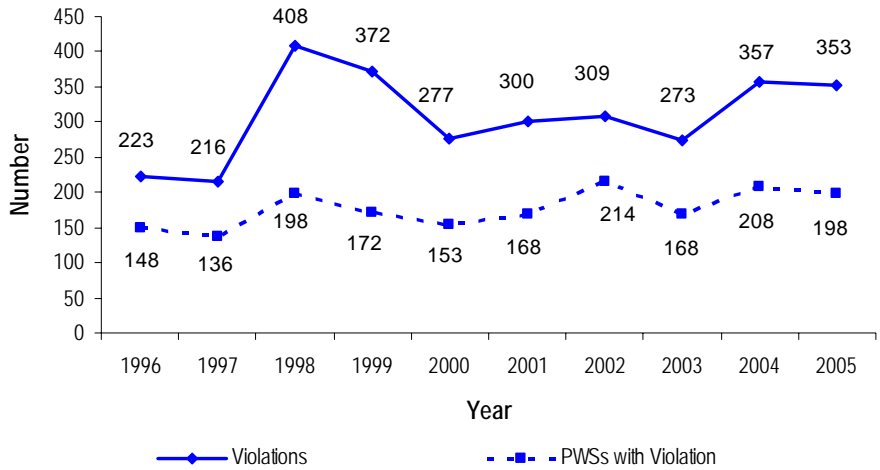


Coliform Bacteria MCL Violations: 1996 - 2005

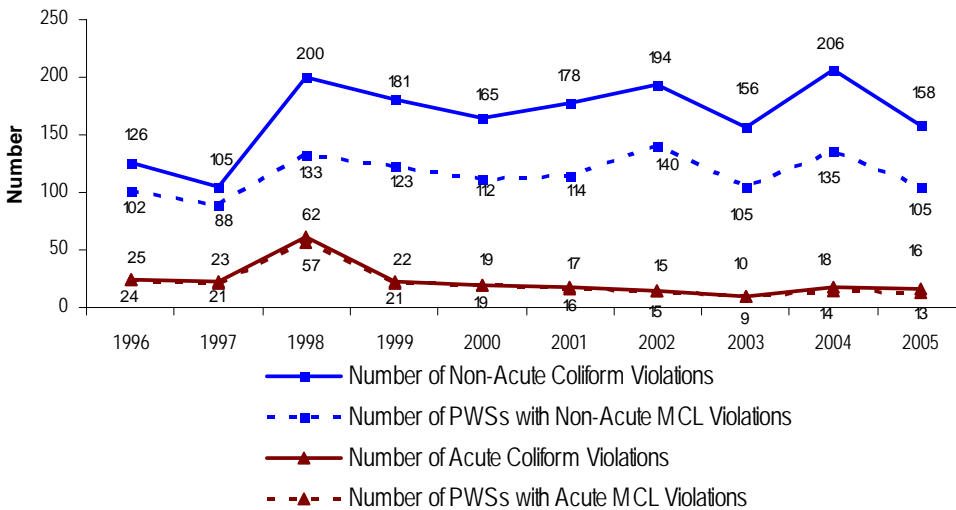

The number of coliform bacteria MCL violations and the number of systems with those violations decreased in 2005. Acute coliform MCL violations are those that have confirmed presence of fecal coliform or *Escherichia coli*, while non-acute coliform MCL violations are those with confirmed coliform bacteria presence that is not of fecal origin.

Nitrate MCL Violations: 1996 - 2005

The number of nitrate MCL violations increased from 2004, although the number of systems with violations decreased. In 2005, there were 7 CWS that had 21 violations; 1 NTNC with 1 violation; and 11 TNC with 22 violations.

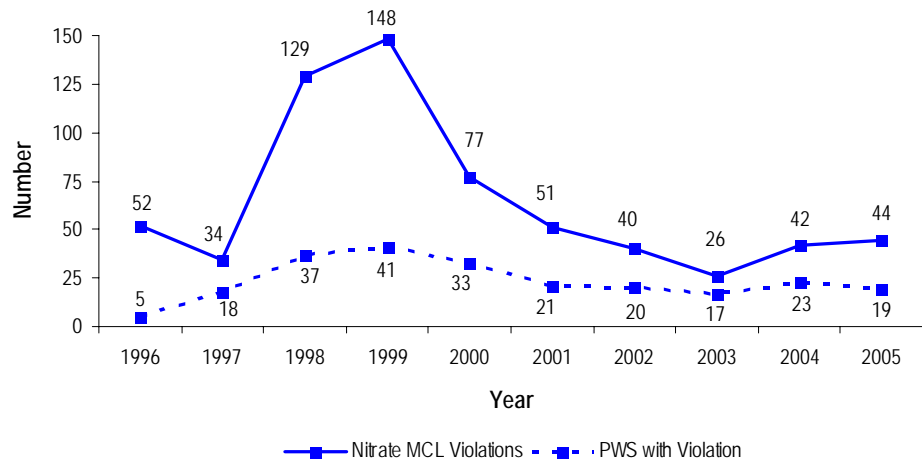

Major Monitoring & Reporting Violations

Monitoring and Reporting (M/R) violations for this report were based on the guidelines briefly described in the next table. EPA deems these violations to be classified as major violations. Minor monitoring violations are those in which at least some of the required monitoring was completed. They are not listed in this report. Systems are assigned the monitoring requirements for each contaminant in an operation permit that is issued at least every three years. The monitoring requirements vary by contaminant, from sampling every four hours (turbidity) to sampling once every nine years (inorganic chemicals). The specific requirements are listed in the Iowa Administrative Code (567) Chapters 41, 42, and 43.

Monitoring Guidelines by Rule:

Rule	Violation Type	Description
Total Coliform Rule	M/R, Routine Major	No samples collected during a compliance period
	M/R, Repeat Major	No follow-up samples collected after a positive sample
Surface Water Treatment Rule, Interim Enhanced Surface Water Treatment Rule, and Long-term 1 Enhanced Surface Water Treatment Rule	M/R, Routine Major	Collected less than 10% of samples required during a compliance period
Lead and Copper Rule	M/R Routine Tap	Failure to collect the initial tap samples followed by a failure to correct that omission within 3 months for large systems, 6 months for medium systems, and 12 months for small systems, or the failure to submit the associated report.
	M/R Routine Tap	Failure to collect any required samples.
Phase I, II, IIB, and V Rules (Inorganic and organic chemicals)	Regular Monitoring	Failure to collect any required samples
Stage 1 Disinfectants & Disinfection Byproducts Rule	M/R, Routine Major	Failure to collect any required samples
Radionuclides	M/R, Routine Major	Failure to collect any required samples
Any Inorganic or Organic Chemical	Confirmation/Check Major	Failure to collect the required confirmation sample.

Out of Compliance: A violation is incurred when the PWS fails to collect, have analyzed, and report the required number of samples in any one compliance period. One violation is issued for each analyte when samples are not collected, analyzed, and reported in accordance with the system's operation permit.

Compliance Achieved: A system is returned to compliance when the samples are collected and the results are reported to the IDNR.

Major Monitoring and Reporting (M/R) Violation Data

Almost 2.6 million people received water served by Iowa's systems that met the major monitoring and reporting requirements. Of the 2,047 regulated PWSs in Iowa, 81.2% (1,662 PWSs) were in compliance with all major monitoring and reporting requirements. There were 385 PWSs serving a total population of 277,231 that incurred 1,024 monitoring and reporting violations in 2005. The IDNR assigns violations by contaminant for each system, which can result in a single system incurring several monitoring violations.

Listed below are the contaminants with a major monitoring or reporting violation in 2005. The majority of violations were for failure to collect coliform bacteria samples (38.0%), failure to collect nitrate samples (19.1%), and failure to collect VOC samples (11.2%). Coliform bacteria and nitrate are the two contaminants that are required to be sampled by all systems.


Contaminant	Number of PWS	Number of Violations	Population Affected *
MONITORING			
Antimony	4	8	1,259
Arsenic	6	11	1,918
Barium	4	8	1,259
Cadmium	4	8	1,259
Chlorine	27	47	66,327
Chromium	4	8	1,259
Coliform Bacteria, Total	221	356	40,461
Copper	17	17	3,193
Fluoride	6	10	1,599
Gross alpha, excluding radon & uranium	3	3	5,878
Haloacetic Acids (5)	23	23	12,662
Lead	17	17	3,193
Mercury	4	8	1,259
Nitrate	124	179	58,669
Nitrite	14	18	3,189
Radium 226 & 228	5	6	6,074
Selenium	4	8	1,259
Sodium	9	13	17,715
SOC (synthetic organic chemicals)	3	49	1,040
SWTR/IESWTR/LT1	2	4	2,511
Thallium	4	8	1,259
Total Trihalomethanes	24	24	12,711
VOC (volatile organic chemicals)	3	105	1,316
Monitoring Total:	333**	938	200,047**
REPORTING			
Failure to provide consumer confidence report	35	35	40,906
Failure to submit monthly operation report	7	9	8,579
Failure to obtain a construction or operation permit	6	6	25,982
Failure to obtain a certified operator	27	27	9,962
Failure to comply with a compliance schedule	8	8	2,554
Failure to conduct Lead public education	1	1	493
Reporting Total:	81**	86	87,442**
Monitoring & Reporting Total:	385**	1,024	277,231**

* The population of each PWS is only counted once for each contaminant.

**Each system with a violation is only included once in the number of systems total and the affected population total. To summarize, 385 systems had a total of 1,024 major monitoring or reporting violations, affecting a total population of 277,231.


Monitoring & Reporting Compliance Rates: 1996 - 2005

The number of public water supplies in compliance with all major monitoring and reporting requirements has fluctuated between 74.8% and 82.7% over the past eight years. The first two years of this report only included major significantly non-compliant systems, which are a subset of the systems with a major monitoring and reporting violations, and is not fully comparable to the more inclusive data reported since 1998. This chart indicates the percentage of PWS in compliance with all major monitoring and reporting requirements, which was 81.2% in 2005.

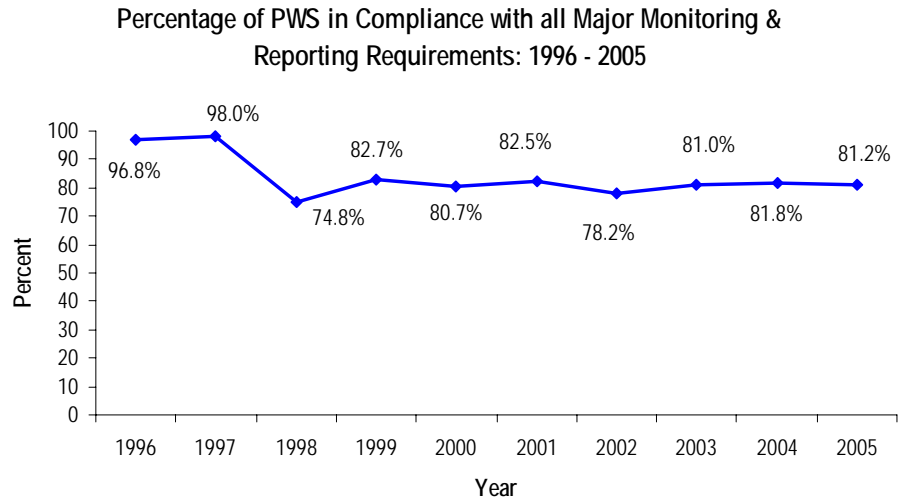

In 2005, the number of systems with monitoring and reporting violations remained steady from the past two years, while the number of violations increased by 127 from 2004. Although this can be influenced by the fluctuation of monitoring schedules over a several year period, the increase in 2005 can be mostly attributed to three systems that did not collect VOC or SOC samples, which contributed 154 violations to the total.

Monitoring & Reporting Violations: 1996 - 2005

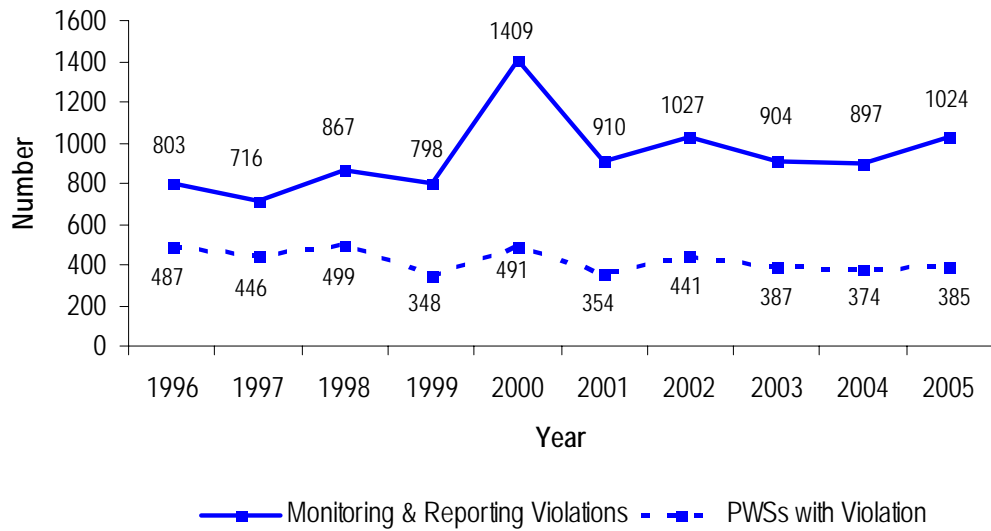

Enforcement Actions

Any time a system incurs a violation, enforcement actions are taken. All systems are issued a notice of violation (NOV), which requires that the public be notified about the violation and any possible health effects. Operation permits are used to list the monitoring and reporting requirements, and also any compliance schedule that the system must meet in order to remedy a violation. The operation permit is termed a "bilateral compliance agreement", because the system has a legal right to appeal the document for 30 days, after which time it is binding.

If a system is unable or unwilling to mitigate a violation, an administrative order (AO) is the next enforcement action. An AO may be issued with a monetary penalty, or more commonly, without a monetary penalty. The next level of escalation in enforcement actions is to refer the system to the Iowa Attorney General for enforcement.

All violations remain "open" until the system satisfies the requirements to return it to compliance. In the case of a monitoring violation, returning to compliance may be as simple as collecting the sample that was missed and conducting public notification. In the case where a system has an ongoing health-based standard violation, the system may have to install treatment processes to be able to successfully remove the contaminant from the water. These types of situations can take many months to remedy, and the system is required to conduct public notification at intervals throughout the time period when they are not in compliance with the health standard.

IDNR tracks the corrective actions for all violations at all PWSs. All violations and corrective actions are reported to EPA. When the criteria for compliance are met, the specific violation is coded "Compliance Achieved". Failure to achieve compliance in a timely manner may result in the issuance of an administrative order. These are the most commonly used enforcement actions:

- NOV issued: A notice of violation has been issued to the system by the department.
- PN requested: Public notification for the violation must be done by the system.
- PN received: Public notification has been done by the system and a copy has been received by the department.
- BCA issued: A bilateral compliance agreement between the system and the department has been issued.
- AO w/Penalty: An administrative order with a penalty has been issued by the department.
- AO w/o Penalty: An administrative order without a penalty has been issued by the department.
- AG Case Referred: The system has been referred to the Attorney General's Office for enforcement action.
- Compliance Achieved: The system is now in compliance and the specific violation is "closed".



Most violations have a predefined set of enforcement actions, which include the following four actions at a minimum: notice of violation issued, public notification requested, public notification received, and compliance achieved. Once the PWS has successfully met the compliance achieved criteria, the system is returned to compliance in the department's computer tracking system.

Variations and Exemptions

Iowa does not use the variance and exemption allowances from EPA.

Public Notification, Lead Public Education, and Consumer Confidence Report—567 IAC Chapter 42

The SDWA requires a system to notify both the people who consume the system's water and the department whenever the following violations occur:

- a Maximum Contamination Level (MCL) has been exceeded,
- a Maximum Residual Disinfectant Level (MRDL) has been exceeded,
- a required Treatment Technique (TT) has not been achieved,
- the lead action level is exceeded in at least 10 percent of the tap water samples,
- a Compliance Schedule has not been met,
- an EPA Lifetime Health Advisory (HA) has been exceeded,
- a waterborne emergency has occurred,
- a certified operator has not been retained for CWS and NTNC systems, or
- other situations where the department determines that public notification is needed.

MCL, MRDL, or Treatment Technique Violation

To comply with the MCL, MRDL, and TT public notification requirements, the PWS must:

- notify the department within 48 hours after the violation occurred (24 hours for acute violations);
- notify the consumers by the required public notification procedures; and
- provide proof of such public notice including a certification to the department.

Monitoring or Reporting Violation

All PWSs must issue public notification for failure to:

- monitor and report the required data to the department;
- comply with established testing procedures; or
- meet the public notification requirements.



Public Education for a Lead Action Level Exceedance

A PWS must notify the IDNR and the population served by the PWS when the 90th percentile exceeds the action level for lead. This lead public education requires that mandatory language be provided to the consumers every twelve months as long as the action level is exceeded, in the following forms:

- newspaper announcement;
- pamphlets and brochures to doctors, clinics, schools, daycare facilities, etc.;
- attachments to customers' water bills;
- a notice printed directly on the water bill; and
- a public service announcement must be issued to television and radio for broadcasting.

In addition to the annual notice, a public service announcement must be issued every six months to local television and radio broadcast outlets.

Consumer Confidence Reports

All CWS must notify the public by July 1 of every year with information on the quality of the water delivered by the system in the previous calendar year, and to characterize the risks (if any) from exposure to contaminants in the drinking water. This report, called a Consumer Confidence Report (CCR) or a Water Quality Report, must be prepared by each CWS and made available to their public. The CCR must include the following information:

- source water information;
- definitions of terms used in the report;
- information on detected contaminants (if any were detected), including mandatory language and additional health information where applicable; and,
- whether the system is not in compliance with any other requirement, including monitoring, public notification, operation, administrative order, or operator certification.



Each CWS must mail or otherwise directly deliver one copy of the report to each customer. Mailing waivers are issued to CWS having fewer than 10,000 persons, provided the system had no violations for the covered calendar year. A CWS serving fewer than 500 persons and having a mailing waiver is allowed to publicly post their CCR.



In 2005, 35 CWS failed to prepare and distribute their CCR for calendar year 2004. Each CWS received a reporting violation for this failure. The compliance rate for Iowa's CWS with the CCR requirements in 2005 was 97.0%.

Health Effects

If a public notification or public education requirement is not met, the public health is placed at risk because the public is unaware of the potential health effects of the water being consumed. Children, pregnant women, the elderly, and persons with compromised immune systems are at the greatest risk from most contaminants.

Public Notification or Public Education Violation

A system is in violation of the public notification or public education rules when it does not issue public notification specific to its violation and does not provide proof of notification to the IDNR. A system is returned to compliance when it publishes the appropriate public notification or public education language within the required amount of time and provides the proof to the IDNR.

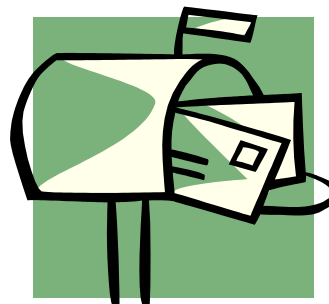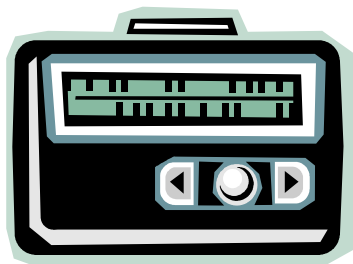

Operator Certification—567 IAC Chapter 81

All CWS and NTNC are required to have a certified operator in direct responsible charge of the water treatment and water distribution systems. The operators must be certified by the department at the same classification of the plant or water distribution system at a minimum.


The Iowa Operator Certification Program reporting time frame is July 1 through June 30. For the certification year of July 1, 2005 through June 30, 2006, the program efforts included:

- accessibility of the operator certification database to all DNR drinking water program staff,
- continued implementation of the new certified operator requirements for community and nontransient noncommunity water supplies, and
- soliciting bids and monitoring contracts for operator training.

Classification of Systems and Facilities

All CWS and NTNC were required in 2002 to designate a certified operator in direct responsible charge of the water treatment and water distribution systems. The facilities are classified according to complexity, with Grade 4 being the most complex. Listed below are the Iowa CWS and NTNC systems in all classification levels, as of May 25, 2006.

Treatment and Distribution System Classification of Iowa's PWS

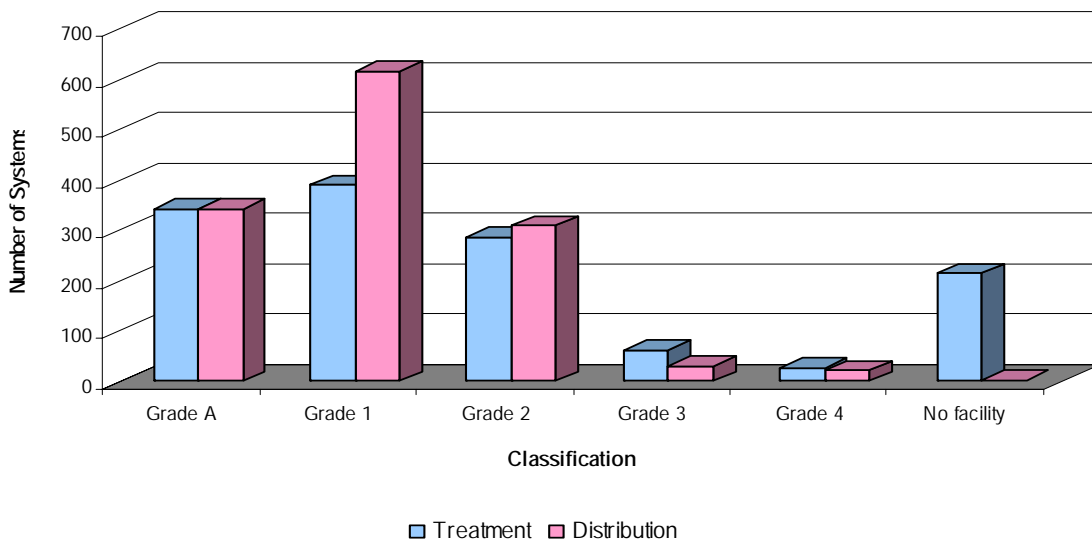

Classification	Treatment Facility	Distribution Facility
Grade A	343	343
Grade 1	391	617
Grade 2	286	310
Grade 3	62	31
Grade 4	26	21
No facility	214	1
Total	1322	1322

Classification Grades for Operator Certification

The Iowa Operator Certification program is predicated on three principles: Education, Experience, and Examination. A certified drinking water operator in Iowa must meet these requirements:


1. Meet the initial education and experience requirements and pay the examination fee
2. Successfully pass the examination for the specific type of certification
3. Maintain the certification by successfully attaining the required continuing education credits during each two-year certification period and paying the bi-annual certification fee

The requirements are based upon the level of complexity of the various facility grades, with Grade A being the least complex and Grade 4 being the most complex.

In 2005, there were 279 small system Grade A certifications, which is a substantial increase over the 2004 level of 219 small system Grade A certifications. Grade A certification includes both water treatment and water distribution. In this reporting period, there were 2,099 active water distribution certifications and 1,993 active water treatment certifications, both of which increased from 2004 levels.

Certification Grade	Number of certified Water Distribution Operators	Number of certified Water Treatment Operators
Grade A	279 (combined WT and WD)	
Grade 1	445	718
Grade 2	737	876
Grade 3	592	231
Grade 4	325	168

The following chart depicts the makeup of the two types of drinking water certifications. Note that Grade A is included in both certifications, since it is a combined water distribution and water treatment certification.

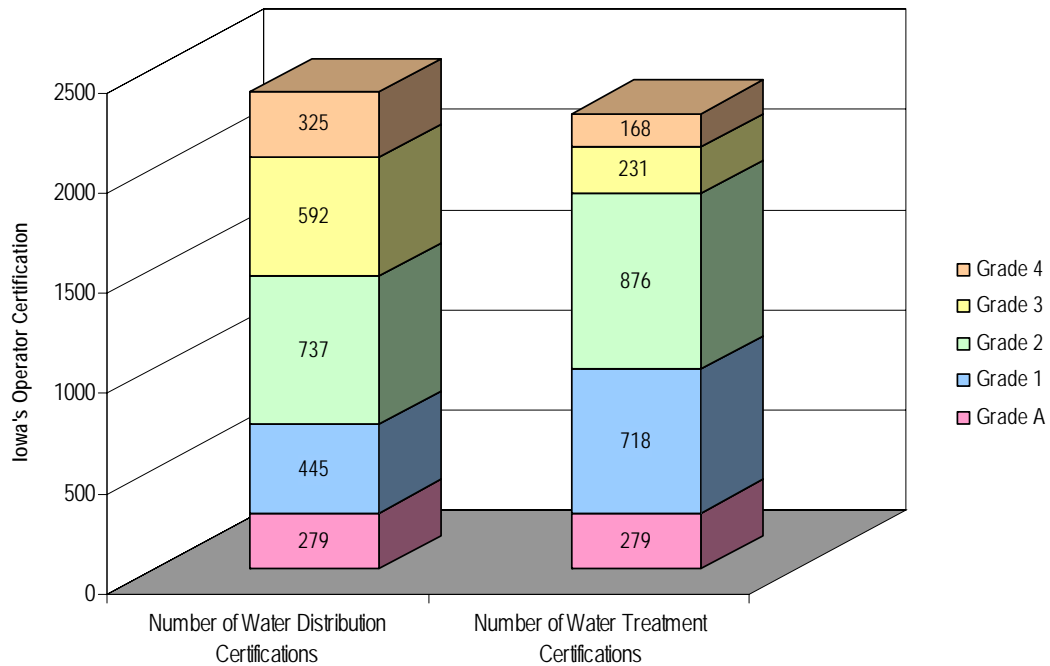

Enforcement

Compliance actions were directed at 27 public water supply systems that failed to have a certified operator in charge of their water supply. The certification for water treatment and water distribution was revoked from the license of one operator during this reporting period.

Certification Renewal

Operator certifications are renewed every two years, with the next renewal period ending in June 30, 2007. Continuing education requirements must be met by March 31, 2007 in order for the operator to renew for the next period. Operators holding a Grade A, 1 or 2 certification are required to earn 1.0 continuing education unit (10 contact hours). Operators holding a Grade 3 or 4 certification must earn 2.0 continuing education units (20 contact hours).

Shown below are various components of water treatment and distribution systems in Iowa.



Pump & pipe gallery



Contact basin



Office with computerized remote system-wide monitoring capability (typically called a SCADA system, or *Supervisory Control And Data Acquisition* system).



Interior of an elevated water storage tower

Abbreviations

AG	Attorney General of Iowa
AL	action level
AOP	administrative order with penalty
AOWP	administrative order without penalty
BCA	bilateral compliance agreement
CCR	consumer confidence report
CT	contact time
Cu	chemical symbol for copper
CWS	community public water supply
EPA	U.S. Environmental Protection Agency
FDA	U.S. Food and Drug Administration
GW	groundwater
IGW	groundwater under the direct influence of surface water
HA	Health Advisory
HAA5	haloacetic acids (5)
HPC	heterotrophic plate count
IAC	Iowa Administrative Code
IDNR	Iowa Department of Natural Resources
IOC	inorganic chemical
LSL	lead service line
MCL	maximum contaminant level
mg/L	milligrams per liter
M/R	Monitoring and Reporting
MRDL	maximum residual disinfectant level
mrem/yr	millirems per year
NOV	Notice of Violation
NTNC	non-transient non-community public water supply
NTU	nephelometric turbidity units
Pb	chemical symbol for lead
pCi/L	picocuries per liter
PE	public education for Lead
PN	public notification
PWS	public water supply system
PWSS	Public Water System Supervision (EPA program)
Rn	chemical symbol for radon
SDWA	Safe Drinking Water Act
SDWIS/FED	Safe Drinking Water Information System/Federal (EPA's electronic database)
SOC	synthetic (nonvolatile) organic chemical
SW	surface water
SWTR	Surface Water Treatment Rule
TCR	Total Coliform Rule
TNC	transient non-community public water supply
TT	treatment technique
TTHM	total trihalomethanes
U	chemical symbol for uranium
V/E	variance or exemption
VOC	volatile organic chemical
WD	water distribution
WT	water treatment
WQP	water quality parameters

Distribution of this Report

The Safe Drinking Water Act requires both summary and detailed reports from the State be accessible to the U.S. EPA, the Governor of Iowa, and the public. The following options are utilized to make this report readily available to the public.

The IDNR sends the detailed report to the:

- EPA Headquarters in Washington, DC,
- EPA Region 7 Headquarters in Kansas City, KS, and
- Office of the Governor of Iowa.

The IDNR also:

- publishes an official notice of report availability,
- includes the report on the IDNR Internet website and makes it available for downloading, and
- makes the detailed and summary report available for individuals and organizations upon request.

Staff Contact Information:

Name	Telephone	Primary Responsibilities	Title
Diane Moles	515/725-0281	Rules and Policy Development	Executive Officer II
Hal Frank	515/725-0342	SDWIS Data Management	Environmental Specialist
Laurie Sharp	515/725-0284	Operator Certification Program	Program Planner 2
John Vedder	515/725-0350	Operation Permits, Compliance/Enforcement, & Data Quality	Sr. Environmental Specialist
Stephen Hopkins	515/725-0295	Water Supply Operation Section Supervisor	Env. Program Supervisor
Dennis Alt	515/725-0275	Water Supply Engineering Section Supervisor	Env. Program Supervisor

Fax number for all of the above: 515/725-0348

E-mail addresses: *first name.last name@dnr.state.ia.us*

Mailing address:

Iowa Department of Natural Resources - Water Supply
401 SW 7th St., Suite M
Des Moines, IA 50309-4611

Photo attribution: All photos in this report were taken by staff of the IDNR Water Supply Sections and, with the exception of the State Capitol on this page, are of systems that have participated in the Iowa Drinking Water State Revolving Loan Fund program.



APPENDIX A: EPA Violations Summary Report

The EPA Violations Summary Report listed in this appendix is a numerical total of the violations of each contaminant required under the SDWA and is a required report element. This report lists the number of violations of each contaminant categorized by both MCL/MRD/TT Violations and major federal Monitoring & Reporting Violations. State violations, such as failure to obtain an operation permit, are not included in this summary report.

Legend

Column (from left to right)	Description of Heading
1	The first column identifies the contaminant name
2	The second column identifies the MCL for that contaminant
3	The third column identifies the number of MCL violations for that contaminant
4	The fourth column identifies the number of PWSs with MCL violations for that contaminant
5	The fifth column identifies the number of TT violations
6	The sixth column identifies the number of PWSs with TT violations
7	The seventh column identifies the number of M/R violations for that contaminant
8	The eighth column identifies the number of PWSs with M/R violations for that contaminant



APPENDIX A: EPA VIOLATIONS SUMMARY REPORT

State: Iowa		Reporting Interval: January 1, 2005 through December 31, 2005					
Organic Contaminants	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
1,1,1-Trichloroethane	0.2	0	0	0	0	5	3
1,1,2-Trichloroethane	0.005	0	0	0	0	5	3
1,1-Dichloroethylene	0.007	0	0	0	0	5	3
1,2,4-Trichlorobenzene	0.07	0	0	0	0	5	3
1,2-Dibromo-3-chloropropane (DBCP)	0.0002	0	0	0	0	0	0
1,2-Dichloroethane	0.005	0	0	0	0	5	3
1,2-Dichloropropane	0.005	0	0	0	0	5	3
2,3,7,8-TCDD (Dioxin)	0.00000008	0	0	0	0	0	0
2,4,5-TP (Silvex)	0.05	0	0	0	0	4	2
2,4-D	0.07	0	0	0	0	4	2
Acrylamide		0	0	0	0	0	0
Alachlor (Lasso)	0.002	0	0	0	0	4	2
Atrazine	0.003	0	0	0	0	4	2
Benzene	0.005	0	0	0	0	5	3
Benzo[a]pyrene	0.0002	0	0	0	0	4	2
Carbofuran	0.04	0	0	0	0	0	0
Carbon tetrachloride	0.005	0	0	0	0	5	3
Chlordane	0.002	0	0	0	0	0	0

Organic Contaminants, continued	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
cis-1,2-Dichloroethylene	0.07	0	0	0	0	5	3
Dalapon	0.2	0	0	0	0	4	2
Di(2-ethylhexyl)adipate	0.4	0	0	0	0	4	2
Di(2-ethylhexyl)phthalate	0.006	0	0	0	0	5	3
Dichloromethane	0.005	0	0	0	0	5	3
Dinoseb	0.007	0	0	0	0	4	2
Diquat	0.02	0	0	0	0	0	0
Endothall	0.1	0	0	0	0	0	0
Endrin	0.002	0	0	0	0	0	0
Epichlorohydrin		0	0	0	0	0	0
Ethylbenzene	0.7	0	0	0	0	5	3
Ethylene dibromide	0.00005	0	0	0	0	0	0
Glyphosate	0.7	0	0	0	0	0	0
Heptachlor	0.0004	0	0	0	0	0	0
Heptachlor epoxide	0.0002	0	0	0	0	0	0
Hexachlorobenzene	0.001	0	0	0	0	0	0
Hexachlorocyclopentadiene	0.05	0	0	0	0	0	0
Lindane	0.0002	0	0	0	0	0	0
Methoxychlor	0.04	0	0	0	0	0	0

Organic Contaminants, continued	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Monochlorobenzene	0.1	0	0	0	0	5	3
o-Dichlorobenzene	0.6	0	0	0	0	5	3
Oxamyl (Vydate)	0.2	0	0	0	0	0	0
para-Dichlorobenzene	0.075	0	0	0	0	5	3
Pentachlorophenol	0.001	0	0	0	0	4	2
Picloram	0.5	0	0	0	0	4	2
Simazine	0.004	0	0	0	0	4	2
Styrene	0.1	0	0	0	0	5	3
Tetrachloroethylene	0.005	0	0	0	0	5	3
Toluene	1	0	0	0	0	5	3
Total polychlorinated biphenyls	0.0005	0	0	0	0	0	0
Toxaphene	0.003	0	0	0	0	0	0
trans-1,2-Dichloroethylene	0.1	0	0	0	0	5	3
Trichloroethylene	0.005	0	0	0	0	5	3
Vinyl chloride	0.002	0	0	0	0	5	3
Xylenes (total)	10	0	0	0	0	5	3
Haloacetic acids	0.060	6	4	0	0	23	23
Total trihalomethanes	0.080	67	27	0	0	24	24

Inorganic Contaminants	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Antimony	0.006	0	0	0	0	8	4
Arsenic	0.010	1	1	0	0	11	6
Asbestos	7 million fibers/L (>10 µm in length)	0	0	0	0	0	0
Barium	2	0	0	0	0	8	4
Beryllium	0.004	0	0	0	0	0	0
Cadmium	0.005	0	0	0	0	8	4
Chromium	0.1	0	0	0	0	8	4
Cyanide (as free cyanide)	0.2	0	0	0	0	0	0
Fluoride	4.0	0	0	0	0	10	6
Mercury	0.002	0	0	0	0	8	4
Nitrate	10 (as Nitrogen)	44	19	0	0	179	124
Nitrite	1.0 (as Nitrogen)	3	3	0	0	18	14
Selenium	0.05	0	0	0	0	8	4
Sodium	not applicable	0	0	0	0	13	9
Thallium	0.002	0	0	0	0	8	4
Total nitrate and nitrite	10 (as Nitrogen)	NA	NA	NA	NA	NA	NA

Contaminant	MCL	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Radionuclide Contaminants							
Gross alpha	15 pCi/L	0	0	0	0	3	3
Radium-226 and radium-228	5 pCi/L	8	4	0	0	6	5
Gross beta	4 mrem/year	0	0	0	0	0	0
Uranium	30 µg/L	0	0	0	0	0	0
Subtotal		129	54*	0	0	497	169*

*: Each system is only counted once in the subtotal category (i.e., 54 systems had 129 MCL violations and 169 systems had 497 monitoring/reporting violations).

Contaminant	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Other Contaminants							
Acute Total Coliform Bacteria MCL violation	Presence	16	13	0	0	0	0
Non-acute Total Coliform Bacteria MCL violation	Presence	158	105	0	0	0	0
Major routine and follow up Total Coliform Bacteria monitoring violation		0	0	0	0	356	221
Sanitary survey		0	0	0	0	State initiates Sanitary survey	State initiates Sanitary survey
Subtotal		174	105*	0	0	356	221

*Each system is counted only once in the subtotal category, i.e., 105 systems had 174 acute and non-acute coliform bacteria violations.

Contaminant	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Surface Water Treatment Rule and Interim Enhanced SWTR *							
Filtered systems *		0	0	0	0	0	0
Monitoring, routine/repeat		0	0	0	0	4	2
Treatment techniques		0	0	3	2	0	0
Unfiltered systems *		0	0	0	0	0	0
Monitoring, routine/repeat		0	0	0	0	0	0
Failure to filter		0	0	0	0	0	0
Subtotal		0	0	3	2	4	2

* All surface water and influenced groundwater systems in Iowa have filtration.

Contaminant	Action Level	Action Level Exceedance		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Lead and Copper Rule	Lead: 0.015 mg/L Copper: 1.3 mg/L	Lead: 25 Copper: 22	Lead: 24 Copper: 19		0	0	0
Initial lead and copper tap M/R		0	0	0	0	0	0
Follow-up or routine lead and copper tap M/R		0	0	0	0	Cu: 17 Pb: 17	Cu: 17 Pb: 17
Treatment installation		0	0	0	0	0	0
Public education		0	0	0	0	1	1
Subtotal		47	39*	0	0	35	18*

*: Each system is only counted once in the subtotal category (i.e., 39 systems had 47 ALE and 18 had 35 monitoring/reporting violations).

Contaminant	MRDL or MCL	MRDL or MCL Violations		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Stage 1 DBPR (TTHM & HAA included under Organic Contaminants)							
Chlorine or chloramine residual	4.0	0	0	0	0	47 monitoring 9 reporting	27 monitoring 7 reporting
Chlorine dioxide	0.8 mg/L	0	0	0	0	0	0
Chlorite	1.0 mg/L	0	0	0	0	0	0
Bromate	0.010 mg/L	0	0	0	0	0	0
Total organic carbon (TOC)		0	0	0	0	0	0
Subtotal		0	0	0	0	56	25*


*: Each system is only counted once in the subtotal category (i.e., 25 systems had 56 monitoring/reporting violations).

APPENDIX B: Iowa Public Water Supply Violation Data

All public water supply systems that incurred one or more violations during 2005 are listed in the following appendix, including the most recent enforcement action. Systems that became "inactive" during the year because they no longer met the definition of a public water supply are denoted in boldface print on the table.

Legend

Item	Description
PWS Name	Business name of the Public Water System
Minimum Population Served	Population that could use the water, as reported to IDNR by the PWS. For municipal systems, it is the most recent official census.
County	County location of PWS
PWSID Number	Public Water System Identification number, a unique and dedicated number permanently assigned to each PWS
PWS Type	Classification type of PWS: community public water system (CWS), non-transient non-community system (NTNC), or transient non-community system (TNC)
Violation Number	A unique, dedicated identification number assigned to each violation as it occurs.
Analyte	The analyte that triggered the violation.
Compliance Period End Date	Date at the end of the compliance period in which the violation occurred.
Violation	The EPA-assigned text description of the violation.
Violation Type	The alphabetic code description of the violation.
Enforcement Action Date	Most recent action taken by the PWS or the IDNR in response to the violation. The final action for any violation is "Compliance Achieved", meaning the system is now in compliance.
Enforcement Action	Date the follow-up action or enforcement action occurred

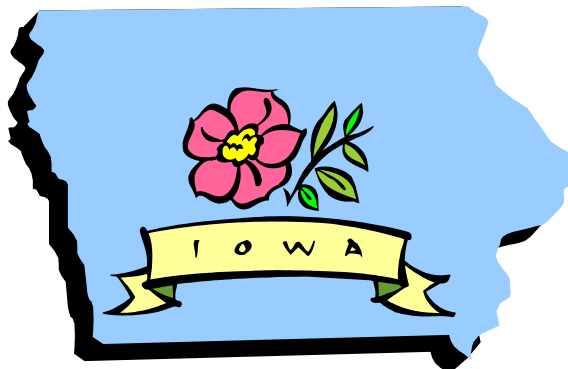

Iowa Public Water Supply System Violations in 2005

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ABBE CENTER FOR COMMUNITY CARE	160	LINN	IA5700900	CWS	2005-01555	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	10/21/2005	Compliance Achieved
ABBE CENTER FOR COMMUNITY CARE	160	LINN	IA5700900	CWS	2006-00817	Lead	30-Sep-05	AL, 90th Percentile	MCL	12/1/2005	NOV issued
ABBE CENTER FOR COMMUNITY CARE	160	LINN	IA5700900	CWS	2006-00857	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	12/13/2005	Compliance Achieved
AEROPLANE INN	25	POTTAWATTAMIE	IA7836201	TNC	2006-00263	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	10/19/2005	Compliance Achieved
AGAPE CHRISTIAN FAMILY CHURCH	208	CERRO GORDO	IA1716802	TNC	2005-03430	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	6/22/2005	Compliance Achieved
ALBION WATER DEPARTMENT	592	MARSHALL	IA6403011	CWS	2006-00454	Nitrate Nitrogen	30-Nov-05	MCL, Single	MCL	5/24/2006	Compliance Achieved
ALBRECT ACRES	27	DUBUQUE	IA3183401	TNC	2005-01937	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/18/2005	Compliance Achieved
ALDEN WATER SUPPLY	904	HARDIN	IA4213013	CWS	2006-01616	Copper	30-Sep-05	AL, 90th Percentile	MCL	4/12/2006	BCA issued
ALL GOLF CENTER	94	BLACK HAWK	IA0790201	TNC	2006-01244	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	1/24/2006	NOV issued
AMERICANA BOWL	110	LEE	IA5625217	TNC	2006-01231	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	3/29/2006	Compliance Achieved
AMES WATER TREATMENT PLANT	46503	STORY	IA8503039	CWS	2006-00312	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	10/5/2005	Compliance Achieved
AMY LOUS CAFE	34	CHICKASAW	IA1911204	TNC	2005-03748	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/20/2005	Compliance Achieved
ANCHOR INN (GARBER)	35	CLAYTON	IA2232776	TNC	2005-03071	Nitrate Nitrogen	31-May-05	Routine Major	MON	9/21/2005	Compliance Achieved
ANCHOR INN (GARBER)	35	CLAYTON	IA2232776	TNC	2005-03138	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	7/20/2005	NOV issued
ANCHOR INN (GARBER)	35	CLAYTON	IA2232776	TNC	2005-03609	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/9/2005	Compliance Achieved
ANCHOR INN (GARBER)	35	CLAYTON	IA2232776	TNC	2006-00579	Nitrate Nitrogen	31-Oct-05	Routine Major	MON	11/15/2005	Compliance Achieved
ANDREW JACKSON CARE	40	JACKSON	IA4900901	CWS	2006-00230	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	8/1/2005	Compliance Achieved
ANTHONY'S RESORT	50	DUBUQUE	IA3183877	TNC	2005-03615	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/18/2005	Compliance Achieved
APOSTOLIC CHURCH	200	JONES	IA5307801	TNC	2005-01980	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/29/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ARC - FIVE SEASONS	675	SCOTT	IA8222609	CWS	2005-01854	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/1/2005	Compliance Achieved
ARC - FIVE SEASONS	675	SCOTT	IA8222609	CWS	2005-03507	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/1/2005	Compliance Achieved
ARC - SILVER CREEK	700	SCOTT	IA8222610	CWS	2005-01855	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/1/2005	Compliance Achieved
ARC - SILVER CREEK	700	SCOTT	IA8222610	CWS	2005-03508	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/1/2005	Compliance Achieved
ARC - SILVER CREEK	700	SCOTT	IA8222610	CWS	2005-03554	Copper	30-Jun-05	Routine Tap	MON	9/1/2005	Compliance Achieved
ARC - SILVER CREEK	700	SCOTT	IA8222610	CWS	2005-03555	Lead	30-Jun-05	Routine Tap	MON	9/1/2005	Compliance Achieved
ARC CEDAR TERRACE	483	LINN	IA5700600	CWS	2005-03681	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/19/2005	Compliance Achieved
ARC MARION VILLAGE	1220	LINN	IA5751601	CWS	2005-01710	Chlorine	31-Jan-05	Monitoring (MOR)	MON	12/13/2005	Compliance Achieved
ARC MARION VILLAGE	1220	LINN	IA5751601	CWS	2006-00835	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	12/13/2005	Compliance Achieved
ARC MARION VILLAGE	1220	LINN	IA5751601	CWS	2006-00859	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	12/13/2005	Compliance Achieved
ARGO GENERAL STORE & DELI	27	SCOTT	IA8245201	TNC	2005-01974	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/5/2005	Compliance Achieved
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2005-03465	Sodium	30-Jun-05	Routine Major	MON	7/28/2005	Compliance Achieved
ARTHUR MUNICIPAL WATER SUPPLY	245	IDA	IA4703068	CWS	2006-01595	Failure to submit MRDL	30-Nov-05	Reporting	RPT	2/15/2006	NOV issued
ARTHUR MUNICIPAL WATER SUPPLY	245	IDA	IA4703068	CWS	2006-01596	Failure to submit MRDL	31-Dec-05	Reporting	RPT	2/15/2006	NOV issued
ARTS-WAY MANUFACTURING, CO., INC.	108	EMMET	IA3203101	NTNC	2005-01698	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	4/12/2005	Compliance Achieved
ATKINS MUNICIPAL WATER WORKS	1297	BENTON	IA0603072	CWS	2005-03163	Nitrite Nitrogen	31-Jul-05	MCL, Single	MCL	2/7/2006	Compliance Achieved
AVALON SUPPER CLUB INC.	77	DUBUQUE	IA3128314	TNC	2006-00310	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	3/27/2006	Compliance Achieved
AVALON SUPPER CLUB INC.	77	DUBUQUE	IA3128314	TNC	2006-01034	Nitrate Nitrogen	31-Dec-05	Confirmation/Check Major	MON	3/27/2006	Compliance Achieved
AVALON SUPPER CLUB INC.	77	DUBUQUE	IA3128314	TNC	2006-01107	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/1/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BACKBONE GOLF AND COUNTRY CLUB	64	DELAWARE	IA2279854	TNC	2005-02929	Coliform Bacteria, Total	31-May-05	MCL (TCR), Monthly	MCL	7/1/2005	NOV issued
BACKBONE GOLF AND COUNTRY CLUB	64	DELAWARE	IA2279854	TNC	2005-02974	Coliform Bacteria, Total	30-Jun-05	Repeat Major	MON	8/29/2005	Compliance Achieved
BACKBONE GOLF AND COUNTRY CLUB	64	DELAWARE	IA2279854	TNC	2005-03190	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	8/29/2005	Compliance Achieved
BACKBONE STATE PARK	25	DELAWARE	IA2821906	TNC	2005-02927	Failure to meet Compliance Schedule	31-May-05	Compliance Schedule	V/E	5/1/2006	Compliance Achieved
BANKSTON PUBLIC WATER SYSTEM	38	DUBUQUE	IA3109086	TNC	2006-01907	Failure to submit Monthly Operation Report	31-Jul-05	Monitoring (MOR)	MON	7/20/2005	Compliance Achieved
BAR-L-RANCH	56	GUTHRIE	IA3937444	TNC	2006-01115	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/6/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2005-01820	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	5/9/2005	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2005-01943	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/9/2005	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2005-02855	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	5/9/2005	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2005-03740	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	2/7/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-01221	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/7/2006	Compliance Achieved
BEACON WATER SUPPLY	518	MAHASKA	IA6203093	CWS	2005-02742	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	12/19/2005	Compliance Achieved
BEACON WATER SUPPLY	518	MAHASKA	IA6203093	CWS	2005-03055	Coliform Bacteria, Total	31-May-05	Routine Major	MON	12/19/2005	Compliance Achieved
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2006-01084	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	3/14/2006	Compliance Achieved
BEAVER MEADOWS COUNTRY CLUB	25	BUTLER	IA1281201	TNC	2006-00405	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	11/4/2005	NOV issued
BEEDES LAKE HOME OWNERS ASSOCIATION	75	FRANKLIN	IA3500933	CWS	2006-00760	Consumer Confidence Report	31-Jul-05	CCR	RPT	5/22/2006	NOV issued
BEN HAVEN MOBILE HOME PARK	100	BUCHANAN	IA1074601	CWS	2006-00488	Copper	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
BEN HAVEN MOBILE HOME PARK	100	BUCHANAN	IA1074601	CWS	2006-00489	Lead	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
BEN HAVEN MOBILE HOME PARK	100	BUCHANAN	IA1074601	CWS	2006-00727	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BIG O MART	384	BUCHANAN	IA1003201	TNC	2006-01086	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	3/14/2006	Compliance Achieved
BIG O MART	384	BUCHANAN	IA1003201	TNC	2006-01191	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	3/14/2006	Compliance Achieved
BLACK DIAMOND ROADHOUSE	52	JOHNSON	IA5260202	TNC	2006-01260	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	4/17/2006	Compliance Achieved
BODE MUNICIPAL WATER SUPPLY	327	HUMBOLDT	IA4609028	CWS	2006-00226	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/7/2005	NOV issued
BODE MUNICIPAL WATER SUPPLY	327	HUMBOLDT	IA4609028	CWS	2006-00227	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/7/2005	NOV issued
BONAPARTE WATER SUPPLY	458	VAN BUREN	IA8914031	CWS	2006-00545	Copper	30-Sep-05	Routine Tap	MON	11/22/2005	NOV issued
BONAPARTE WATER SUPPLY	458	VAN BUREN	IA8914031	CWS	2006-00546	Lead	30-Sep-05	Routine Tap	MON	11/22/2005	NOV issued
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-01950	Nitrite Nitrogen	31-Mar-05	Routine Major	MON	6/30/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02803	Dalapon	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02804	Di(2-Ethylhexyl) Adipate	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02805	Simazine	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02806	Di(2-Ethylhexyl) Phthalate	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02807	Picloram	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02808	Dinoseb	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02809	Atrazine	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02810	Alachlor (Lasso)	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02811	2,4-D	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02812	2,4,5-TP (Silvex)	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02813	Benzo (a) Pyrene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02814	Pentachlorophenol	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02815	Arsenic	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02816	Barium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02817	Cadmium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02818	Chromium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02819	Fluoride	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02820	Mercury	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02821	Sodium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02822	Antimony	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02823	Thallium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02824	Selenium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02825	Dichloromethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02826	o-Dichlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02827	p-Dichlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02828	Vinyl Chloride	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02829	1,1-Dichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02830	trans-1,2- Dichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02831	1,2-Dichloroethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02832	1,1,1-Trichloroethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02833	Carbon Tetrachloride	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02834	1,2-Dichloropropane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02835	Trichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02836	1,1,2-Trichloroethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02837	Tetrachloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02838	Monochlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02839	Benzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02840	Toluene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02841	Ethylbenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02842	Styrene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02843	1,2,4-Trichlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02844	cis-1,2-Dichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02845	Xylenes	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02860	Arsenic	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02861	Barium	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02862	Cadmium	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02863	Chromium	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02864	Fluoride	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02865	Mercury	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02866	Sodium	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02867	Antimony	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02868	Thallium	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-02869	Selenium	31-Mar-05	Routine Major	MON	11/4/2005	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03205	Arsenic	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03206	Barium	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03207	Cadmium	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03208	Chromium	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03209	Fluoride	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03210	Mercury	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03211	Sodium	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03212	Antimony	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03213	Thallium	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03214	Selenium	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03215	Dichloromethane	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03216	o-Dichlorobenzene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03217	p-Dichlorobenzene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03218	Vinyl Chloride	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03219	1,1-Dichloroethylene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03220	trans-1,2-Dichloroethylene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03221	1,2-Dichloroethane	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03222	1,1,1-Trichloroethane	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03223	Carbon Tetrachloride	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03224	1,2-Dichloropropane	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03225	Trichloroethylene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03226	1,1,2-Trichloroethane	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03227	Tetrachloroethylene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03228	Monochlorobenzene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03229	Benzene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03230	Toluene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03231	Ethylbenzene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03232	Styrene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03233	1,2,4-Trichlorobenzene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03234	cis-1,2-Dichloroethylene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03235	Xylenes	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03236	Dalapon	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03237	Di(2-Ethylhexyl) Adipate	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03238	Simazine	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03239	Di(2-Ethylhexyl) Phthalate	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03240	Picloram	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03241	Dinoseb	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03242	Atrazine	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03243	Alachlor (Lasso)	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03244	2,4-D	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03245	2,4,5-TP (Silvex)	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03246	Benzo (a) Pyrene	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03247	Pentachlorophenol	30-Jun-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03325	Arsenic	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03326	Barium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03327	Cadmium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03328	Chromium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03329	Fluoride	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03330	Mercury	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03331	Sodium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03332	Antimony	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03333	Thallium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03334	Selenium	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03335	Dichloromethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03336	o-Dichlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03337	p-Dichlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03338	Vinyl Chloride	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03339	1,1-Dichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03340	trans-1,2- Dichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03341	1,2-Dichloroethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03342	1,1,1-Trichloroethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03343	Carbon Tetrachloride	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03344	1,2-Dichloropropane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03345	Trichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03346	1,1,2-Trichloroethane	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03347	Tetrachloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03348	Monochlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03349	Benzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03350	Toluene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03351	Ethylbenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03352	Styrene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03353	1,2,4-Trichlorobenzene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03354	cis-1,2-Dichloroethylene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03355	Xylenes	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03356	Dalapon	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03357	Di(2-Ethylhexyl) Adipate	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03358	Simazine	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03359	Di(2-Ethylhexyl) Phthalate	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03360	Picloram	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03361	Dinoseb	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03362	Atrazine	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03363	Alachlor (Lasso)	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03364	2,4-D	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03365	2,4,5-TP (Silvex)	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03366	Benzo (a) Pyrene	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2005-03367	Pentachlorophenol	31-Mar-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00100	Arsenic	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00101	Barium	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00102	Cadmium	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00103	Chromium	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00104	Fluoride	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00105	Mercury	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00106	Sodium	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00107	Antimony	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00108	Thallium	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00109	Selenium	30-Sep-05	Confirmation/Check Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00223	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	1/27/2006	Compliance Achieved
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2006-00224	Total Trihalomethanes	31-Aug-05	Routine Major	MON	1/27/2006	Compliance Achieved
BOOS IMPLEMENT INC (NH)	57	CHICKASAW	IA1970206	TNC	2006-00359	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	3/14/2006	Compliance Achieved
BOWLAWAY LANES	30	CHICKASAW	IA1970204	TNC	2006-00320	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
BOYDEN MUNICIPAL WATER SUPPLY	687	SIOUX	IA8409037	CWS	2006-00010	Failure to meet Certified Operator Requirement	31-Aug-05	Operator Certification	STA	8/30/2005	NOV issued
BPB MANUFACTURING	115	WEBSTER	IA9433187	NTNC	2006-00274	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/17/2005	Compliance Achieved
BRADFORD HOUSE	50	CHICKASAW	IA1967222	TNC	2006-00208	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2005-01765	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	8/31/2005	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2005-03262	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	12/13/2005	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2005-03295	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	12/13/2005	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2006-00483	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	2/24/2006	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2006-00894	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	2/24/2006	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2006-01082	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
BRAYTON WATER SYSTEM	145	AUDUBON	IA0510040	CWS	2006-00187	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/7/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BRAYTON WATER SYSTEM	145	AUDUBON	IA0510040	CWS	2006-00188	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/7/2005	NOV issued
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2005-02653	Coliform Bacteria, Total	31-May-05	Repeat Major	MON	10/20/2005	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2005-02985	Coliform Bacteria, Total	31-May-05	Routine Major	MON	10/20/2005	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2006-00854	Failure to submit Operation Permit Application	31-Aug-05	Non-Reported Type	RPT	8/16/2005	NOV issued
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2006-01173	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
BRITTANY ESTATES HOMEOWNERS ASSOCIATION	105	LINN	IA5715301	CWS	2005-03815	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	3/16/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-00216	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/4/2005	NOV issued
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-00217	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/4/2005	NOV issued
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-00508	Copper	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-00509	Lead	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-01908	Failure to submit Monthly Operation Report	31-May-05	Monitoring (MOR)	MON	6/10/2005	Compliance Achieved
BROGANS PUB & GRUB	30	LINN	IA5765201	TNC	2005-03551	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	8/8/2005	NOV issued
BROGANS PUB & GRUB	30	LINN	IA5765201	TNC	2005-03576	Coliform Bacteria, Fecal	31-Jul-05	MCL (TCR), Acute	MCL	8/8/2005	NOV issued
BROGANS PUB & GRUB	30	LINN	IA5765201	TNC	2006-00910	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	1/30/2006	Compliance Achieved
BRONSON WATER SUPPLY	269	WOODBURY	IA9709046	CWS	2005-03990	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	9/2/2005	Compliance Achieved
BRONSON WATER SUPPLY	269	WOODBURY	IA9709046	CWS	2006-00800	Chlorine	31-Aug-05	Monitoring (DBP), Major	MON	9/2/2005	Compliance Achieved
BROOKHILL ESTATES	36	CLINTON	IA2330301	CWS	2005-02969	Failure to meet Certified Operator Requirement	31-Jul-05	Operator Certification	STA	8/16/2005	Compliance Achieved
BROWN BOTTLE RESTAURANT	225	BLACK HAWK	IA0709201	TNC	2005-03518	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	2/16/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BROWN BOTTLE RESTAURANT	225	BLACK HAWK	IA0709201	TNC	2006-00042	Coliform Bacteria, Total	31-Oct-05	MCL (TCR), Monthly	MCL	2/16/2006	Compliance Achieved
BROWN BOTTLE RESTAURANT	225	BLACK HAWK	IA0709201	TNC	2006-00448	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	2/16/2006	Compliance Achieved
BROWN BOTTLE RESTAURANT	225	BLACK HAWK	IA0709201	TNC	2006-00958	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	2/16/2006	Compliance Achieved
BROWN BOTTLE RESTAURANT	225	BLACK HAWK	IA0709201	TNC	2006-00962	Failure to meet Compliance Schedule	31-Oct-05	Compliance Schedule	V/E	2/16/2006	Compliance Achieved
BS GENERAL STORE	27	CLINTON	IA2322202	TNC	2005-01953	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/13/2005	Compliance Achieved
BUBBAS BAR & GRILL	25	HOWARD	IA4515782	TNC	2005-01938	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	10/18/2005	Compliance Achieved
BUFFALO CREEK - HICKORY HILL	25	LINN	IA5720975	TNC	2005-03536	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	4/10/2006	Compliance Achieved
BUFFALO CREEK - HICKORY HILL	25	LINN	IA5720975	TNC	2005-03813	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	4/10/2006	Compliance Achieved
BUFFALO CREEK - HICKORY HILL	25	LINN	IA5720975	TNC	2006-00087	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	3/14/2006	Compliance Achieved
BURDS GREEN ACRES SUBDIVISION	300	DUBUQUE	IA3170302	CWS	2005-01898	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	9/1/2005	Compliance Achieved
BURDS GREEN ACRES SUBDIVISION	300	DUBUQUE	IA3170302	CWS	2005-02962	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	12/13/2005	Compliance Achieved
BUZZYS	27	CLINTON	IA2391203	TNC	2005-01781	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	3/30/2005	Compliance Achieved
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2005-03151	Nitrate Nitrogen	30-Jun-05	MCL, Single	MCL	7/1/2005	NOV issued
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2005-04009	Nitrate Nitrogen	31-Aug-05	Routine Major	MON	10/6/2005	Compliance Achieved
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2006-00348	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	1/17/2006	Compliance Achieved
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2006-00349	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	1/17/2006	Compliance Achieved
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2006-00847	Nitrate Nitrogen	31-Dec-05	MCL, Single	MCL	12/9/2005	NOV issued
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2006-01239	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/17/2006	Compliance Achieved
CAMBRIDGE WATER SUPPLY	819	STORY	IA8509069	CWS	2006-01624	Copper	30-Sep-05	AL, 90th Percentile	MCL	3/15/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CAMP CONESTOGA	150	SCOTT	IA8264446	TNC	2006-01159	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/24/2006	Compliance Achieved
CAMP CONESTOGA	150	SCOTT	IA8264446	TNC	2006-01240	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/24/2006	Compliance Achieved
CAMP CONESTOGA	150	SCOTT	IA8264446	TNC	2006-01241	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/24/2006	Compliance Achieved
CAMP CONESTOGA	150	SCOTT	IA8264446	TNC	2006-01242	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/24/2006	Compliance Achieved
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2005-03528	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	11/3/2005	BCA issued
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2005-03846	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	11/3/2005	BCA issued
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2005-03885	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	11/8/2005	Compliance Achieved
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-00077	Coliform Bacteria, Total	30-Sep-05	Repeat Major	MON	11/8/2005	Compliance Achieved
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-00078	Coliform Bacteria, Total	30-Sep-05	Repeat Major	MON	11/8/2005	Compliance Achieved
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-00079	Coliform Bacteria, Total	30-Sep-05	Repeat Major	MON	11/8/2005	Compliance Achieved
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-00153	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	11/3/2005	BCA issued
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-00806	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	11/28/2005	NOV issued
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-00952	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	11/3/2005	BCA issued
CAMP DODGE WATER SUPPLY	630	POLK	IA7700901	CWS	2005-02031	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	1/11/2006	BCA issued
CAMP DODGE WATER SUPPLY	630	POLK	IA7700901	CWS	2005-03798	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	1/11/2006	BCA issued
CAMP DODGE WATER SUPPLY	630	POLK	IA7700901	CWS	2006-00410	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	1/11/2006	BCA issued
CAMP EWALU - OUTPOST	27	CLAYTON	IA2279401	TNC	2005-03630	Coliform Bacteria, Total	31-Aug-05	Repeat Major	MON	8/29/2005	Compliance Achieved
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2005-03149	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	7/11/2005	NOV issued
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2005-03176	Coliform Bacteria, Fecal	30-Jun-05	MCL (TCR), Acute	MCL	7/11/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2005-03522	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	7/25/2005	NOV issued
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2005-03806	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	8/29/2005	NOV issued
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2006-00335	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/4/2005	NOV issued
CAMP EWALU - POOL	27	CLAYTON	IA2279403	TNC	2005-03388	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/29/2005	Compliance Achieved
CAMP EWALU - POOL	27	CLAYTON	IA2279403	TNC	2005-03745	Nitrate Nitrogen	31-Jul-05	Routine Major	MON	8/29/2005	Compliance Achieved
CAMP IODISECA	25	JOHNSON	IA5282802	TNC	2005-01911	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/3/2005	Compliance Achieved
CAMP IODISECA	25	JOHNSON	IA5282802	TNC	2005-01973	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/3/2005	Compliance Achieved
CAMP MITIGWA	250	BOONE	IA0890490	TNC	2005-03572	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/15/2005	NOV issued
CAMP MITIGWA	250	BOONE	IA0890490	TNC	2005-03573	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	8/15/2005	NOV issued
CAMP MITIGWA	250	BOONE	IA0890490	TNC	2005-03594	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/16/2005	NOV issued
CAMP MITIGWA	250	BOONE	IA0890490	TNC	2006-00147	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	2/27/2006	Compliance Achieved
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2005-03117	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	6/22/2005	NOV issued
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2005-03166	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	7/14/2005	NOV issued
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2005-03927	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	1/3/2006	Compliance Achieved
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2006-01253	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/3/2006	Compliance Achieved
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2006-01257	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/3/2006	Compliance Achieved
CASEYS STORE (NICHOLS)	32	MUSCATINE	IA7052205	TNC	2005-01965	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/7/2005	Compliance Achieved
CASEYS STORE 2512	30	JOHNSON	IA5221210	TNC	2006-01245	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	3/13/2006	Compliance Achieved
CEDAR BEND PARK	26	BREMER	IA0975913	TNC	2005-02965	Nitrate Nitrogen	30-Jun-05	MCL, Single	MCL	6/28/2004	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CEDAR BEND PARK	26	BREMER	IA0975913	TNC	2005-03531	Nitrate Nitrogen	31-Jul-05	MCL, Single	MCL	7/27/2005	NOV issued
CEDAR BEND PARK	26	BREMER	IA0975913	TNC	2005-03801	Nitrate Nitrogen	31-Aug-05	MCL, Single	MCL	8/25/2005	NOV issued
CEDAR BEND PARK	26	BREMER	IA0975913	TNC	2005-04036	Nitrate Nitrogen	30-Sep-05	MCL, Single	MCL	9/23/2005	NOV issued
CEDAR BEND PARK	26	BREMER	IA0975913	TNC	2006-00034	Nitrate Nitrogen	31-Oct-05	MCL, Single	MCL	10/14/2005	NOV issued
CEDAR FALLS MUNICIPAL WATER UTILITIES	36145	BLACK HAWK	IA0709084	CWS	2006-00025	Coliform Bacteria, Total	31-Oct-05	MCL (TCR), Monthly	MCL	11/28/2005	NOV issued
CEDAR FALLS MUNICIPAL WATER UTILITIES	36145	BLACK HAWK	IA0709084	CWS	2006-00421	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	11/28/2005	NOV issued
CEDAR LAKES INC	41	CEDAR	IA1689403	TNC	2005-03099	Coliform Bacteria, Total	31-May-05	Routine Major	MON	6/27/2005	Compliance Achieved
CEDAR LAKES INC	41	CEDAR	IA1689403	TNC	2005-03752	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	9/6/2005	Compliance Achieved
CEDAR LAKES INC	41	CEDAR	IA1689403	TNC	2005-04010	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	9/6/2005	Compliance Achieved
CEDAR SPRINGS WESLEYAN CAMP	25	FLOYD	IA3414494	TNC	2006-00221	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	10/20/2005	Compliance Achieved
CEDAR VALLEY GOLF	27	CEDAR	IA1689202	TNC	2005-03412	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/29/2005	Compliance Achieved
CEDAR VALLEY PRODUCE AUCTION	42	HOWARD	IA4525202	TNC	2005-01476	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	12/14/2005	Compliance Achieved
CEDAR VALLEY PRODUCE AUCTION	42	HOWARD	IA4525202	TNC	2005-01968	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	10/18/2005	Compliance Achieved
CEDAR VALLEY PRODUCE AUCTION	42	HOWARD	IA4525202	TNC	2005-03256	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	10/18/2005	Compliance Achieved
CEDAR VALLEY PRODUCE AUCTION	42	HOWARD	IA4525202	TNC	2005-03643	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/18/2005	Compliance Achieved
CENTRAL BAPTIST CHURCH	101	POTTAWATTAMIE	IA7820851	TNC	2006-00301	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	10/3/2005	Compliance Achieved
CENTRAL CITY WATER SUPPLY	1157	LINN	IA5720010	CWS	2006-00248	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/7/2005	NOV issued
CENTRAL CITY WATER SUPPLY	1157	LINN	IA5720010	CWS	2006-00249	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/7/2005	NOV issued
CENTRAL IA WATER ASSN (NEWTON)	24250	JASPER	IA5059704	CWS	2005-03838	Failure to obtain Construction Permit	31-Jul-05	Non-Reported Type	STA	7/18/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CENTRAL IOWA WATER ASSN (WAVERLY)	25	BREMER	IA0990701	CWS	2006-00851	Failure to maintain Separation Distances	31-Aug-05	Compliance Schedule	V/E	1/1/2006	Compliance Achieved
CENTRAL PARK - JONES CONSERVATION	103	JONES	IA5315967	TNC	2005-03413	Nitrite Nitrogen	30-Jun-05	Routine Major	MON	12/14/2005	Compliance Achieved
CENTRAL PARK - JONES CONSERVATION	103	JONES	IA5315967	TNC	2005-03414	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	12/14/2005	Compliance Achieved
CENTRAL PARK - JONES CONSERVATION	103	JONES	IA5315967	TNC	2006-00240	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/9/2005	Compliance Achieved
CENTRAL WATER SYSTEM	25	DICKINSON	IA3000099	CWS	2006-01603	Failure to report CT Ratio	31-Aug-05	SWTR Monitoring (MOR)	MON	2/28/2006	Compliance Achieved
CENTRAL WATER WORKS	27	WEBSTER	IA9400801	CWS	2005-02769	Radium 226 & Radium 228	31-Mar-05	Routine Major	MON	8/4/2005	Compliance Achieved
CENTRAL WATER WORKS	27	WEBSTER	IA9400801	CWS	2005-03194	Radium 226 & Radium 228	30-Jun-05	Confirmation/Check Major	MON	8/4/2005	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2005-03122	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	3/13/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2005-04042	Total Haloacetic Acids	30-Sep-05	MCL, Average	MCL	8/25/2005	BCA issued
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2005-04061	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	3/13/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-00396	Sodium	30-Sep-05	Routine Major	MON	12/14/2005	Compliance Achieved
CHATEAU AT WOLF CREEK	35	POLK	IA7717302	CWS	2005-04011	Total Trihalomethanes	31-Jul-05	Routine Major	MON	10/5/2005	Compliance Achieved
CHATEAU AT WOLF CREEK	35	POLK	IA7717302	CWS	2005-04012	Total Haloacetic Acids	31-Jul-05	Monitoring (DBP), Major	MON	10/5/2005	Compliance Achieved
CHESTER WATER SUPPLY	151	HOWARD	IA4509024	CWS	2006-00453	Failure to meet Certified Operator Requirement	31-Oct-05	Operator Certification	STA	1/1/2006	Compliance Achieved
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2005-03133	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	9/2/2005	AO w/o Penalty
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2005-03144	Coliform Bacteria, Fecal	30-Jun-05	MCL (TCR), Acute	MCL	9/2/2005	AO w/o Penalty
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2005-03549	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/2/2005	AO w/o Penalty
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2005-03817	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	9/2/2005	AO w/o Penalty
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2005-03818	Coliform Bacteria, Fecal	31-Jul-05	MCL (TCR), Acute	MCL	9/2/2005	AO w/o Penalty

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2005-03859	Coliform Bacteria, Fecal	31-Aug-05	MCL (TCR), Acute	MCL	9/2/2005	AO w/o Penalty
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2006-00177	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	9/2/2005	AO w/o Penalty
CHIMNEY ROCK CANOE RENTAL & CAMPGROUND	122	WINNESHIEK	IA9606201	TNC	2006-00709	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	5/23/2006	Compliance Achieved
CLARINDA WATER PLANT	5690	PAGE	IA7329029	CWS	2006-00415	Turbidity	31-Jul-05	Monthly CFE Turbidity (IESWTR)	TT	1/31/2006	Compliance Achieved
CLEARVIEW MHP - RIPLEY INC.	880	MUSCATINE	IA7000600	CWS	2005-02958	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	1/18/2006	Compliance Achieved
CLEARVIEW MHP - RIPLEY INC.	880	MUSCATINE	IA7000600	CWS	2005-03497	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	1/18/2006	Compliance Achieved
CLERMONT WATER SUPPLY	716	FAYETTE	IA3317047	CWS	2005-03041	Coliform Bacteria, Total	31-May-05	Routine Major	MON	10/18/2005	Compliance Achieved
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2005-01570	Nitrate Nitrogen	31-Jan-05	Routine Major	MON	9/29/2005	Compliance Achieved
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2005-03700	Nitrate Nitrogen	31-Jul-05	Routine Major	MON	9/29/2005	Compliance Achieved
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2006-00192	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2006-01192	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
CLIMAX MOLYBDENUM COMPANY	150	LEE	IA5625140	NTNC	2005-01857	Nitrate Nitrogen	30-Apr-05	MCL, Single	MCL	5/2/2005	Compliance Achieved
CLIVE WATER DEPARTMENT	14125	POLK	IA7720051	CWS	2006-00540	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	12/19/2005	Compliance Achieved
CLOVERLEAF COLD STORAGE	400	WOODBURY	IA9778101	NTNC	2005-01694	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	6/20/2005	Compliance Achieved
CLOVERLEAF COLD STORAGE	400	WOODBURY	IA9778101	NTNC	2006-00843	Lead	31-Dec-05	AL, 90th Percentile	MCL	12/8/2005	BCA issued
CLUTIER WATER SUPPLY	229	TAMA	IA8616052	CWS	2006-00341	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	12/2/2005	NOV issued
CLUTIER WATER SUPPLY	229	TAMA	IA8616052	CWS	2006-00342	Total Trihalomethanes	31-Aug-05	Routine Major	MON	12/2/2005	NOV issued
COAL CAMP CORPORATION	35	DALLAS	IA2573302	CWS	2005-01187	Coliform Bacteria, Total	31-Jan-05	MCL (TCR), Monthly	MCL	7/7/2005	Compliance Achieved
COIN WATER SUPPLY	252	PAGE	IA7335054	CWS	2006-01618	Copper	30-Sep-05	AL, 90th Percentile	MCL	10/28/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-01540	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	3/16/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-01770	Nitrite Nitrogen	28-Feb-05	Confirmation/Check Major	MON	3/16/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-01771	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	3/16/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-01792	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/16/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-02094	Coliform Bacteria, Total	31-May-05	Repeat Major	MON	5/5/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-02848	Nitrate Nitrogen	30-Apr-05	Routine Major	MON	5/5/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-03265	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/6/2005	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2005-03932	Coliform Bacteria, Total	31-Aug-05	Repeat Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00061	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00062	Coliform Bacteria, Total	30-Sep-05	Repeat Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00180	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00490	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00623	Nitrate Nitrogen	31-Oct-05	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00710	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00898	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-00920	Nitrate Nitrogen	30-Nov-05	Routine Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-01093	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-01215	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/9/2006	Compliance Achieved
COLFAX WATER SUPPLY	2223	JASPER	IA5009056	CWS	2006-00820	Copper	30-Sep-05	AL, 90th Percentile	MCL	12/1/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
COLFAX WATER SUPPLY	2223	JASPER	IA5009056	CWS	2006-01580	Failure to meet Certified Operator Requirement	31-Mar-05	Operator Certification	STA	3/24/2005	NOV issued
COLLEGE SPRINGS WATER SUPPLY	246	PAGE	IA7341059	CWS	2005-01810	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/16/2005	Compliance Achieved
COLLEGE SPRINGS WATER SUPPLY	246	PAGE	IA7341059	CWS	2006-00725	Consumer Confidence Report	31-Jul-05	CCR	RPT	3/15/2006	Compliance Achieved
COLLEGE SPRINGS WATER SUPPLY	246	PAGE	IA7341059	CWS	2006-00809	Chlorine	28-Feb-05	Monitoring (DBP), Major	MON	2/28/2006	Compliance Achieved
COLLEGE SPRINGS WATER SUPPLY	246	PAGE	IA7341059	CWS	2006-00837	Failure to meet Certified Operator Requirement	30-Nov-05	Operator Certification	STA	11/16/2005	NOV issued
COLONY COUNTRY CAMPGROUND	25	JOHNSON	IA5225804	TNC	2006-01141	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	4/4/2006	Compliance Achieved
COLWELL PARK	30	FLOYD	IA3409401	TNC	2005-03141	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	6/30/2005	NOV issued
COLWELL PARK	30	FLOYD	IA3409401	TNC	2005-03517	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	7/28/2005	NOV issued
COLWELL PARK	30	FLOYD	IA3409401	TNC	2005-03534	Coliform Bacteria, Fecal	30-Sep-05	MCL (TCR), Acute	MCL	7/28/2005	NOV issued
CONESTOGA CNCL/TOPAWINGO WELL	34	ALLAMAKEE	IA0315444	TNC	2005-03308	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/4/2005	Compliance Achieved
CORALVILLE LAKE TERRACE	340	JOHNSON	IA5200817	CWS	2006-00746	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/2/2006	Compliance Achieved
CORALVILLE LAKE-WEST OVERLOOK	1263	JOHNSON	IA5225411	TNC	2005-03967	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	9/1/2005	Compliance Achieved
CORRECTIONVILLE WATER SUPPLY	851	WOODBURY	IA9721076	CWS	2005-01709	Nitrate Nitrogen	31-Mar-05	MCL, Single	MCL	9/13/2005	Compliance Achieved
COTTAGE RESERVE CORPORATION	175	JOHNSON	IA5200801	CWS	2006-00839	Copper	30-Sep-05	Routine Tap	MON	12/7/2005	BCA issued
COTTAGE RESERVE CORPORATION	175	JOHNSON	IA5200801	CWS	2006-00840	Lead	30-Sep-05	Routine Tap	MON	12/7/2005	BCA issued
COUNTRY ESTATES	126	LINN	IA5784301	CWS	2005-02926	Failure to meet Compliance Schedule	31-May-05	Compliance Schedule	V/E	12/12/2005	BCA issued
COUNTRY HEIGHTS	91	MUSCATINE	IA7073301	CWS	2005-04028	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	3/8/2006	Compliance Achieved
COUNTRY HILLS COMMUNITY GOLF	43	FAYETTE	IA3383841	TNC	2005-01841	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	11/2/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
COUNTRY HILLS COMMUNITY GOLF	43	FAYETTE	IA3383841	TNC	2005-02979	Coliform Bacteria, Total	31-May-05	Routine Major	MON	10/18/2005	Compliance Achieved
COUNTRY HILLS WATER CORP	41	DUBUQUE	IA3122301	CWS	2005-03575	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	4/18/2006	Compliance Achieved
COUNTRY HILLS WATER CORP	41	DUBUQUE	IA3122301	CWS	2005-04033	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	4/18/2006	Compliance Achieved
COUNTRY VIEW PUBLIC GOLF COURSE	26	WINNESHIEK	IA9630203	TNC	2005-03288	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
COUNTRY VIEW PUBLIC GOLF COURSE	26	WINNESHIEK	IA9630203	TNC	2005-03306	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
COUNTRY VIEW PUBLIC GOLF COURSE	26	WINNESHIEK	IA9630203	TNC	2005-03897	Coliform Bacteria, Total	30-Sep-05	Repeat Major	MON	10/20/2005	Compliance Achieved
COUNTRY VIEW PUBLIC GOLF COURSE	26	WINNESHIEK	IA9630203	TNC	2006-00093	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	4/17/2006	Compliance Achieved
CRESCENT SKI HILLS	119	POTTAWATTAMIE	IA7822842	TNC	2005-01526	Nitrate Nitrogen	31-Jan-05	Confirmation/Check Major	MON	8/23/2005	Compliance Achieved
CRESCENT SKI HILLS	119	POTTAWATTAMIE	IA7822842	TNC	2005-01907	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	8/23/2005	Compliance Achieved
CRESCENT SKI HILLS	119	POTTAWATTAMIE	IA7822842	TNC	2005-01912	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	8/23/2005	Compliance Achieved
CRESCO GOLF AND COUNTRY CLUB	36	HOWARD	IA4515778	TNC	2005-03076	Nitrate Nitrogen	31-May-05	Routine Major	MON	10/18/2005	Compliance Achieved
CRESCO WATERWORKS	3905	HOWARD	IA4515087	CWS	2006-01909	Failure to submit MRDL	31-May-05	Reporting	RPT	7/8/2005	Compliance Achieved
CROOKED CREEK CHRISTIAN CAMP	77	WASHINGTON	IA9271801	TNC	2005-02085	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	3/14/2006	Compliance Achieved
CROOKED CREEK CHRISTIAN CAMP	77	WASHINGTON	IA9271801	TNC	2005-03129	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	3/14/2006	Compliance Achieved
CULVERS LAWN AND GARDEN	120	LINN	IA5751202	TNC	2005-03644	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/20/2005	Compliance Achieved
CULVERS LAWN AND GARDEN	120	LINN	IA5751202	TNC	2005-03645	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	10/20/2005	Compliance Achieved
CULVERS LAWN AND GARDEN	120	LINN	IA5751202	TNC	2006-01255	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/14/2006	Compliance Achieved
CUTTYS OKOBOJI RESORT CLUB	285	DICKINSON	IA3070434	TNC	2006-00317	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	12/5/2005	Compliance Achieved
CUTTYS OKOBOJI RESORT CLUB	285	DICKINSON	IA3070434	TNC	2006-00318	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	12/5/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CUTTYS OKOBOJI RESORT CLUB	285	DICKINSON	IA3070434	TNC	2006-00319	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	12/5/2005	Compliance Achieved
DAKOTA MHP	32	JOHNSON	IA5200618	CWS	2006-00234	Total Trihalomethanes	31-Aug-05	Routine Major	MON	12/28/2005	Compliance Achieved
DAKOTA MHP	32	JOHNSON	IA5200618	CWS	2006-00235	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	12/28/2005	Compliance Achieved
DANS OVERHEAD DOORS	110	JOHNSON	IA5252203	NTNC	2006-00046	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	4/4/2006	Compliance Achieved
DANS OVERHEAD DOORS	110	JOHNSON	IA5252203	NTNC	2006-00955	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	4/4/2006	Compliance Achieved
DANVILLE WATER SUPPLY	914	DES MOINES	IA2915000	CWS	2005-01852	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/23/2005	BCA issued
DANVILLE WATER SUPPLY	914	DES MOINES	IA2915000	CWS	2005-02954	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/23/2005	BCA issued
DANVILLE WATER SUPPLY	914	DES MOINES	IA2915000	CWS	2005-03811	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	8/23/2005	BCA issued
DANVILLE WATER SUPPLY	914	DES MOINES	IA2915000	CWS	2006-01294	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	8/23/2005	BCA issued
DAWSON WATER WORKS	155	DALLAS	IA2525010	CWS	2006-00748	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued
DAYTON MUNICIPAL WATER SUPPLY	884	WEBSTER	IA9425011	CWS	2005-03839	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	4/5/2006	Compliance Achieved
DECORAH IMPLEMENT COMPANY	50	WINNESHIEK	IA9630768	TNC	2005-03289	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2005-01951	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/26/2005	Compliance Achieved
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2006-00924	Nitrate Nitrogen	30-Nov-05	Routine Major	MON	12/15/2005	Compliance Achieved
DEEP RIVER WATER SUPPLY	288	POWESHIEK	IA7915017	CWS	2005-03855	Copper	30-Jun-05	AL, 90th Percentile	MCL	12/30/2005	BCA issued
DEERFIELD HEIGHTS ASSOCIATION	25	WINNESHIEK	IA9630316	CWS	2006-00337	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
DELHI LAKEVIEW ESTATES,INC #1	30	DELAWARE	IA2817456	TNC	2005-02976	Coliform Bacteria, Total	30-Jun-05	Repeat Major	MON	9/26/2005	Compliance Achieved
DELHI LAKEVIEW ESTATES,INC #1	30	DELAWARE	IA2817456	TNC	2005-03659	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	9/28/2005	Compliance Achieved
DELHI LAKEVIEW ESTATES,INC #1	30	DELAWARE	IA2817456	TNC	2006-00505	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	4/26/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DELHI LAKEVIEW ESTATES,INC #1	30	DELAWARE	IA2817456	TNC	2006-00852	Failure to submit Operation Permit Application	31-Aug-05	Non-Reported Type	RPT	9/12/2005	Compliance Achieved
DELHI LAKEVIEW ESTATES,INC #1	30	DELAWARE	IA2817456	TNC	2006-01238	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2006-00726	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/27/2006	NOV issued
DELTA WATER SUPPLY	410	KEOKUK	IA5417026	CWS	2006-00747	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/15/2006	Compliance Achieved
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2005-03547	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	2/20/2006	Compliance Achieved
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2005-03559	Coliform Bacteria, Fecal	31-Jul-05	MCL (TCR), Acute	MCL	2/20/2006	Compliance Achieved
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2006-00985	Copper	31-Dec-05	AL, 90th Percentile	MCL	1/13/2006	NOV issued
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2006-00986	Lead	31-Dec-05	AL, 90th Percentile	MCL	1/13/2006	NOV issued
DEUCES	43	POTTAWATTAMIE	IA7820203	TNC	2005-01914	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/28/2005	Compliance Achieved
DEVIL DOGS DOGHOUSE	49	KEOKUK	IA5440201	TNC	2006-00424	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	4/4/2006	Compliance Achieved
DIAMOND JO WORTH	7300	WORTH	IA9855202	NTNC	2006-00022	Coliform Bacteria, Total	31-Oct-05	MCL (TCR), Monthly	MCL	10/17/2005	NOV issued
DIKE WATER SUPPLY	944	GRUNDY	IA3815042	CWS	2006-00763	Consumer Confidence Report	31-Jul-05	CCR	RPT	3/9/2006	Compliance Achieved
DIXON MEMORIAL PARK	30	SCOTT	IA8225495	TNC	2005-03286	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	4/26/2006	Compliance Achieved
DIXON MEMORIAL PARK	30	SCOTT	IA8225495	TNC	2005-03299	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	11/8/2005	Compliance Achieved
DIXON MEMORIAL PARK	30	SCOTT	IA8225495	TNC	2006-00268	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	4/26/2006	Compliance Achieved
DIXON WATER WORKS	276	SCOTT	IA8225043	CWS	2006-00267	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	10/3/2005	Compliance Achieved
DIXON WATER WORKS	276	SCOTT	IA8225043	CWS	2006-00750	Consumer Confidence Report	31-Jul-05	CCR	RPT	12/22/2005	Compliance Achieved
DONNELLSON MUNI WATER WORKS	963	LEE	IA5620046	CWS	2006-00752	Consumer Confidence Report	31-Jul-05	CCR	RPT	1/31/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-01680	Nitrate Nitrogen	28-Feb-05	MCL, Single	MCL	5/3/2005	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-01860	Nitrate Nitrogen	30-Apr-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-02922	Nitrate Nitrogen	31-May-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-03120	Nitrate Nitrogen	30-Jun-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-03186	Nitrate Nitrogen	31-Jul-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-03598	Nitrate Nitrogen	31-Aug-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2005-03860	Nitrate Nitrogen	30-Sep-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-00027	Nitrate Nitrogen	31-Oct-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-00449	Nitrate Nitrogen	30-Nov-05	MCL, Single	MCL	5/3/2005	BCA issued
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-00871	Nitrate Nitrogen	31-Dec-05	MCL, Single	MCL	5/3/2005	BCA issued
DUBUQUE REGIONAL AIRPORT	420	DUBUQUE	IA3126013	NTNC	2006-00836	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	12/14/2005	Compliance Achieved
DUBUQUE REGIONAL AIRPORT	420	DUBUQUE	IA3126013	NTNC	2006-00867	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	12/14/2005	Compliance Achieved
DUBUQUE SHOOTING SOCIETY	85	DUBUQUE	IA3126882	TNC	2005-03271	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	8/25/2005	Compliance Achieved
DUBUQUE WATER WORKS	57686	DUBUQUE	IA3126052	CWS	2006-00850	Chlorine	31-Jul-05	Monitoring (DBP), Major	MON	8/2/2005	Compliance Achieved
DUBUQUE YMCA CAMP	60	DUBUQUE	IA3126489	TNC	2005-03270	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/1/2005	Compliance Achieved
DUBUQUE YMCA CAMP	60	DUBUQUE	IA3126489	TNC	2005-03368	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	7/1/2005	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2005-03994	Nitrate Nitrogen	31-Aug-05	Routine Major	MON	9/30/2005	Compliance Achieved
EAGLE GROVE COUNTRY CLUB	51	WRIGHT	IA9926809	TNC	2005-03319	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	4/19/2006	Compliance Achieved
EAST SIDE ACRES	57	WOODBURY	IA9700630	CWS	2005-01696	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	8/19/2005	Compliance Achieved
ECONO LODGE	37	CASS	IA1509706	TNC	2005-01891	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/20/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2005-01830	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	5/24/2005	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2005-03100	Coliform Bacteria, Total	31-May-05	Routine Major	MON	8/4/2005	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2005-03411	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	7/19/2005	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2005-04060	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/30/2005	NOV issued
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2006-00808	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	12/5/2005	NOV issued
EDGETOWN MOBILE HOME COURT	25	MARSHALL	IA6403301	CWS	2005-01941	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	7/7/2005	Compliance Achieved
EDGETOWN MOBILE HOME COURT	25	MARSHALL	IA6403301	CWS	2005-02851	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	7/7/2005	Compliance Achieved
EDGETOWN MOBILE HOME COURT	25	MARSHALL	IA6403301	CWS	2005-03091	Coliform Bacteria, Total	31-May-05	Routine Major	MON	7/7/2005	Compliance Achieved
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2005-03546	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/15/2005	NOV issued
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2005-03587	Coliform Bacteria, Fecal	30-Sep-05	MCL (TCR), Acute	MCL	8/15/2005	NOV issued
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2005-03819	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	9/1/2005	NOV issued
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2006-00067	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
EFFIGY MOUNDS NATIONAL MONUMENT	328	CLAYTON	IA2258494	TNC	2006-00429	Failure to meet Certified Operator Requirement	31-Oct-05	Operator Certification	STA	1/10/2006	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2005-03079	Nitrate Nitrogen	31-May-05	Routine Major	MON	9/27/2005	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2006-00446	Copper	30-Jun-05	Routine Tap	MON	12/21/2005	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2006-00447	Lead	30-Jun-05	Routine Tap	MON	12/21/2005	Compliance Achieved
ELDON C STUTSMAN INC	165	JOHNSON	IA5221101	NTNC	2006-01247	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/28/2006	Compliance Achieved
ELDON C STUTSMAN INC	165	JOHNSON	IA5221101	NTNC	2006-01248	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/28/2006	Compliance Achieved
ELDON WATER SUPPLY	998	WAPELLO	IA9053004	CWS	2005-03689	Total Haloacetic Acids	30-Jun-05	Monitoring (DBP), Major	MON	8/29/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ELDON WATER SUPPLY	998	WAPELLO	IA9053004	CWS	2005-03690	Total Trihalomethanes	30-Jun-05	Routine Major	MON	8/29/2005	Compliance Achieved
ELDRIDGE WATER SUPPLY	4836	SCOTT	IA8230008	CWS	2005-01488	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	11/7/2005	Compliance Achieved
ELDRIDGE WATER SUPPLY	4836	SCOTT	IA8230008	CWS	2005-02067	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	11/7/2005	Compliance Achieved
ELDRIDGE WATER SUPPLY	4836	SCOTT	IA8230008	CWS	2005-04025	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	11/7/2005	Compliance Achieved
ELDRIDGE WATER SUPPLY	4836	SCOTT	IA8230008	CWS	2006-00433	Total Haloacetic Acids	30-Jun-05	MCL, Average	MCL	8/24/2005	Compliance Achieved
ELKADER GOLF & COUNTRY CLUB	45	CLAYTON	IA2223438	TNC	2005-02710	Nitrate Nitrogen	30-Apr-05	Confirmation/Check Major	MON	5/31/2005	Compliance Achieved
ELKADER GOLF & COUNTRY CLUB	45	CLAYTON	IA2223438	TNC	2005-03653	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	9/29/2005	Compliance Achieved
ELKHART WATER SUPPLY	362	POLK	IA7730012	CWS	2005-03978	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	11/8/2005	Compliance Achieved
ELKHART WATER SUPPLY	362	POLK	IA7730012	CWS	2006-00012	Chlorine	31-Aug-05	Monitoring (DBP), Major	MON	11/8/2005	Compliance Achieved
ELLIOTT WATER SUPPLY	402	MONTGOMERY	IA6915015	CWS	2005-03582	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	2/28/2006	Compliance Achieved
ELLIOTT WATER SUPPLY	402	MONTGOMERY	IA6915015	CWS	2006-00435	Failure to meet Certified Operator Requirement	30-Nov-05	Operator Certification	STA	11/8/2005	NOV issued
ELLIOTT WATER SUPPLY	402	MONTGOMERY	IA6915015	CWS	2006-00555	Nitrate Nitrogen	31-Oct-05	Routine Major	MON	11/7/2005	Compliance Achieved
ELLSWORTH PUBLIC WATER SUPPLY	531	HAMILTON	IA4009016	CWS	2006-01280	Arsenic	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
ELY WATER SUPPLY	1149	LINN	IA5728018	CWS	2006-00818	Lead	30-Sep-05	AL, 90th Percentile	MCL	9/16/2005	NOV issued
F B & COMPANY	42	LINN	IA5720201	TNC	2006-01145	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	3/30/2006	Compliance Achieved
F B & COMPANY	42	LINN	IA5720201	TNC	2006-01182	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	3/30/2006	Compliance Achieved
FAIRFAX WATER SUPPLY	1662	LINN	IA5731032	CWS	2005-02870	Gross Alpha, excluding Rn & U	31-Mar-05	Routine Major	MON	10/21/2005	Compliance Achieved
FAIRFAX WATER SUPPLY	1662	LINN	IA5731032	CWS	2005-02871	Radium 226 & Radium 228	31-Mar-05	Routine Major	MON	10/21/2005	Compliance Achieved
FAIRWAY OAKS	92	MUSCATINE	IA7048306	CWS	2005-02959	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	12/5/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
FEATHERLITE MANUFACTURING, INC.	125	HOWARD	IA4535101	NTNC	2006-00849	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	12/15/2005	NOV issued
FELLOWSHIP OF FAITH CHRISTIAN CENTER	303	POTTAWATTAMIE	IA7856801	TNC	2005-02858	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	5/3/2005	Compliance Achieved
FINLEYS LANDING	43	DUBUQUE	IA3126437	TNC	2006-00445	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/28/2005	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00373	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	2/24/2006	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00428	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	2/24/2006	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00712	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	2/24/2006	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00802	Chlorine	31-Oct-05	Monitoring (DBP), Major	MON	2/24/2006	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00819	Lead	30-Jun-05	AL, 90th Percentile	MCL	3/14/2006	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00932	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	2/24/2006	Compliance Achieved
FIVE SEASONS CEDAR FALLS	298	BLACK HAWK	IA0709601	CWS	2006-00943	Chlorine	30-Nov-05	Monitoring (DBP), Major	MON	2/24/2006	Compliance Achieved
FIVE STAR COOPERATIVE	66	CHICKASAW	IA1970208	TNC	2005-04032	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	10/6/2005	NOV issued
FLOYD MUNI WATER SUPPLY	361	FLOYD	IA3414044	CWS	2006-00444	Lead	30-Sep-05	AL, 90th Percentile	MCL	12/1/2005	BCA issued
FOBIANS M & J	32	BLACK HAWK	IA0709208	TNC	2005-01577	Nitrate Nitrogen	31-Jan-05	Routine Major	MON	2/1/2005	Compliance Achieved
FOBIANS M & J	32	BLACK HAWK	IA0709208	TNC	2005-02873	Nitrate Nitrogen	30-Apr-05	Routine Major	MON	6/10/2005	Compliance Achieved
FOBIANS M & J	32	BLACK HAWK	IA0709208	TNC	2005-03093	Nitrate Nitrogen	31-May-05	Routine Major	MON	6/10/2005	Compliance Achieved
FOREST RIDGE - CENTER	120	EMMET	IA3290601	CWS	2005-01693	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	10/18/2005	Compliance Achieved
FOREST RIDGE - CENTER	120	EMMET	IA3290601	CWS	2005-01803	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/16/2005	Compliance Achieved
FOREST RIDGE - CENTER	120	EMMET	IA3290601	CWS	2006-00797	Chlorine	28-Feb-05	Monitoring (DBP), Major	MON		No EPA Enforcement Action

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
FORT DODGE ICE & COLD	30	WEBSTER	IA9433103	TNC	2005-01829	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	4/14/2005	Compliance Achieved
FOUR OAKS	60	LINN	IA5715802	CWS	2005-02963	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	12/14/2005	Compliance Achieved
FOUR OAKS	60	LINN	IA5715802	CWS	2006-00856	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	8/4/2005	Compliance Achieved
FREMONT GOLF COURSE	129	FREMONT	IA3661884	TNC	2005-03145	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	2/1/2006	Compliance Achieved
FREMONT GOLF COURSE	129	FREMONT	IA3661884	TNC	2005-03516	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	2/1/2006	Compliance Achieved
FRYTOWN WATER COOP	87	JOHNSON	IA5291301	CWS	2005-03527	Failure to meet Certified Operator Requirement	30-Jun-05	Operator Certification	STA	1/1/2006	Compliance Achieved
FRYTOWN WATER COOP	87	JOHNSON	IA5291301	CWS	2006-00427	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	5/25/2006	Compliance Achieved
FRYTOWN WATER COOP	87	JOHNSON	IA5291301	CWS	2006-00525	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	11/1/2005	Compliance Achieved
GALT MUNICIPAL WATER SUPPLY	30	WRIGHT	IA9932071	CWS	2005-03843	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	4/14/2006	Compliance Achieved
GALT MUNICIPAL WATER SUPPLY	30	WRIGHT	IA9932071	CWS	2006-01279	Arsenic	31-Dec-05	Routine Major	MON	4/14/2006	Compliance Achieved
GATEWAY DEVELOPMENT	25	JOHNSON	IA5225312	NTNC	2005-03276	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/29/2005	Compliance Achieved
GATEWAY DEVELOPMENT	25	JOHNSON	IA5225312	NTNC	2006-00074	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	10/10/2005	Compliance Achieved
GATEWAY DEVELOPMENT	25	JOHNSON	IA5225312	NTNC	2006-01202	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	4/5/2006	Compliance Achieved
GEORGE WATER SUPPLY	1051	LYON	IA6028081	CWS	2005-01845	Nitrate Nitrogen	31-Mar-05	MCL, Single	MCL	9/30/2005	Compliance Achieved
GEORGIA PACIFIC CORP GYPSUM DIV.	160	WEBSTER	IA9433188	NTNC	2006-00276	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	1/31/2006	Compliance Achieved
GEORGIA PACIFIC CORP GYPSUM DIV.	160	WEBSTER	IA9433188	NTNC	2006-00315	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	4/5/2006	Compliance Achieved
GILBERT WATER SUPPLY	987	STORY	IA8531083	CWS	2005-03996	Nitrite Nitrogen	31-Aug-05	Routine Major	MON	2/7/2006	Compliance Achieved
GILBERT WATER SUPPLY	987	STORY	IA8531083	CWS	2006-00824	Copper	30-Jun-05	AL, 90th Percentile	MCL	12/1/2005	NOV issued
GILBERT WATER SUPPLY	987	STORY	IA8531083	CWS	2006-00988	Copper	31-Dec-05	AL, 90th Percentile	MCL	1/13/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
GOLD KEY MOTEL	58	FRANKLIN	IA3544720	TNC	2005-01899	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/17/2005	Compliance Achieved
GOLD KEY MOTEL	58	FRANKLIN	IA3544720	TNC	2005-02064	Failure to meet Compliance Schedule	06-May-05	Compliance Schedule	V/E	4/18/2006	AO w/ Penalty
GOODELL WATER SUPPLY	174	HANCOCK	IA4135093	CWS	2005-03856	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	4/5/2006	Compliance Achieved
GOULD HEIGHTS WATER SERVICE COMPANY	570	POLK	IA7700853	CWS	2005-03976	Total Haloacetic Acids	31-Jul-05	Monitoring (DBP), Major	MON	10/3/2005	NOV issued
GOULD HEIGHTS WATER SERVICE COMPANY	570	POLK	IA7700853	CWS	2005-03977	Total Trihalomethanes	31-Jul-05	Routine Major	MON	10/3/2005	NOV issued
GRANDMAS SNACK SHOP	46	BUTLER	IA1211821	TNC	2005-03830	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	2/24/2006	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-01703	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	7/19/2005	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-01848	Coliform Bacteria, Total	30-Apr-05	MCL (TCR), Monthly	MCL	7/19/2005	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-01888	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/5/2005	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-02715	Coliform Bacteria, Total	30-Apr-05	Repeat Major	MON	5/9/2005	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-02716	Coliform Bacteria, Total	30-Apr-05	Repeat Major	MON	5/9/2005	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-02717	Coliform Bacteria, Total	30-Apr-05	Repeat Major	MON	5/9/2005	Compliance Achieved
GRANNY B CAFE	37	CASS	IA1545201	TNC	2005-02718	Coliform Bacteria, Total	30-Apr-05	Repeat Major	MON	5/9/2005	Compliance Achieved
GREEN BRIER SUBDIVISION	47	DUBUQUE	IA3126307	CWS	2006-00297	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	2/8/2006	Compliance Achieved
GREEN BRIER SUBDIVISION	47	DUBUQUE	IA3126307	CWS	2006-00298	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	2/8/2006	Compliance Achieved
GREENE LANES	41	FLOYD	IA1253851	TNC	2005-01890	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	12/30/2005	Compliance Achieved
GREENWOOD ACRES WATER CO.	240	POLK	IA7709395	CWS	2006-00977	Copper	30-Jun-05	AL, 90th Percentile	MCL	1/9/2006	NOV issued
GREENWOOD ACRES WATER CO.	240	POLK	IA7709395	CWS	2006-00978	Copper	31-Dec-05	AL, 90th Percentile	MCL	1/9/2006	NOV issued
GUTTENBERG GOLF & COUNTRY CLUB	129	CLAYTON	IA2242204	TNC	2005-03840	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/16/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-00861	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	10/20/2005	Compliance Achieved
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-00959	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	10/20/2005	Compliance Achieved
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-00960	Chlorine	31-Aug-05	Monitoring (DBP), Major	MON	10/20/2005	Compliance Achieved
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-00961	Failure to meet Compliance Schedule	31-Oct-05	Compliance Schedule	V/E	10/19/2005	NOV issued
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-01906	Failure to submit Monthly Operation Report	31-Jul-05	Monitoring (MOR)	MON	10/20/2005	Compliance Achieved
HANCOCK COUNTY FAIRGROUNDS	27	HANCOCK	IA4103201	TNC	2005-03371	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/11/2005	Compliance Achieved
HANFORD COMMUNITY CHURCH	52	CERRO GORDO	IA1739801	TNC	2006-01258	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/27/2006	Compliance Achieved
HARD WATER INN	33	CLARKE	IA2038201	TNC	2005-01782	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	11/17/2005	Compliance Achieved
HARPER WATER SUPPLY	134	KEOKUK	IA5428031	CWS	2006-00241	Total Trihalomethanes	31-Aug-05	Routine Major	MON	10/27/2005	NOV issued
HARPER WATER SUPPLY	134	KEOKUK	IA5428031	CWS	2006-00242	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	10/27/2005	NOV issued
HARPER WATER SUPPLY	134	KEOKUK	IA5428031	CWS	2006-00439	Failure to meet Certified Operator Requirement	30-Nov-05	Operator Certification	STA	4/17/2006	Compliance Achieved
HARPERS CAFE AND MOTEL	33	ALLAMAKEE	IA0330710	TNC	2005-03648	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	9/28/2005	Compliance Achieved
HARPERS CAFE AND MOTEL	33	ALLAMAKEE	IA0330710	TNC	2005-03696	Nitrate Nitrogen	31-Jul-05	Routine Major	MON	9/28/2005	Compliance Achieved
HARPERS CAFE AND MOTEL	33	ALLAMAKEE	IA0330710	TNC	2006-00186	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2005-02945	Nitrate Nitrogen	31-May-05	MCL, Single	MCL	7/6/2005	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-00051	Nitrate Nitrogen	31-Oct-05	MCL, Single	MCL	1/25/2006	BCA issued
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-00801	Nitrate Nitrogen	30-Nov-05	MCL, Single	MCL	1/25/2006	BCA issued
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-00957	Nitrate Nitrogen	31-Dec-05	MCL, Single	MCL	1/25/2006	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00580	Barium	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00581	Cadmium	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00582	Chromium	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00583	Fluoride	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00584	Mercury	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00585	Antimony	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00586	Thallium	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENDERSON WATER DEPARTMENT	171	MILLS	IA6529043	CWS	2006-00587	Selenium	30-Sep-05	Routine Major	MON	12/21/2005	Compliance Achieved
HENNESSY SCHOOL (PETERSBURG)	81	DUBUQUE	IA3130809	NTNC	2006-00866	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	12/15/2005	Compliance Achieved
HICKORY ESTATES	48	SCOTT	IA8227301	CWS	2006-01184	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/6/2006	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2005-01687	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	10/20/2005	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2005-01884	Coliform Bacteria, Total	31-Mar-05	Repeat Major	MON	6/6/2005	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2005-01885	Coliform Bacteria, Total	31-Mar-05	Repeat Major	MON	6/6/2005	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2005-01886	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	6/6/2005	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2005-02881	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	10/20/2005	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2005-04013	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	10/20/2005	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2006-01273	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2006-01274	Nitrite Nitrogen	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
HIGHLAND HIGH SCHOOL	305	WASHINGTON	IA9260528	NTNC	2005-01874	Fluoride	31-Mar-05	Confirmation/Check Major	MON	5/11/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
HILLS BAR & GRILL	55	JOHNSON	IA5221204	TNC	2005-03403	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	8/1/2005	Compliance Achieved
HILLS SCHOOL-IA CITY COMM SCHOOLS	193	JOHNSON	IA5221519	NTNC	2005-01901	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/6/2005	Compliance Achieved
HILLSIDE GOLF	62	HANCOCK	IA5592893	TNC	2005-03969	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/27/2005	Compliance Achieved
HILLSIDE GOLF	62	HANCOCK	IA5592893	TNC	2006-00528	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	12/9/2005	Compliance Achieved
HITTERS SPORTS PARK	400	LINN	IA5715204	TNC	2005-03294	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	10/19/2005	Compliance Achieved
HITTERS SPORTS PARK	400	LINN	IA5715204	TNC	2005-03898	Nitrate Nitrogen	31-Aug-05	Confirmation/Check Major	MON	10/19/2005	Compliance Achieved
HITTERS SPORTS PARK	400	LINN	IA5715204	TNC	2006-00247	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	5/1/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2005-01999	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	6/28/2005	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2005-02000	Nitrite Nitrogen	31-Mar-05	Routine Major	MON	6/28/2005	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2005-02001	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	6/28/2005	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2005-02909	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	6/28/2005	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2005-03102	Coliform Bacteria, Total	31-May-05	Routine Major	MON	6/28/2005	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2006-00711	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	11/30/2005	Compliance Achieved
HORNICK WATER SUPPLY	253	WOODBURY	IA9738057	CWS	2005-01929	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/2/2005	Compliance Achieved
HORSTMANN GENERAL STORE	28	SCOTT	IA8212201	TNC	2006-01250	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	1/3/2006	Compliance Achieved
HULL WATER SUPPLY	1960	SIOUX	IA8444063	CWS	2005-03820	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	2/13/2006	Compliance Achieved
HULL WATER SUPPLY	1960	SIOUX	IA8444063	CWS	2006-00974	Failure to meet Certified Operator Requirement	30-Nov-05	Operator Certification	STA	11/10/2005	AO w/ Penalty
HUMBOLDT COUNTRY CLUB	82	HUMBOLDT	IA4641884	TNC	2006-00072	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/9/2005	Compliance Achieved
INDIAN HILLS HOME OWNERS ASSOCIATION	30	JOHNSON	IA5280302	CWS	2005-03051	Coliform Bacteria, Total	31-May-05	Routine Major	MON	6/16/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
IOWA ARMY AMMUNITION PLANT	900	DES MOINES	IA2900900	NTNC	2005-01486	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/23/2005	BCA issued
IOWA ARMY AMMUNITION PLANT	900	DES MOINES	IA2900900	NTNC	2005-02048	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/23/2005	BCA issued
IOWA ARMY AMMUNITION PLANT	900	DES MOINES	IA2900900	NTNC	2005-03557	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	8/23/2005	BCA issued
IOWA ARMY AMMUNITION PLANT	900	DES MOINES	IA2900900	NTNC	2006-00956	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	8/23/2005	BCA issued
IOWA CITY REGENCY MHP	700	JOHNSON	IA5225673	CWS	2005-01683	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	9/27/2005	Compliance Achieved
IOWA CITY REGENCY MHP	700	JOHNSON	IA5225673	CWS	2005-01843	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	9/27/2005	Compliance Achieved
IOWA CITY REGENCY MHP	700	JOHNSON	IA5225673	CWS	2006-00755	Consumer Confidence Report	31-Jul-05	CCR	RPT	11/28/2005	Compliance Achieved
IOWA CITY REHABILITATION & HEALTH CARE C	128	JOHNSON	IA5200847	CWS	2005-02049	Coliform Bacteria, Total	30-Apr-05	MCL (TCR), Monthly	MCL	10/10/2005	Compliance Achieved
IOWA ETHANOL LLC	40	WORTH	IA9830202	NTNC	2005-03452	Copper	30-Jun-05	AL, 90th Percentile	MCL	4/11/2006	Compliance Achieved
IOWA TRUCK STOP #385	27	CERRO GORDO	IA1716202	TNC	2005-01942	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	6/30/2005	Compliance Achieved
IOWA VALLEY ESTATES	85	IOWA	IA4800634	CWS	2005-01681	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	8/3/2005	Compliance Achieved
ISU	28178	STORY	IA8503528	CWS	2005-03118	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	1/25/2006	Compliance Achieved
ISU	28178	STORY	IA8503528	CWS	2005-03168	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	1/25/2006	Compliance Achieved
IZAAK WALTON LEAGUE-DAVENPORT	50	SCOTT	IA8222801	TNC	2006-00024	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	1/5/2006	Compliance Achieved
IZAAK WALTON LEAGUE-IOWA CITY	34	JOHNSON	IA5225803	TNC	2006-00463	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	5/11/2006	Compliance Achieved
J WOOD PARK	25	CLAYTON	IA2234441	TNC	2005-03031	Coliform Bacteria, Total	31-May-05	Routine Major	MON	8/2/2005	Compliance Achieved
JAEGER PLUMBING & PUMP, INC.	50	DUBUQUE	IA3126713	TNC	2005-01768	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	12/15/2005	Compliance Achieved
JAKWAY PARK-CAMPING AREA	25	BUCHANAN	IA1031402	TNC	2005-03583	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/19/2005	NOV issued
JERICO JOS	28	CHICKASAW	IA1951201	TNC	2005-01572	Nitrate Nitrogen	31-Jan-05	Routine Major	MON	2/15/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
JERICO JOS	28	CHICKASAW	IA1951201	TNC	2006-00917	Nitrate Nitrogen	30-Nov-05	Routine Major	MON	2/24/2006	Compliance Achieved
JERICO JOS	28	CHICKASAW	IA1951201	TNC	2006-01209	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
JERICO JOS	28	CHICKASAW	IA1951201	TNC	2006-01210	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
JEWELS SKATE COUNTRY	104	WINNESHIEK	IA9630204	TNC	2006-00619	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	12/15/2005	Compliance Achieved
JMD OIL INC	45	CEDAR	IA1600605	CWS	2005-01793	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/24/2005	Compliance Achieved
JMD OIL INC	45	CEDAR	IA1600605	CWS	2006-00392	Sodium	30-Sep-05	Routine Major	MON	11/4/2005	Compliance Achieved
JMD OIL INC	45	CEDAR	IA1600605	CWS	2006-00841	Failure to meet Certified Operator Requirement	31-Dec-05	Operator Certification	STA	12/30/2005	Compliance Achieved
JOHN MORRELL & COMPANY	1325	WOODBURY	IA9778897	NTNC	2005-03602	Failure to meet Certified Operator Requirement	31-Jul-05	Operator Certification	STA	7/5/2005	NOV issued
JOLLEY WATER SUPPLY	54	CALHOUN	IA1335001	CWS	2006-00853	Failure to submit MRDL	30-Jun-05	Reporting	RPT	12/6/2005	NOV issued
JOLLEY WATER SUPPLY	54	CALHOUN	IA1335001	CWS	2006-00855	Failure to submit MRDL	30-Sep-05	Reporting	RPT	12/6/2005	NOV issued
JOLLEY WATER SUPPLY	54	CALHOUN	IA1335001	CWS	2006-00897	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	12/6/2005	Compliance Achieved
JOLLEY WATER SUPPLY	54	CALHOUN	IA1335001	CWS	2006-00946	Chlorine	30-Nov-05	Monitoring (DBP), Major	MON	12/6/2005	Compliance Achieved
K & S QUASKY MART & DELI, LLC	103	BUCHANAN	IA1074203	TNC	2005-01859	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	12/15/2005	Compliance Achieved
K & S QUASKY MART & DELI, LLC	103	BUCHANAN	IA1074203	TNC	2005-02044	Coliform Bacteria, Fecal	30-Jun-05	MCL (TCR), Acute	MCL	12/15/2005	Compliance Achieved
K & S QUASKY MART & DELI, LLC	103	BUCHANAN	IA1074203	TNC	2005-02068	Coliform Bacteria, Total	31-May-05	MCL (TCR), Monthly	MCL	12/15/2005	Compliance Achieved
K&K GAS & FOOD INC	50	JACKSON	IA3198799	TNC	2005-02732	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	10/18/2005	Compliance Achieved
K&K GAS & FOOD INC	50	JACKSON	IA3198799	TNC	2005-03402	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	10/18/2005	Compliance Achieved
KAMMERER MOBILE HOME PARK	100	MUSCATINE	IA7000686	CWS	2005-03974	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	9/6/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
KAMRAR WATER DEPT	229	HAMILTON	IA4033013	CWS	2005-02014	Arsenic	31-Mar-05	Routine Major	MON	5/9/2005	Compliance Achieved
KELSIES	52	DUBUQUE	IA3126204	TNC	2006-00219	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	5/8/2006	Compliance Achieved
KELSIES	52	DUBUQUE	IA3126204	TNC	2006-01105	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	5/8/2006	Compliance Achieved
KENDALLVILLE PARK	25	WINNESHIEK	IA9615901	TNC	2005-03152	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	7/13/2005	NOV issued
KENDALLVILLE PARK	25	WINNESHIEK	IA9615901	TNC	2005-03550	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/1/2005	NOV issued
KENDALLVILLE PARK	25	WINNESHIEK	IA9615901	TNC	2005-03849	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/15/2005	NOV issued
KENSETT FABRICATORS INC	26	WORTH	IA9840896	NTNC	2006-00282	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/20/2005	Compliance Achieved
KESWICK WATER SYSTEM	295	KEOKUK	IA5442029	CWS	2006-00756	Consumer Confidence Report	31-Jul-05	CCR	RPT	1/10/2006	Compliance Achieved
KEYSTONE WATER SUPPLY	687	BENTON	IA0640030	CWS	2005-02955	Nitrite Nitrogen	30-Jun-05	MCL, Single	MCL	12/15/2005	Compliance Achieved
KINGDOM HALL	50	CLAYTON	IA2223871	TNC	2005-03267	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/27/2005	Compliance Achieved
KLEMME WATER WORKS	593	HANCOCK	IA4155035	CWS	2005-02920	Radium 226 & Radium 228	31-Mar-05	MCL, Average	MCL	5/20/2005	NOV issued
KLEMME WATER WORKS	593	HANCOCK	IA4155035	CWS	2005-02921	Radium 226 & Radium 228	30-Jun-05	MCL, Average	MCL	5/20/2005	NOV issued
KUM & GO STORE #443	162	IOWA	IA4884784	TNC	2005-03318	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	11/2/2005	Compliance Achieved
KUM & GO STORE #443	162	IOWA	IA4884784	TNC	2005-03905	Nitrate Nitrogen	31-Aug-05	Confirmation/Check Major	MON	11/2/2005	Compliance Achieved
KUM & GO STORE #443	162	IOWA	IA4884784	TNC	2006-00229	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
KUM & GO STORE #23	111	POTTAWATTAMIE	IA7853100	TNC	2005-01811	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/23/2005	Compliance Achieved
L T TAP	25	CHICKASAW	IA1957201	TNC	2005-03085	Nitrate Nitrogen	31-May-05	Routine Major	MON	10/5/2005	Compliance Achieved
LAKE CREST MANOR HOA #3	300	JOHNSON	IA5200891	CWS	2005-02741	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	5/26/2005	Compliance Achieved
LAKE CREST MANOR HOA #3	300	JOHNSON	IA5200891	CWS	2006-00758	Consumer Confidence Report	31-Jul-05	CCR	RPT	12/6/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LAKE CREST MANOR HOA #3	300	JOHNSON	IA5200891	CWS	2006-01324	Arsenic	31-Dec-05	MCL, Average	MCL	2/6/2006	BCA issued
LAKE RIDGE, INCORPORATED	900	JOHNSON	IA5225315	CWS	2005-03277	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/12/2005	Compliance Achieved
LAKE SHORE RESORTS CLUB INC	65	FAYETTE	IA3353202	TNC	2005-03090	Nitrate Nitrogen	31-May-05	Routine Major	MON	10/18/2005	Compliance Achieved
LAKESIDE MANOR PARK	215	SCOTT	IA8200605	CWS	2006-01236	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/28/2006	Compliance Achieved
LAKESIDE RESTAURANT	37	WRIGHT	IA9909203	TNC	2006-00346	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/7/2005	NOV issued
LAKESIDE RESTAURANT	37	WRIGHT	IA9909203	TNC	2006-00347	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/7/2005	NOV issued
LAKESIDE RESTAURANT	37	WRIGHT	IA9909203	TNC	2006-01044	Nitrate Nitrogen	31-Dec-05	Confirmation/Check Major	MON	1/25/2006	NOV issued
LAKESIDE RESTAURANT	37	WRIGHT	IA9909203	TNC	2006-01237	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
LAKEWOOD UTILITIES	200	WEBSTER	IA9433324	CWS	2006-00450	Failure to meet Certified Operator Requirement	30-Nov-05	Operator Certification	STA	11/17/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02771	Arsenic	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02772	Barium	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02773	Cadmium	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02774	Chromium	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02775	Fluoride	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02776	Mercury	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02777	Sodium	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02778	Antimony	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02779	Thallium	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2005-02780	Selenium	31-Mar-05	Routine Major	MON	5/24/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2006-00515	Copper	30-Sep-05	Routine Tap	MON	11/28/2005	NOV issued
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2006-00516	Lead	30-Sep-05	Routine Tap	MON	11/28/2005	NOV issued
LARRABEE MUNICIPAL WATER WORKS	149	CHEROKEE	IA1833060	CWS	2006-01602	Failure to obtain Construction Permit	28-Feb-05	Non-Reported Type	STA	3/9/2005	Compliance Achieved
LEHIGH CEMENT COMPANY	155	CERRO GORDO	IA1750196	NTNC	2006-00422	Copper	30-Sep-05	Routine Tap	MON	11/3/2005	NOV issued
LEHIGH CEMENT COMPANY	155	CERRO GORDO	IA1750196	NTNC	2006-00423	Lead	30-Sep-05	Routine Tap	MON	11/3/2005	NOV issued
LEHIGH WATER SUPPLY	497	WEBSTER	IA9453071	CWS	2006-01610	Radium 226 & Radium 228	31-Mar-05	MCL, Average	MCL	3/13/2006	Compliance Achieved
LEHIGH WATER SUPPLY	497	WEBSTER	IA9453071	CWS	2006-01611	Radium 226 & Radium 228	30-Jun-05	MCL, Average	MCL	3/13/2006	Compliance Achieved
LEISURE LAKE ASSOCIATION	26	JACKSON	IA4929801	TNC	2005-03135	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	8/24/2005	Compliance Achieved
LEISURE LAKE ASSOCIATION	26	JACKSON	IA4929801	TNC	2005-03501	Coliform Bacteria, Fecal	30-Jun-05	MCL (TCR), Acute	MCL	8/24/2005	Compliance Achieved
LEISURE LAKE ASSOCIATION	26	JACKSON	IA4929801	TNC	2005-03639	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/12/2005	Compliance Achieved
LEISURE LAKE ASSOCIATION	26	JACKSON	IA4929801	TNC	2005-03640	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	8/24/2005	Compliance Achieved
LEMKE FUNERAL HOME - ANDOVER	25	CLINTON	IA2307201	TNC	2005-01923	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/4/2005	Compliance Achieved
LETTS UNITED METHODIST CHURCH	26	LOUISA	IA5847820	TNC	2005-02964	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	1/3/2006	Compliance Achieved
LETTS UNITED METHODIST CHURCH	26	LOUISA	IA5847820	TNC	2005-03192	Coliform Bacteria, Total	30-Jun-05	Repeat Major	MON	7/11/2005	Compliance Achieved
LETTS UNITED METHODIST CHURCH	26	LOUISA	IA5847820	TNC	2005-03320	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/28/2005	Compliance Achieved
LETTS UNITED METHODIST CHURCH	26	LOUISA	IA5847820	TNC	2005-03494	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	1/3/2006	Compliance Achieved
LEWIS AND CLARK STATE PARK	67	MONONA	IA6739949	TNC	2006-00538	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	11/29/2005	Compliance Achieved
LIBERTY DOORS	32	JOHNSON	IA5252101	TNC	2005-03496	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	1/3/2006	Compliance Achieved
LIBERTY DOORS	32	JOHNSON	IA5252101	TNC	2006-00017	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	1/3/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2005-02054	Coliform Bacteria, Total	30-Apr-05	MCL (TCR), Monthly	MCL	9/22/2005	BCA issued
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2005-02984	Coliform Bacteria, Total	31-May-05	Routine Major	MON	11/8/2005	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2005-03154	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	9/22/2005	BCA issued
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2005-03155	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	9/22/2005	BCA issued
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-01146	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	3/14/2006	Compliance Achieved
LINN HOLLOW MHP	60	WASHINGTON	IA9200601	CWS	2005-01587	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	8/22/2005	Compliance Achieved
LITTLE ANGELS CHILD CARE CENTER	29	JOHNSON	IA5285501	NTNC	2005-03148	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	12/13/2005	Compliance Achieved
LITTLE ANGELS CHILD CARE CENTER	29	JOHNSON	IA5285501	NTNC	2006-00340	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	10/18/2005	Compliance Achieved
LITTLE ROCK WATER SUPPLY	493	LYON	IA6060006	CWS	2006-00971	Lead	30-Sep-05	AL, 90th Percentile	MCL	11/8/2005	BCA issued
LITTLE ROCK WATER SUPPLY	493	LYON	IA6060006	CWS	2006-01296	Failure to conduct Lead Public Education	30-Sep-05	Public Education	RPT	2/27/2006	Compliance Achieved
LITTLE SIOUX SCOUT RANCH	25	HARRISON	IA7820431	TNC	2005-03627	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	9/15/2005	Compliance Achieved
LOGAN-MISSOURI VALLEY COUNTRY CLUB	105	HARRISON	IA4337201	TNC	2005-03703	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/17/2005	Compliance Achieved
LOGANSPOUT WATER DISTRICT #1	150	BOONE	IA0837701	CWS	2006-00813	Lead	30-Sep-05	AL, 90th Percentile	MCL	11/30/2005	NOV issued
LOMBARDIS	54	DUBUQUE	IA4910861	TNC	2006-00231	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/16/2005	Compliance Achieved
LONE ROCK WATER SUPPLY	157	KOSSUTH	IA5547094	CWS	2005-03174	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	12/9/2005	Compliance Achieved
LONE TREE MUNI WATER SYSTEM	1195	JOHNSON	IA5240095	CWS	2005-03580	Copper	30-Jun-05	AL, 90th Percentile	MCL	12/28/2005	Compliance Achieved
LOUISA-MUSCATINE COMMUNITY SCHOOL	1190	LOUISA	IA5847537	NTNC	2005-01758	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	9/19/2005	Compliance Achieved
LOYAL ORDER OF THE MOOSE LODGE/C RAPIDS	70	LINN	IA5715209	TNC	2006-00330	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/28/2005	Compliance Achieved
LU VERNE WATER SUPPLY	299	KOSSUTH	IA5551006	CWS	2006-00767	Consumer Confidence Report	31-Jul-05	CCR	RPT	5/3/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
M AND W MOBILE HOME PARK	275	MUSCATINE	IA7000601	CWS	2006-00762	Consumer Confidence Report	31-Jul-05	CCR	RPT	1/6/2006	Compliance Achieved
MACEDONIA WATER SUPPLY	325	POTTAWATTAMIE	IA7841014	CWS	2006-00416	Copper	30-Sep-05	Routine Tap	MON	10/28/2005	NOV issued
MACEDONIA WATER SUPPLY	325	POTTAWATTAMIE	IA7841014	CWS	2006-00417	Lead	30-Sep-05	Routine Tap	MON	10/28/2005	NOV issued
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-00209	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-00322	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-00376	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01080	Nitrate Nitrogen	31-Dec-05	Confirmation/Check Major	MON	2/24/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01208	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01298	Failure to submit Monthly Operation Report	31-Aug-05	Monitoring (MOR)	MON	3/9/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01299	Failure to submit Monthly Operation Report	30-Sep-05	Monitoring (MOR)	MON	3/9/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01300	Failure to submit Monthly Operation Report	31-Oct-05	Monitoring (MOR)	MON	3/9/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01301	Failure to submit Monthly Operation Report	30-Nov-05	Monitoring (MOR)	MON	3/9/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01302	Failure to submit Monthly Operation Report	31-Dec-05	Monitoring (MOR)	MON	3/9/2006	Compliance Achieved
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2006-01303	Failure to submit Action Plan	30-Sep-05	Compliance Schedule	V/E	1/21/2006	NOV issued
MANCHESTER FISH HATCHERY	25	DELAWARE	IA2839996	TNC	2005-01796	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	10/4/2005	Compliance Achieved
MANCHESTER FISH HATCHERY	25	DELAWARE	IA2839996	TNC	2005-01895	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/4/2005	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2005-01814	Nitrate Nitrogen	28-Feb-05	Routine Major	MON	10/4/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2005-03993	Nitrate Nitrogen	31-Aug-05	Routine Major	MON	10/4/2005	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-00913	Nitrate Nitrogen	30-Nov-05	Routine Major	MON	3/14/2006	Compliance Achieved
MASON CITY WATER DEPARTMENT	29172	CERRO GORDO	IA1750048	CWS	2005-03532	Consumer Confidence Report	01-Jul-05	CCR	RPT	7/27/2005	NOV issued
MATSELL BRIDGE A	150	LINN	IA5720914	TNC	2005-01573	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	9/12/2005	Compliance Achieved
MATSELL BRIDGE A	150	LINN	IA5720914	TNC	2005-03814	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	9/7/2005	NOV issued
MATSELL BRIDGE A	150	LINN	IA5720914	TNC	2005-03833	Coliform Bacteria, Fecal	31-Aug-05	MCL (TCR), Acute	MCL	9/7/2005	NOV issued
MEADOW HILLS GOLF COURSE	44	HARDIN	IA4260807	TNC	2005-02047	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	5/2/2005	NOV issued
MEADOW LANE MOBILE HOME PARK	130	BREMER	IA0900647	CWS	2006-00739	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued
MELODY OAKS SUBDIVISION	40	HARRISON	IA4344301	CWS	2006-00738	Consumer Confidence Report	31-Jul-05	CCR	RPT	3/20/2006	Compliance Achieved
MELSHA TAP INC	25	JOHNSON	IA5285203	TNC	2006-00825	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	12/8/2005	NOV issued
MELSHA TAP INC	25	JOHNSON	IA5285203	TNC	2006-00970	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	1/3/2006	NOV issued
METRO PAINTBALL GAMES	39	POTTAWATTAMIE	IA7820844	TNC	2006-00044	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	10/19/2005	NOV issued
MICKEYS VALLEY HALL	35	SCOTT	IA8271202	TNC	2005-01975	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/28/2005	Compliance Achieved
MICKEYS VALLEY HALL	35	SCOTT	IA8271202	TNC	2006-00351	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/10/2005	Compliance Achieved
MICKEYS VALLEY HALL	35	SCOTT	IA8271202	TNC	2006-01251	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	4/3/2006	Compliance Achieved
MID RIVER MARINA	27	JOHNSON	IA5252202	TNC	2005-01945	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	6/27/2005	Compliance Achieved
MID RIVER MARINA	27	JOHNSON	IA5252202	TNC	2005-02857	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	6/27/2005	Compliance Achieved
MID RIVER MARINA	27	JOHNSON	IA5252202	TNC	2005-03385	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	6/27/2005	Compliance Achieved
MID RIVER MARINA	27	JOHNSON	IA5252202	TNC	2006-00005	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	10/13/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MID RIVER MARINA	27	JOHNSON	IA5252202	TNC	2006-00826	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	12/2/2005	NOV issued
MIDDLETOWN WATER SUPPLY	535	DES MOINES	IA2952075	CWS	2005-01853	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/23/2005	BCA issued
MIDDLETOWN WATER SUPPLY	535	DES MOINES	IA2952075	CWS	2005-02950	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/23/2005	BCA issued
MIDDLETOWN WATER SUPPLY	535	DES MOINES	IA2952075	CWS	2005-04050	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	8/23/2005	BCA issued
MIDDLETOWN WATER SUPPLY	535	DES MOINES	IA2952075	CWS	2006-01326	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	8/23/2005	BCA issued
MIKES SALOON	240	PLYMOUTH	IA7528801	TNC	2005-03282	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/7/2005	Compliance Achieved
MILFORD MUNICIPAL UTILITIES	2486	DICKINSON	IA3050079	CWS	2006-01598	Turbidity	30-Apr-05	IESWTR Monitoring	MON	4/18/2005	NOV issued
MILFORD MUNICIPAL UTILITIES	2486	DICKINSON	IA3050079	CWS	2006-01599	Turbidity	31-May-05	IESWTR Monitoring	MON	6/3/2005	NOV issued
MILFORD MUNICIPAL UTILITIES	2486	DICKINSON	IA3050079	CWS	2006-01600	Turbidity	30-Jun-05	IESWTR Monitoring	MON	6/7/2005	NOV issued
MILFORD MUNICIPAL UTILITIES	2486	DICKINSON	IA3050079	CWS	2006-01601	Turbidity	31-Oct-05	IESWTR Recordkeeping	RPT	10/7/2005	NOV issued
MILLVILLE STEAKHOUSE	38	CLAYTON	IA2242786	TNC	2006-00296	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	12/16/2005	Compliance Achieved
MINBURN WATERWORKS	391	DALLAS	IA2547085	CWS	2005-03950	Total Haloacetic Acids	31-Jul-05	Monitoring (DBP), Major	MON	10/3/2005	NOV issued
MINBURN WATERWORKS	391	DALLAS	IA2547085	CWS	2005-03951	Total Trihalomethanes	31-Jul-05	Routine Major	MON	10/3/2005	NOV issued
MINDEN WATER SUPPLY	564	POTTAWATTAMIE	IA7849086	CWS	2005-03284	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/5/2005	Compliance Achieved
MITCHELL COUNTY CARE FACILITY	27	MITCHELL	IA6600901	NTNC	2005-02746	Nitrate Nitrogen	30-Apr-05	Routine Major	MON	5/16/2005	Compliance Achieved
MITCHELL DAM BAR	84	MITCHELL	IA6642201	TNC	2005-01915	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/11/2005	Compliance Achieved
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2005-01906	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/27/2005	Compliance Achieved
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2005-01956	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/27/2005	Compliance Achieved
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2005-03056	Coliform Bacteria, Total	31-May-05	Routine Major	MON	7/5/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2005-03095	Nitrate Nitrogen	31-May-05	Routine Major	MON	8/4/2005	Compliance Achieved
MONDAMIN WATER SUPPLY	423	HARRISON	IA4349094	CWS	2006-00407	Lead	30-Sep-05	AL, 90th Percentile	MCL	10/26/2005	NOV issued
MONDAMIN WATER SUPPLY	423	HARRISON	IA4349094	CWS	2006-00408	Copper	30-Sep-05	AL, 90th Percentile	MCL	10/26/2005	NOV issued
MONTI-VIEW MOBILE HOME PARK	60	JONES	IA5300688	CWS	2005-01711	Chlorine	31-Jan-05	Monitoring (DBP), Major	MON	12/16/2005	Compliance Achieved
MONTI-VIEW MOBILE HOME PARK	60	JONES	IA5300688	CWS	2006-00832	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	12/16/2005	Compliance Achieved
MONTI-VIEW MOBILE HOME PARK	60	JONES	IA5300688	CWS	2006-00860	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	12/16/2005	Compliance Achieved
MONTOUR WATER SUPPLY	285	TAMA	IA8666002	CWS	2005-01909	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/21/2005	Compliance Achieved
MOONSHINE TAP	30	CHICKASAW	IA1974222	TNC	2005-01505	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	9/21/2005	Compliance Achieved
MOONSHINE TAP	30	CHICKASAW	IA1974222	TNC	2006-00064	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	11/8/2005	Compliance Achieved
MOONSHINE TAP	30	CHICKASAW	IA1974222	TNC	2006-01198	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
MOOREHEAD PARK #1	253	IDA	IA4728958	TNC	2005-02738	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	5/3/2005	Compliance Achieved
MORGAN CREEK PARK	30	LINN	IA5715973	TNC	2006-00028	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	10/27/2005	NOV issued
MOUNT VERNON COMMUNITY BIBLE CHURCH	43	LINN	IA5758801	TNC	2005-03281	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/21/2005	Compliance Achieved
MOUNT VERNON WATER SUPPLY	4171	LINN	IA5758021	CWS	2005-03542	Radium 226 & Radium 228	31-Mar-05	Routine Major	MON	10/21/2005	Compliance Achieved
MOUNT VERNON WATER SUPPLY	4171	LINN	IA5758021	CWS	2005-03543	Gross Alpha, excluding Rn & U	31-Mar-05	Routine Major	MON	10/21/2005	Compliance Achieved
NAPSINEKEE HEIGHTS HOA	40	SCOTT	IA8245301	CWS	2006-01287	Arsenic	31-Dec-05	Routine Major	MON	2/16/2006	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2005-01802	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	8/31/2005	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2005-02731	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	8/31/2005	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2005-03661	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/31/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2006-00220	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2006-00904	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	2/24/2006	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2006-01106	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
NEW HAMPTON GOLF & COUNTRY CLUB	57	CHICKASAW	IA1970202	TNC	2005-04029	Nitrate Nitrogen	30-Sep-05	MCL, Single	MCL	9/21/2005	NOV issued
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-00491	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	11/17/2005	Compliance Achieved
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2005-03687	Total Trihalomethanes	30-Jun-05	Routine Major	MON	8/3/2005	Compliance Achieved
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2005-03688	Total Haloacetic Acids	30-Jun-05	Monitoring (DBP), Major	MON	8/3/2005	Compliance Achieved
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2006-00409	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	10/26/2005	NOV issued
NEW VIRGINIA WATER SUPPLY	469	WARREN	IA9159067	CWS	2005-03568	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/5/2005	NOV issued
NEW VIRGINIA WATER SUPPLY	469	WARREN	IA9159067	CWS	2006-00020	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	10/10/2005	NOV issued
NEW VIRGINIA WATER SUPPLY	469	WARREN	IA9159067	CWS	2006-01290	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	1/18/2006	NOV issued
NORA SPRINGS WEST HILLS GOLF COURSE	25	CERRO GORDO	IA3423801	TNC	2005-03321	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/20/2005	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2005-03445	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2005-03446	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2005-03447	Nitrite Nitrogen	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2005-03936	Nitrate Nitrogen	31-Aug-05	Confirmation/Check Major	MON	10/20/2005	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2005-03937	Nitrite Nitrogen	31-Aug-05	Confirmation/Check Major	MON	10/20/2005	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2006-00014	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	2/6/2006	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2006-00374	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2006-00438	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	2/6/2006	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2006-00892	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/6/2006	Compliance Achieved
NORBY FARM FLEET	48	WINNESHIEK	IA9630208	TNC	2006-00893	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/6/2006	Compliance Achieved
NORTH CORALVILLE LAKE MANOR	64	JOHNSON	IA5200889	CWS	2006-00768	Consumer Confidence Report	31-Jul-05	CCR	RPT	12/16/2005	Compliance Achieved
NORTH LINN HIGH SCHOOL / MIDDLE SCHOOL	475	LINN	IA5722532	NTNC	2006-00529	Copper	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
NORTH LINN HIGH SCHOOL / MIDDLE SCHOOL	475	LINN	IA5722532	NTNC	2006-00530	Lead	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
NORTH TWIN VIEW HEIGHTS	180	JOHNSON	IA5200813	CWS	2006-00771	Consumer Confidence Report	31-Jul-05	CCR	RPT	12/7/2005	Compliance Achieved
NORTHWOOD COUNTRY CLUB	42	WORTH	IA9855201	TNC	2005-03292	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/29/2005	Compliance Achieved
OAK LAKE MAINTENANCE, INC.	100	KOSSUTH	IA5500838	CWS	2006-00054	Coliform Bacteria, Total	31-Oct-05	MCL (TCR), Monthly	MCL	10/28/2005	NOV issued
OAKDALE HOSPITAL WATER SYSTEM	450	JOHNSON	IA5200982	NTNC	2005-03183	Copper	30-Jun-05	AL, 90th Percentile	MCL	12/8/2005	Compliance Achieved
OAKDALE HOSPITAL WATER SYSTEM	450	JOHNSON	IA5200982	NTNC	2005-03184	Lead	30-Jun-05	AL, 90th Percentile	MCL	12/8/2005	Compliance Achieved
OAKDALE HOSPITAL WATER SYSTEM	450	JOHNSON	IA5200982	NTNC	2006-00990	Copper	31-Dec-05	AL, 90th Percentile	MCL	1/17/2006	BCA issued
OAKGROVE CHRISTIAN CHURCH	140	BENTON	IA0670801	TNC	2005-03519	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/1/2005	NOV issued
OKOBOJI VIEW GOLF COURSE	127	DICKINSON	IA3070868	TNC	2005-02730	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	5/16/2005	Compliance Achieved
OLDTIMERS # 3 SOUTH	25	ALLAMAKEE	IA0330632	TNC	2006-01081	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/24/2006	NOV issued
OLLIE MEMORIAL FIELD	50	KEOKUK	IA5460201	TNC	2005-02073	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	2/20/2006	Compliance Achieved
OLSENS WATER SYSTEM	60	HAMILTON	IA4003211	TNC	2005-01916	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	8/4/2005	Compliance Achieved
OLSENS WATER SYSTEM	60	HAMILTON	IA4003211	TNC	2005-02988	Nitrate Nitrogen	31-May-05	Confirmation/Check Major	MON	8/4/2005	Compliance Achieved
OLSENS WATER SYSTEM	60	HAMILTON	IA4003211	TNC	2005-03957	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	10/5/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
OLSENS WATER SYSTEM	60	HAMILTON	IA4003211	TNC	2006-00222	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/9/2005	Compliance Achieved
OLSENS WATER SYSTEM	60	HAMILTON	IA4003211	TNC	2006-00906	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	1/27/2006	Compliance Achieved
OLSENS WATER SYSTEM	60	HAMILTON	IA4003211	TNC	2006-01116	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/27/2006	Compliance Achieved
ONAWA COUNTRY CLUB	50	MONONA	IA6739770	TNC	2005-03092	Coliform Bacteria, Total	31-May-05	Routine Major	MON	8/25/2005	Compliance Achieved
ONAWA COUNTRY CLUB	50	MONONA	IA6739770	TNC	2005-03380	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/14/2005	Compliance Achieved
ONAWA COUNTRY CLUB	50	MONONA	IA6739770	TNC	2005-03381	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/14/2005	Compliance Achieved
ONAWA COUNTRY CLUB	50	MONONA	IA6739770	TNC	2005-03739	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/25/2005	Compliance Achieved
ORIENT MUNICIPAL WATER SUPPLY	402	ADAIR	IA0160099	CWS	2006-00811	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	11/30/2005	NOV issued
OSCEOLA WATER WORKS	4659	CLARKE	IA2038038	CWS	2005-03797	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	1/11/2006	BCA issued
OSKALOOSA MUNICIPAL WATER DEPT	10938	MAHASKA	IA6273005	CWS	2006-00387	Sodium	30-Sep-05	Routine Major	MON	12/13/2005	Compliance Achieved
OSTERDOCK STORE	26	CLAYTON	IA2242203	TNC	2005-01933	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/6/2005	Compliance Achieved
OSTERDOCK STORE	26	CLAYTON	IA2242203	TNC	2005-03369	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/28/2005	Compliance Achieved
OSTERDOCK STORE	26	CLAYTON	IA2242203	TNC	2006-01204	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2005-01808	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/31/2005	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2006-00238	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	12/21/2005	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2006-00239	Total Trihalomethanes	31-Aug-05	Routine Major	MON	12/21/2005	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2006-00774	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/24/2006	Compliance Achieved
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2005-01469	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/23/2005	BCA issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2005-02051	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/23/2005	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2006-00414	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	11/9/2005	NOV issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2006-00434	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	11/9/2005	NOV issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2006-00787	Total Haloacetic Acids	31-Dec-05	MCL, Average	MCL	11/9/2005	NOV issued
PAGE I RWD (RED OAK)	2500	MONTGOMERY	IA6950701	CWS	2005-03786	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	2/28/2006	Compliance Achieved
PALO COMMUNITY CENTER	38	LINN	IA5765001	TNC	2005-02912	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	10/20/2005	Compliance Achieved
PALO COMMUNITY CENTER	38	LINN	IA5765001	TNC	2006-01211	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/10/2006	Compliance Achieved
PALO COMMUNITY CENTER	38	LINN	IA5765001	TNC	2006-01269	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/10/2006	Compliance Achieved
PALO SAVINGS BANK	70	LINN	IA5765204	TNC	2006-00922	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	12/9/2005	Compliance Achieved
PALO UNITED METHODIST CHURCH	50	LINN	IA5765801	TNC	2005-02853	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	10/20/2005	Compliance Achieved
PALO UNITED METHODIST CHURCH	50	LINN	IA5765801	TNC	2005-02854	Nitrate Nitrogen	30-Apr-05	Routine Major	MON	10/20/2005	Compliance Achieved
PALO UNITED METHODIST CHURCH	50	LINN	IA5765801	TNC	2006-00003	Nitrate Nitrogen	30-Sep-05	MCL, Single	MCL	10/3/2005	NOV issued
PANAMA WATER WORKS	212	SHELBY	IA8355025	CWS	2006-00040	Copper	30-Sep-05	AL, 90th Percentile	MCL	10/17/2005	NOV issued
PANDORAS BOX	55	DALLAS	IA2509203	TNC	2005-01821	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	5/9/2005	Compliance Achieved
PANDORAS BOX	55	DALLAS	IA2509203	TNC	2005-01944	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/9/2005	Compliance Achieved
PANDORAS BOX	55	DALLAS	IA2509203	TNC	2005-02856	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	5/9/2005	Compliance Achieved
PANORA WATER WORKS	1175	GUTHRIE	IA3971026	CWS	2005-01196	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	1/13/2005	NOV issued
PANORA WATER WORKS	1175	GUTHRIE	IA3971026	CWS	2005-02050	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	4/26/2005	NOV issued
PARADISE VALLEY CAMPGROUND	55	CLAYTON	IA2234601	TNC	2005-02941	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	6/10/2005	NOV issued
PARADISE VALLEY CAMPGROUND	55	CLAYTON	IA2234601	TNC	2006-00321	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	10/25/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PEOSTA WATER SUPPLY	651	DUBUQUE	IA3170001	CWS	2006-00512	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	1/6/2006	Compliance Achieved
PEOSTA WATER SUPPLY	651	DUBUQUE	IA3170001	CWS	2006-00803	Chlorine	31-Oct-05	Monitoring (DBP), Major	MON	1/6/2006	Compliance Achieved
PEOSTA WATER SUPPLY	651	DUBUQUE	IA3170001	CWS	2006-01910	Failure to submit MRDL	31-May-05	Reporting	RPT	7/8/2005	Compliance Achieved
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-01266	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-01267	Nitrite Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-01268	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
PICTURED ROCKS METHODIST CAMP	29	JONES	IA5343413	TNC	2006-01578	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/27/2006	Compliance Achieved
PINICON RIDGE C	150	LINN	IA5720907	TNC	2006-00467	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	4/21/2006	Compliance Achieved
PINICON RIDGE CAMPGROUNDS	150	LINN	IA5720905	TNC	2005-03535	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/2/2005	NOV issued
PINTS SUBDIVISION	87	BUCHANAN	IA1037301	CWS	2006-01623	Lead	30-Sep-05	AL, 90th Percentile	MCL	3/15/2006	NOV issued
PIONEER HI-BRED DURANT PLANT	63	CEDAR	IA1636101	NTNC	2006-00311	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	10/31/2005	Compliance Achieved
PLANTATION COUNTRY VIEW SUBDIVISION	25	WINNESHIEK	IA9680301	CWS	2005-02075	Lead	30-Jun-05	AL, 90th Percentile	MCL	5/10/2005	NOV issued
PLANTATION VILLAGE OWNERS ASSN INC	49	DES MOINES	IA2900600	CWS	2005-03510	Total Trihalomethanes	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
PLANTATION VILLAGE OWNERS ASSN INC	49	DES MOINES	IA2900600	CWS	2005-04051	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	3/27/2006	Compliance Achieved
PLANTATION VILLAGE OWNERS ASSN INC	49	DES MOINES	IA2900600	CWS	2006-00432	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	3/27/2006	Compliance Achieved
PLANTATION VILLAGE OWNERS ASSN INC	49	DES MOINES	IA2900600	CWS	2006-01295	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	3/27/2006	Compliance Achieved
PLEASANT CREEK ESTATES - PALO	45	LINN	IA5765302	CWS	2005-03743	Radium 226 & Radium 228	30-Jun-05	Routine Major	MON	11/8/2005	Compliance Achieved
PLEASANT CREEK ESTATES - PALO	45	LINN	IA5765302	CWS	2005-03744	Gross Alpha, excluding Rn & U	30-Jun-05	Routine Major	MON	11/8/2005	Compliance Achieved
PLEASANT CREEK ESTATES - PALO	45	LINN	IA5765302	CWS	2005-04038	Radium 226 & Radium 228	30-Sep-05	MCL, Average	MCL	9/23/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PLEASANT CREEK PUBLIC AREA 2	26	DUBUQUE	IA4910402	TNC	2006-00016	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	10/17/2005	NOV issued
PLYMOUTH WATER SUPPLY	429	CERRO GORDO	IA1759048	CWS	2005-03451	Copper	30-Sep-05	AL, 90th Percentile	MCL	4/12/2006	BCA issued
PONDEROSA HALL AND BALLROOM	100	BENTON	IA0690885	TNC	2005-03300	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/22/2005	Compliance Achieved
PONY CREEK PARK	28	MILLS	IA6525979	TNC	2005-03853	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/21/2005	NOV issued
PONY CREEK PARK	28	MILLS	IA6525979	TNC	2006-00011	Coliform Bacteria, Total	31-Oct-05	MCL (TCR), Monthly	MCL	10/6/2005	NOV issued
PRAIRIE CITY WATER WORKS	1365	JASPER	IA5064055	CWS	2005-03070	Nitrate Nitrogen	31-May-05	Routine Major	MON	2/7/2006	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2005-03553	Lead	30-Sep-05	AL, 90th Percentile	MCL	8/1/2005	BCA issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2005-03989	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	1/12/2006	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00280	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	1/12/2006	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00553	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	1/12/2006	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00798	Chlorine	31-Aug-05	Monitoring (DBP), Major	MON	1/24/2006	AO issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00799	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	1/24/2006	AO issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00804	Chlorine	31-Oct-05	Monitoring (DBP), Major	MON	1/24/2006	AO issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00912	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	1/12/2006	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00945	Chlorine	30-Nov-05	Monitoring (DBP), Major	MON	1/24/2006	AO issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00973	Failure to meet Certified Operator Requirement	31-Jul-05	Operator Certification	STA	7/1/2005	NOV issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-01174	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/12/2006	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-01292	Chlorine	31-Dec-05	Monitoring (DBP), Major	MON	1/24/2006	AO issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PRAIRIE VALLEY COMMUNITY SCHOOL	300	CALHOUN	IA1320501	NTNC	2005-01699	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	4/12/2005	Compliance Achieved
PRAIRIEBURG MUNI. WATER SUPPLY	175	LINN	IA5772054	CWS	2005-03457	Nitrite Nitrogen	30-Jun-05	Routine Major	MON	10/20/2005	Compliance Achieved
QUAKERDALE	35	HARDIN	IA4271901	CWS	2006-01283	Fluoride	31-Dec-05	Routine Major	MON	1/31/2006	Compliance Achieved
QUAKERDALE	35	HARDIN	IA4271901	CWS	2006-01284	Sodium	31-Dec-05	Routine Major	MON	1/27/2006	Compliance Achieved
RABINER TREATMENT CENTER	30	WEBSTER	IA9433801	NTNC	2006-01235	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/27/2006	Compliance Achieved
RACERS BAR & GRILL	105	KOSSUTH	IA5502203	TNC	2005-03393	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	11/17/2005	Compliance Achieved
RACERS BAR & GRILL	105	KOSSUTH	IA5502203	TNC	2006-00160	Nitrate Nitrogen	30-Sep-05	Confirmation/Check Major	MON	11/17/2005	Compliance Achieved
RADIO CITY MHP	400	POLK	IA7727601	CWS	2005-03390	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	12/19/2005	Compliance Achieved
RADIO CITY MHP	400	POLK	IA7727601	CWS	2005-04004	Total Trihalomethanes	31-Jul-05	Routine Major	MON	10/3/2005	NOV issued
RADIO CITY MHP	400	POLK	IA7727601	CWS	2005-04005	Total Haloacetic Acids	31-Jul-05	Monitoring (DBP), Major	MON	10/3/2005	NOV issued
RALEIGH HILLS GOLF COURSE	66	CHICKASAW	IA1946201	TNC	2005-03372	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/21/2005	Compliance Achieved
RALEIGH HILLS GOLF COURSE	66	CHICKASAW	IA1946201	TNC	2006-00323	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
RAPID CREEK RIDGE	70	JOHNSON	IA5225387	CWS	2005-03678	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/30/2005	Compliance Achieved
RATHBUN REG WTR ASSN (BURLINGTON)	7095	DES MOINES	IA0400902	CWS	2005-01851	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	12/22/2005	Compliance Achieved
RATHBUN REG WTR ASSN (BURLINGTON)	7095	DES MOINES	IA0400902	CWS	2005-03556	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	12/22/2005	Compliance Achieved
RATHBUN REG WTR ASSN (BURLINGTON)	7095	DES MOINES	IA0400902	CWS	2005-04026	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	12/22/2005	Compliance Achieved
RED MAN INN	37	MITCHELL	IA6634201	TNC	2005-03852	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/23/2005	NOV issued
RED MAN INN	37	MITCHELL	IA6634201	TNC	2005-04039	Coliform Bacteria, Fecal	30-Sep-05	MCL (TCR), Acute	MCL	9/23/2005	NOV issued
RED MAN INN	37	MITCHELL	IA6634201	TNC	2006-00953	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	12/30/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
RED MAN INN	37	MITCHELL	IA6634201	TNC	2006-00967	Coliform Bacteria, Fecal	31-Dec-05	MCL (TCR), Acute	MCL	12/30/2005	NOV issued
REDFIELD WATER WORKS	833	DALLAS	IA2564074	CWS	2006-00211	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/3/2005	NOV issued
REDFIELD WATER WORKS	833	DALLAS	IA2564074	CWS	2006-00212	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/3/2005	NOV issued
REGENCY MANOR MOBILE HOME PARK	763	POLK	IA7727602	CWS	2006-00789	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued
REGENCY MANOR MOBILE HOME PARK	763	POLK	IA7727602	CWS	2006-00870	Failure to meet Certified Operator Requirement	31-Dec-05	Operator Certification	STA	12/13/2005	NOV issued
REINBECK WATER SUPPLY	1751	GRUNDY	IA3870073	CWS	2006-00770	Consumer Confidence Report	31-Jul-05	CCR	RPT	11/21/2005	NOV issued
REMSSEN MUNICIPAL UTILITIES	1762	PLYMOUTH	IA7568079	CWS	2005-03539	Copper	30-Sep-05	AL, 90th Percentile	MCL	7/29/2005	BCA issued
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00558	Dichloromethane	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00559	o-Dichlorobenzene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00560	p-Dichlorobenzene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00561	Vinyl Chloride	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00562	1,1-Dichloroethylene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00563	trans-1,2- Dichloroethylene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00564	1,2-Dichloroethane	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00565	1,1,1-Trichloroethane	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00566	Carbon Tetrachloride	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00567	1,2-Dichloropropane	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00568	Trichloroethylene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00569	1,1,2-Trichloroethane	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00570	Tetrachloroethylene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00571	Monochlorobenzene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00572	Benzene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00573	Toluene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00574	Ethylbenzene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00575	Styrene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00576	1,2,4-Trichlorobenzene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00577	cis-1,2-Dichloroethylene	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2006-00578	Xylenes	30-Sep-05	Routine Major	MON	11/22/2005	Compliance Achieved
REVELLE 1ST & 2ND SUBDIVISION	54	SCOTT	IA8215396	CWS	2005-01922	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/25/2005	Compliance Achieved
REVELLE 1ST & 2ND SUBDIVISION	54	SCOTT	IA8215396	CWS	2006-00264	Total Trihalomethanes	31-Aug-05	Routine Major	MON	10/27/2005	NOV issued
REVELLE 1ST & 2ND SUBDIVISION	54	SCOTT	IA8215396	CWS	2006-00265	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	10/27/2005	NOV issued
RHODYS	42	DUBUQUE	IA3126203	TNC	2005-01928	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/30/2006	Compliance Achieved
RHODYS	42	DUBUQUE	IA3126203	TNC	2005-02967	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	6/17/2005	NOV issued
RHODYS	42	DUBUQUE	IA3126203	TNC	2005-02992	Nitrate Nitrogen	31-May-05	Confirmation/Check Major	MON	5/30/2006	Compliance Achieved
RIDGEROAD DEVELOPMENT	26	EMMET	IA3218301	CWS	2005-01700	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	4/12/2005	Compliance Achieved
RIVER ROAD GOLF CLUB	59	KOSSUTH	IA5502814	TNC	2005-01221	Coliform Bacteria, Total	31-Jan-05	Repeat Major	MON	7/5/2005	Compliance Achieved
RIVER ROAD GOLF CLUB	59	KOSSUTH	IA5502814	TNC	2005-01222	Coliform Bacteria, Total	31-Jan-05	Repeat Major	MON	7/5/2005	Compliance Achieved
RIVER ROAD GOLF CLUB	59	KOSSUTH	IA5502814	TNC	2005-01223	Coliform Bacteria, Total	31-Jan-05	Repeat Major	MON	7/5/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
RIVER ROAD GOLF CLUB	59	KOSSUTH	IA5502814	TNC	2005-01224	Coliform Bacteria, Total	31-Jan-05	Repeat Major	MON	7/5/2005	Compliance Achieved
RIVER ROAD GOLF CLUB	59	KOSSUTH	IA5502814	TNC	2005-01508	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON		No EPA Enforcement Action
RIVERVIEW MANOR	95	SCOTT	IA8271801	CWS	2005-01563	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	2/2/2005	Compliance Achieved
ROCK VALLEY RURAL WATER DISTRICT	1425	SIOUX	IA8482701	CWS	2006-00271	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/1/2005	NOV issued
ROCK VALLEY RURAL WATER DISTRICT	1425	SIOUX	IA8482701	CWS	2006-00272	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/1/2005	NOV issued
ROCK VALLEY RURAL WATER DISTRICT	1425	SIOUX	IA8482701	CWS	2006-01732	Failure to obtain Construction Permit	31-Oct-05	Non-Reported Type	STA	10/10/2005	NOV issued
ROCKFORD GOLF & COUNTRY CLUB	90	FLOYD	IA3430201	TNC	2005-03323	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/14/2005	Compliance Achieved
ROCKY KNOLL MHP	65	WINNEBAGO	IA9525601	CWS	2006-00772	Consumer Confidence Report	31-Jul-05	CCR	RPT	11/21/2005	NOV issued
ROLAND WATER SUPPLY	1324	STORY	IA8570001	CWS	2006-00812	Copper	30-Sep-05	AL, 90th Percentile	MCL	2/15/2006	Compliance Achieved
ROLFE GOLF CLUB	31	POCAHONTAS	IA7639841	TNC	2005-03376	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/1/2005	Compliance Achieved
ROLLING ACRES SUBDIVISION	115	MUSCATINE	IA7048310	CWS	2006-00023	Copper	30-Sep-05	AL, 90th Percentile	MCL	10/12/2005	BCA issued
ROYAL PINES VILLAGE	300	CLINTON	IA2300638	CWS	2005-02948	Chlorine	31-Mar-05	Reporting	RPT	5/31/2005	NOV issued
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-01900	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/18/2005	Compliance Achieved
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-01920	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	10/18/2005	Compliance Achieved
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-03561	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/8/2005	AG Case Filed
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-03574	Coliform Bacteria, Fecal	30-Sep-05	MCL (TCR), Acute	MCL	8/8/2005	AG Case Filed
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-03601	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	8/17/2005	AG Case Filed
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-03883	Coliform Bacteria, Total	31-Aug-05	Repeat Major	MON	10/18/2005	Compliance Achieved
RS TAVERN	35	JACKSON	IA4955725	TNC	2005-03884	Coliform Bacteria, Total	31-Aug-05	Repeat Major	MON	10/18/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
RS TAVERN	35	JACKSON	IA4955725	TNC	2006-00073	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	2/27/2006	Compliance Achieved
RUMORS II	35	JACKSON	IA3113200	TNC	2006-00218	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	3/14/2006	Compliance Achieved
RUMORS II	35	JACKSON	IA3113200	TNC	2006-00299	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	3/14/2006	Compliance Achieved
RUTLAND WATER SUPPLY	145	HUMBOLDT	IA4675012	CWS	2006-01317	Copper	30-Sep-05	Routine Tap	MON	1/31/2006	NOV issued
RUTLAND WATER SUPPLY	145	HUMBOLDT	IA4675012	CWS	2006-01318	Lead	30-Sep-05	Routine Tap	MON	1/31/2006	NOV issued
RYAN WATER SUPPLY	410	DELAWARE	IA2864013	CWS	2006-00862	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	7/25/2005	Compliance Achieved
SAC COUNTY GOLF AND COUNTRY CLUB	40	SAC	IA8144817	TNC	2006-01154	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	3/23/2006	Compliance Achieved
SAINT CHARLES WATER SUPPLY	694	MADISON	IA6161031	CWS	2005-03567	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/5/2005	NOV issued
SAINT CHARLES WATER SUPPLY	694	MADISON	IA6161031	CWS	2005-03796	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	8/22/2005	NOV issued
SAINT CHARLES WATER SUPPLY	694	MADISON	IA6161031	CWS	2006-00830	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	12/5/2005	NOV issued
SAINT MARYS WATER CORPORATION	134	MADISON	IA9176019	CWS	2005-03566	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/5/2005	NOV issued
SAINT MARYS WATER CORPORATION	134	MADISON	IA9176019	CWS	2005-04062	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	9/30/2005	NOV issued
SAINT MARYS WATER CORPORATION	134	MADISON	IA9176019	CWS	2006-01291	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	1/18/2006	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-01990	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/21/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-01991	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/21/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-01992	Nitrite Nitrogen	31-Mar-05	Routine Major	MON	4/21/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-03015	Nitrite Nitrogen	31-May-05	Confirmation/Check Major	MON	6/24/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-03016	Nitrate Nitrogen	31-May-05	Confirmation/Check Major	MON	6/24/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-03420	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/19/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-03579	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	8/25/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2005-03647	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	10/19/2005	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2006-00174	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/7/2005	NOV issued
SAINTS PETER & PAUL LUTHERAN CHURCH	182	JONES	IA5343805	TNC	2006-01263	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
SALIX WATER SUPPLY	370	WOODBURY	IA9770024	CWS	2005-01930	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/18/2005	Compliance Achieved
SAPP BROS TRUCK STOPS	1074	FREMONT	IA3643202	NTNC	2005-02939	Failure to submit Monthly Operation Report	31-Mar-05	Monitoring (MOR)	MON	5/10/2005	Compliance Achieved
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-00930	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	1/6/2006	Compliance Achieved
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-00931	Nitrate Nitrogen	30-Nov-05	Routine Major	MON	1/6/2006	Compliance Achieved
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-00950	Nitrate Nitrogen	31-Dec-05	MCL, Single	MCL	12/21/2005	NOV issued
SCARVILLE GENERAL STORE LLC	85	WINNEBAGO	IA9580201	TNC	2005-03394	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/21/2005	Compliance Achieved
SCARVILLE GENERAL STORE LLC	85	WINNEBAGO	IA9580201	TNC	2005-04006	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	12/30/2005	Compliance Achieved
SCARVILLE GENERAL STORE LLC	85	WINNEBAGO	IA9580201	TNC	2006-00338	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/30/2005	Compliance Achieved
SCARVILLE GENERAL STORE LLC	85	WINNEBAGO	IA9580201	TNC	2006-00631	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	12/30/2005	Compliance Achieved
SCARVILLE GENERAL STORE LLC	85	WINNEBAGO	IA9580201	TNC	2006-00925	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	12/30/2005	Compliance Achieved
SCATTERGOOD FRIENDS SCH- DORM	48	CEDAR	IA1694561	NTNC	2005-01682	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	8/29/2005	Compliance Achieved
SCENIC CITY MOTEL	25	HARDIN	IA4260203	TNC	2006-00426	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	11/21/2005	NOV issued
SCHAEFF BUILDING	35	WOODBURY	IA9778107	NTNC	2006-00724	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	11/21/2005	NOV issued
SCOTT CO PK-SAC FOX	26	SCOTT	IA8251993	TNC	2005-04043	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	10/3/2005	NOV issued
SEYMOUR MUNICIPAL UTILITY WATER DEPT	810	WAYNE	IA9368035	CWS	2006-00814	Lead	30-Sep-05	AL, 90th Percentile	MCL	11/30/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SHARPLESS AUCTIONS	27	JOHNSON	IA5225206	TNC	2005-01967	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/12/2005	Compliance Achieved
SHELBY WATER SUPPLY	696	SHELBY	IA8369038	CWS	2005-01910	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/11/2005	Compliance Achieved
SHELBY WATER SUPPLY	696	SHELBY	IA8369038	CWS	2005-01940	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/11/2005	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2005-01819	Nitrate Nitrogen	28-Feb-05	Routine Major	MON	4/21/2005	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2005-01837	Nitrate Nitrogen	31-Mar-05	MCL, Single	MCL	9/8/2005	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2005-02070	Nitrate Nitrogen	31-May-05	MCL, Single	MCL	8/24/2005	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2005-04000	Nitrate Nitrogen	31-Aug-05	Routine Major	MON	11/4/2005	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2006-00406	Nitrate Nitrogen	31-Oct-05	MCL, Single	MCL	12/12/2005	Compliance Achieved
SHELLSBURG WATER SUPPLY	938	BENTON	IA0670043	CWS	2006-01911	Failure to submit MRDL	31-Mar-05	Reporting	RPT	7/13/2005	Compliance Achieved
SIGOURNEY FOODS	160	KEOKUK	IA5475101	NTNC	2005-01903	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/2/2005	Compliance Achieved
SIGOURNEY MUNI WATER WORKS	2219	JEFFERSON	IA5475050	CWS	2006-00243	Total Trihalomethanes	31-Aug-05	Routine Major	MON	10/27/2005	NOV issued
SIGOURNEY MUNI WATER WORKS	2219	JEFFERSON	IA5475050	CWS	2006-00244	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	10/27/2005	NOV issued
SILVER CITY WATER SUPPLY	259	MILLS	IA6575052	CWS	2005-03313	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	7/12/2005	Compliance Achieved
SIOUX RAPIDS WATER DEPARTMENT	749	BUENA VISTA	IA1175056	CWS	2005-01482	Nitrate Nitrogen	31-Jan-05	MCL, Single	MCL	7/27/2005	Compliance Achieved
SIRWA - CORNING/BROOKS	2049	ADAMS	IA0207704	CWS	2005-01689	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	3/23/2005	NOV issued
SIRWA - CORNING/BROOKS	2049	ADAMS	IA0207704	CWS	2005-02052	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	4/25/2005	NOV issued
SIRWA - CORNING/BROOKS	2049	ADAMS	IA0207704	CWS	2006-00948	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	12/21/2005	NOV issued
SIRWA - CORNING/BROOKS	2049	ADAMS	IA0207704	CWS	2006-00949	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	1/11/2006	NOV issued
SIRWA #1 (GREENFIELD)	639	ADAIR	IA0140701	CWS	2006-00810	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	11/30/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SIRWA #3 (OSCEOLA)	2260	CLARKE	IA2038701	CWS	2005-01691	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	2/28/2005	NOV issued
SIRWA #3 (OSCEOLA)	2260	CLARKE	IA2038701	CWS	2005-01753	Total Haloacetic Acids	31-Mar-05	MCL, Average	MCL	3/11/2005	NOV issued
SIRWA #3 (OSCEOLA)	2260	CLARKE	IA2038701	CWS	2005-03180	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	7/12/2005	NOV issued
SIRWA #3 (OSCEOLA)	2260	CLARKE	IA2038701	CWS	2005-03181	Total Haloacetic Acids	30-Jun-05	MCL, Average	MCL	7/12/2005	NOV issued
SIRWA #3 (OSCEOLA)	2260	CLARKE	IA2038701	CWS	2005-04027	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	9/20/2005	NOV issued
SIRWA #3 (OSCEOLA)	2260	CLARKE	IA2038701	CWS	2005-04054	Total Haloacetic Acids	30-Sep-05	MCL, Average	MCL	9/30/2005	NOV issued
SLABYS TAVERN	27	SCOTT	IA8270201	TNC	2006-00037	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	10/28/2005	NOV issued
SLABYS TAVERN	27	SCOTT	IA8270201	TNC	2006-00441	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	11/14/2005	NOV issued
SLABYS TAVERN	27	SCOTT	IA8270201	TNC	2006-00968	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	12/30/2005	NOV issued
SLEEPY HOLLOW CAMPGROUND & RV PARK	55	JOHNSON	IA5260601	CWS	2005-03278	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/1/2005	Compliance Achieved
SOLDIER WATER SUPPLY	207	MONONA	IA6749061	CWS	2006-00733	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/27/2006	NOV issued
SOUTH CEDAR	25	LINN	IA5720910	TNC	2005-03054	Coliform Bacteria, Total	31-May-05	Routine Major	MON	10/19/2005	Compliance Achieved
SOUTH CEDAR	25	LINN	IA5720910	TNC	2005-03280	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	10/19/2005	Compliance Achieved
SOUTH CEDAR	25	LINN	IA5720910	TNC	2005-03792	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	8/19/2005	NOV issued
SOUTH CEDAR	25	LINN	IA5720910	TNC	2005-03847	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/14/2005	NOV issued
SOUTH HIGH POINT WELL ASSN 2	29	JOHNSON	IA5200324	CWS	2005-02032	Coliform Bacteria, Total	30-Apr-05	MCL (TCR), Monthly	MCL	10/23/2005	Compliance Achieved
SOUTHEAST POLK RWD	5738	POLK	IA7774701	CWS	2005-02056	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	4/29/2005	NOV issued
SOUTHGATE INN	110	CHICKASAW	IA1970711	TNC	2005-03807	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/20/2005	Compliance Achieved
SOUTHGATE INN	110	CHICKASAW	IA1970711	TNC	2005-03850	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/20/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SOUTHPARK	26	HARDIN	IA4260601	CWS	2005-02736	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	6/1/2005	Compliance Achieved
SPARBOE AGRICULTURAL CORPORATION	30	HANCOCK	IA4103801	NTNC	2005-03482	Di(2-Ethylhexyl) Phthalate	30-Jun-05	Routine Major	MON	8/17/2005	Compliance Achieved
SPILLWAY SUPPER CLUB	50	ALLAMAKEE	IA0330706	TNC	2005-01537	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	8/9/2005	Compliance Achieved
SPILLWAY SUPPER CLUB	50	ALLAMAKEE	IA0330706	TNC	2006-00185	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
SPIRIT LAKE WATERWORKS	5427	DICKINSON	IA3070078	CWS	2005-03595	Turbidity	31-Jul-05	Monthly CFE Turbidity (IESWTR)	TT	1/30/2006	Compliance Achieved
SPIRIT LAKE WATERWORKS	5427	DICKINSON	IA3070078	CWS	2006-01612	Turbidity	31-Jul-05	Individual Turbidity CFE (IESWTR)	TT	1/30/2006	Compliance Achieved
SPORTSTERS STEAKHOUSE & LOUNGE	221	BENTON	IA0680202	TNC	2005-01976	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/11/2005	Compliance Achieved
SPORTSTERS STEAKHOUSE & LOUNGE	221	BENTON	IA0680202	TNC	2006-00352	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	5/30/2006	Compliance Achieved
SPORTSTERS STEAKHOUSE & LOUNGE	221	BENTON	IA0680202	TNC	2006-01252	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	5/30/2006	Compliance Achieved
SPRING LAKE COUNTY PARK	61	GREENE	IA3742950	TNC	2005-02735	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	8/1/2005	Compliance Achieved
SPRING LAKE COUNTY PARK	61	GREENE	IA3742950	TNC	2005-02850	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	8/1/2005	Compliance Achieved
SPRING LAKE COUNTY PARK	61	GREENE	IA3742950	TNC	2005-03044	Coliform Bacteria, Total	31-May-05	Routine Major	MON	8/1/2005	Compliance Achieved
SPRING LAKE COUNTY PARK	61	GREENE	IA3742950	TNC	2005-03089	Coliform Bacteria, Total	31-May-05	Routine Major	MON	8/1/2005	Compliance Achieved
SPRING LAKE COUNTY PARK	61	GREENE	IA3742950	TNC	2005-03375	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	8/1/2005	Compliance Achieved
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2005-03611	Coliform Bacteria, Total	31-Aug-05	Repeat Major	MON		No EPA Enforcement Action
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2005-03879	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	10/24/2005	Compliance Achieved
SQUAW CREEK A	153	LINN	IA5720903	TNC	2005-01204	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	10/21/2005	Compliance Achieved
SQUAW CREEK A	153	LINN	IA5720903	TNC	2006-00838	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	12/16/2005	NOV issued
SQUAW VALLEY SOUTH SUBDIVISION	163	STORY	IA8503305	CWS	2005-01566	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	12/19/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ST FRANCIS BARCLAY CHURCH	132	BLACK HAWK	IA0717801	TNC	2005-01473	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	10/20/2005	Compliance Achieved
ST FRANCIS BARCLAY CHURCH	132	BLACK HAWK	IA0717801	TNC	2005-01591	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	10/20/2005	Compliance Achieved
ST FRANCIS BARCLAY CHURCH	132	BLACK HAWK	IA0717801	TNC	2005-01839	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	10/20/2005	Compliance Achieved
ST JOHN LUTHERAN CHURCH	98	HANCOCK	IA4130801	TNC	2006-01262	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/31/2006	Compliance Achieved
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2006-01905	Failure to submit Monthly Operation Report	31-Jul-05	Monitoring (MOR)	MON	7/15/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-01996	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/17/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-03422	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-03423	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-03424	Nitrite Nitrogen	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-03442	Nitrite Nitrogen	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-03443	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (HAMPTON)	47	FRANKLIN	IA3544801	TNC	2005-03444	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (VINCENT)	64	WEBSTER	IA9486801	TNC	2005-03391	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/6/2005	Compliance Achieved
ST JOHNS LUTHERAN CHURCH (VINCENT)	64	WEBSTER	IA9486801	TNC	2005-03392	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/6/2005	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2005-03431	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2005-03432	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2005-03433	Nitrite Nitrogen	30-Jun-05	Routine Major	MON	9/21/2005	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2005-04035	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	2/24/2006	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2005-04047	Coliform Bacteria, Fecal	30-Sep-05	MCL (TCR), Acute	MCL	2/24/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-01545	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	2/24/2006	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-01546	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-01711	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	4/5/2006	Compliance Achieved
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2005-01987	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	5/5/2005	Compliance Achieved
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2005-01988	Nitrite Nitrogen	31-Mar-05	Routine Major	MON	5/5/2005	Compliance Achieved
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2005-01989	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/5/2005	Compliance Achieved
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2005-03538	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	2/24/2006	Compliance Achieved
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2005-03858	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	2/24/2006	Compliance Achieved
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2006-00929	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	1/27/2006	Compliance Achieved
STANWOOD WATER SUPPLY	680	CEDAR	IA1681092	CWS	2005-03182	Copper	30-Jun-05	AL, 90th Percentile	MCL	12/15/2005	Compliance Achieved
STERLING WOODS ASSOCIATION	43	SCOTT	IA8209306	CWS	2006-00980	Copper	30-Sep-05	Routine Tap	MON	1/10/2006	BCA issued
STERLING WOODS ASSOCIATION	43	SCOTT	IA8209306	CWS	2006-00981	Lead	30-Sep-05	Routine Tap	MON	1/10/2006	BCA issued
STOCKMENS	33	WOODBURY	IA9778109	NTNC	2005-01529	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	3/25/2005	Compliance Achieved
STOCKMENS	33	WOODBURY	IA9778109	NTNC	2005-01697	Failure to meet Certified Operator Requirement	28-Feb-05	Operator Certification	STA	5/2/2005	Compliance Achieved
STOCKMENS	33	WOODBURY	IA9778109	NTNC	2005-01775	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	3/28/2005	Compliance Achieved
STOCKMENS	33	WOODBURY	IA9778109	NTNC	2005-01840	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	6/30/2005	Compliance Achieved
STOCKTON MUNI WATER SUPPLY	182	MUSCATINE	IA7063096	CWS	2006-00780	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/22/2006	Compliance Achieved
STORY CITY WATER DEPT	3228	STORY	IA8584000	CWS	2005-02077	Lead	03-Jun-05	AL, 90th Percentile	MCL	2/26/2001	BCA issued
STORY CITY WATER DEPT	3228	STORY	IA8584000	CWS	2006-00987	Lead	31-Dec-05	AL, 90th Percentile	MCL	2/26/2001	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2005-03189	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	6/21/2005	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2005-03607	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	11/8/2005	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-00896	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	12/16/2005	NOV issued
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-01087	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
SULLY MUNI WATER WORKS	904	JASPER	IA5076005	CWS	2006-00232	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/3/2005	NOV issued
SULLY MUNI WATER WORKS	904	JASPER	IA5076005	CWS	2006-00233	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/3/2005	NOV issued
SUNSET VILLAGE	520	MARSHALL	IA6469601	CWS	2006-00794	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued
SUTLIFF STORE INC	27	JOHNSON	IA5282309	TNC	2005-01480	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	7/8/2005	Compliance Achieved
SUTLIFF STORE INC	27	JOHNSON	IA5282309	TNC	2005-01586	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	7/8/2005	Compliance Achieved
SWIFT AND COMPANY	2000	MARSHALL	IA6469102	NTNC	2006-00963	Lead	30-Sep-05	AL, 90th Percentile	MCL	1/9/2006	Compliance Achieved
T MART #404	410	BREMER	IA0990207	TNC	2005-01773	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	9/16/2005	Compliance Achieved
TABLE MOUND PARK	600	DUBUQUE	IA3100600	CWS	2005-01896	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/6/2005	Compliance Achieved
TABLE MOUND PARK	600	DUBUQUE	IA3100600	CWS	2005-02043	Chlorine	31-Mar-05	Monitoring (DBP), Major	MON	4/5/2005	Compliance Achieved
THE BARN (CLIMBING HILL)	27	WOODBURY	IA9715201	TNC	2005-03389	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/23/2005	Compliance Achieved
THE BARN (CLIMBING HILL)	27	WOODBURY	IA9715201	TNC	2005-03921	Nitrate Nitrogen	31-Aug-05	Confirmation/Check Major	MON	9/23/2005	Compliance Achieved
THE BARN (CLIMBING HILL)	27	WOODBURY	IA9715201	TNC	2006-00336	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	1/25/2006	Compliance Achieved
THE BARN (CLIMBING HILL)	27	WOODBURY	IA9715201	TNC	2006-01226	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	Compliance Achieved
THE BARN (SHERRILL)	64	DUBUQUE	IA3183722	TNC	2005-03173	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	7/18/2005	NOV issued
THE BEACH FRONT	42	LEE	IA5694201	TNC	2005-01955	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/20/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
THE BEACH FRONT	42	LEE	IA5694201	TNC	2006-01230	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/23/2006	Compliance Achieved
THE BROILER	122	STORY	IA8503202	TNC	2005-01931	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	12/20/2005	Compliance Achieved
THE BROILER	122	STORY	IA8503202	TNC	2005-02993	Nitrate Nitrogen	31-May-05	Confirmation/Check Major	MON	12/20/2005	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2005-01481	Nitrate Nitrogen	31-Jan-05	MCL, Single	MCL	3/30/2006	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2005-01828	Nitrate Nitrogen	28-Feb-05	Routine Major	MON	4/27/2005	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2005-01962	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	4/27/2005	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2005-03097	Nitrate Nitrogen	31-May-05	Routine Major	MON	6/1/2005	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2005-04008	Nitrate Nitrogen	31-Aug-05	Routine Major	MON	9/23/2005	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2006-00637	Nitrate Nitrogen	31-Oct-05	Routine Major	MON	11/17/2005	Compliance Achieved
THE COUNTRY EXPRESS	515	WINNESHIEK	IA9630205	TNC	2005-01964	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/20/2005	Compliance Achieved
THE DAM BAR & GRILL	29	LINN	IA5786890	TNC	2006-00325	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
THE DAM BAR & GRILL	29	LINN	IA5786890	TNC	2006-00642	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	1/30/2006	Compliance Achieved
THE NEW SHACK TAVERN	70	LINN	IA5715812	TNC	2005-03293	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	10/19/2005	Compliance Achieved
THE NEW SHACK TAVERN	70	LINN	IA5715812	TNC	2005-03618	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	10/19/2005	Compliance Achieved
THE NEW SHACK TAVERN	70	LINN	IA5715812	TNC	2005-03619	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/19/2005	Compliance Achieved
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2005-03266	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/6/2005	Compliance Achieved
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2005-03298	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	7/6/2005	Compliance Achieved
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2005-03608	Coliform Bacteria, Total	31-Jul-05	Repeat Major	MON	7/5/2005	Compliance Achieved
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2005-03871	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	11/4/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2006-00095	Nitrate Nitrogen	30-Sep-05	Confirmation/Check Major	MON	10/18/2005	Compliance Achieved
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2006-01095	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	NOV issued
THE THIRSTY CAMEL	67	MUSCATINE	IA7016202	TNC	2005-03537	Nitrate Nitrogen	31-Jul-05	MCL, Single	MCL	10/11/2005	Compliance Achieved
THE THIRSTY CAMEL	67	MUSCATINE	IA7016202	TNC	2005-03816	Nitrate Nitrogen	31-Aug-05	MCL, Single	MCL	10/11/2005	Compliance Achieved
THE THIRSTY CAMEL	67	MUSCATINE	IA7016202	TNC	2006-00431	Failure to meet Compliance Schedule	30-Nov-05	Compliance Schedule	V/E	12/19/2005	Compliance Achieved
THE ZIPPER	30	WINNESHIEK	IA9637201	TNC	2005-01766	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	5/23/2005	Compliance Achieved
THE ZIPPER	30	WINNESHIEK	IA9637201	TNC	2006-00279	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/14/2005	Compliance Achieved
THREE HORSE SALOON	55	MITCHELL	IA6653201	TNC	2005-03123	Nitrate Nitrogen	30-Jun-05	MCL, Average	MCL	4/5/2006	Compliance Achieved
THREE HORSE SALOON	55	MITCHELL	IA6653201	TNC	2005-03187	Nitrate Nitrogen	31-Jul-05	MCL, Single	MCL	4/5/2006	Compliance Achieved
THREE HORSE SALOON	55	MITCHELL	IA6653201	TNC	2005-03565	Nitrate Nitrogen	31-Aug-05	MCL, Single	MCL	4/5/2006	Compliance Achieved
THUNDER RIDGE ESTATES	36	DUBUQUE	IA3170303	CWS	2005-01497	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	10/21/2005	Compliance Achieved
THUNDER RIDGE ESTATES	36	DUBUQUE	IA3170303	CWS	2005-02057	Lead	30-Jun-05	AL, 90th Percentile	MCL	8/23/2005	Compliance Achieved
THUNDER RIDGE ESTATES	36	DUBUQUE	IA3170303	CWS	2005-02058	Copper	30-Jun-05	AL, 90th Percentile	MCL	8/23/2005	Compliance Achieved
TIMBER VALLEY ESTATES (1ST & 2ND ADD)	169	SCOTT	IA8215384	CWS	2006-00781	Consumer Confidence Report	31-Jul-05	CCR	RPT	1/26/2006	Compliance Achieved
TIMBER VALLEY ESTATES (1ST & 2ND ADD)	169	SCOTT	IA8215384	CWS	2006-01401	Radium 226 & Radium 228	31-Dec-05	Routine Major	MON	2/21/2006	NOV issued
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2006-00782	Consumer Confidence Report	31-Jul-05	CCR	RPT	1/26/2006	Compliance Achieved
TIMBERLINE ESTATES	25	WASHINGTON	IA9260302	CWS	2005-03137	Failure to meet Certified Operator Requirement	31-Jul-05	Operator Certification	STA	9/1/2005	Compliance Achieved
TIMBERLINE ESTATES	25	WASHINGTON	IA9260302	CWS	2005-03408	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	9/27/2005	Compliance Achieved
TIMBERLINE ESTATES	25	WASHINGTON	IA9260302	CWS	2005-04003	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	9/7/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
TIMBERLINE ESTATES	25	WASHINGTON	IA9260302	CWS	2006-00784	Consumer Confidence Report	31-Jul-05	CCR	RPT	12/14/2005	Compliance Achieved
TIMBERLINE ESTATES	25	WASHINGTON	IA9260302	CWS	2006-00869	Lead	30-Sep-05	AL, 90th Percentile	MCL	12/14/2005	BCA issued
TOWN & COUNTRY AQUA CLUB	30	POTTAWATTAMIE	IA7820204	TNC	2006-00291	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	5/4/2006	Compliance Achieved
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2006-00499	Copper	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2006-00500	Lead	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2006-00833	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	2/8/2006	Compliance Achieved
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2006-00863	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	2/8/2006	Compliance Achieved
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2006-00951	Failure to meet Certified Operator Requirement	31-Dec-05	Operator Certification	STA	12/16/2005	Compliance Achieved
TRACY WATER SUPPLY	300	MARION	IA6382029	CWS	2006-00259	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/28/2005	NOV issued
TRACY WATER SUPPLY	300	MARION	IA6382029	CWS	2006-00260	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/28/2005	NOV issued
TRACY WATER SUPPLY	300	MARION	IA6382029	CWS	2006-00795	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued
TROY STORE	502	LINN	IA5786201	TNC	2005-01972	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	10/20/2005	Compliance Achieved
TRUCK COUNTRY OF IOWA	55	DUBUQUE	IA3126209	NTNC	2006-00621	Copper	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
TRUCK COUNTRY OF IOWA	55	DUBUQUE	IA3126209	NTNC	2006-00622	Lead	30-Sep-05	Routine Tap	MON	11/23/2005	NOV issued
TRUCK COUNTRY OF IOWA	55	DUBUQUE	IA3126209	NTNC	2006-01249	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	12/31/2005	NOV issued
TRUCKOMAT CORPORATION	510	SCOTT	IA8285200	NTNC	2006-01203	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	1/30/2006	Compliance Achieved
TRURO WATERWORKS	427	MADISON	IA6167036	CWS	2005-03160	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	7/5/2005	NOV issued
TRURO WATERWORKS	427	MADISON	IA6167036	CWS	2005-04037	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	9/23/2005	NOV issued
TRURO WATERWORKS	427	MADISON	IA6167036	CWS	2006-00947	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	12/21/2005	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
TWENTY-SEVEN FLAGS GOLF COURSE	200	WOODBURY	IA9774201	TNC	2006-01175	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/19/2006	NOV issued
TWENTY-SEVEN FLAGS GOLF COURSE	200	WOODBURY	IA9774201	TNC	2006-01270	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/19/2006	NOV issued
TWENTY-SEVEN FLAGS GOLF COURSE	200	WOODBURY	IA9774201	TNC	2006-01271	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/19/2006	NOV issued
TWIN KNOLLS 6TH ADDITION	45	LINN	IA5784310	CWS	2005-01559	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	10/20/2005	Compliance Achieved
TWIN LAKES UTILITIES & POLL.	190	CALHOUN	IA1300101	CWS	2006-00807	Nitrite Nitrogen	30-Nov-05	MCL, Single	MCL	11/28/2005	NOV issued
TWIN PONDS WEST - CHICKASAW CCB	29	CHICKASAW	IA1970403	TNC	2005-03525	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	8/4/2005	NOV issued
TWIN PONDS WEST - CHICKASAW CCB	29	CHICKASAW	IA1970403	TNC	2005-03590	Coliform Bacteria, Total	31-Aug-05	MCL (TCR), Monthly	MCL	8/19/2005	NOV issued
UNIVERSITY WATER SYSTEM	26684	JOHNSON	IA5225101	CWS	2005-03506	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	5/6/2005	Compliance Achieved
UPPER MISS F&W REFUGE MCGREGOR DISTRICT	25	CLAYTON	IA2258901	TNC	2006-00430	Failure to meet Certified Operator Requirement	31-Oct-05	Operator Certification	STA	1/10/2006	Compliance Achieved
VALLEY COUNTRY CAFE	216	CASS	IA1509747	TNC	2005-01892	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	7/11/2005	Compliance Achieved
VALLEY COUNTRY CAFE	216	CASS	IA1509747	TNC	2005-01932	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	7/11/2005	Compliance Achieved
VALLEY VIEW WATER ASSOCIATION	64	HARRISON	IA4300601	CWS	2006-00735	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/27/2006	NOV issued
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-01993	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	6/13/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-01994	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	6/13/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-01995	Nitrite Nitrogen	31-Mar-05	Routine Major	MON	6/13/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03017	Nitrite Nitrogen	31-May-05	Confirmation/Check Major	MON	10/3/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03018	Nitrate Nitrogen	31-May-05	Confirmation/Check Major	MON	10/3/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03759	Copper	30-Jun-05	Routine Tap	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03760	Lead	30-Jun-05	Routine Tap	MON	9/19/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03761	Arsenic	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03762	Barium	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03763	Cadmium	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03764	Chromium	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03765	Fluoride	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03766	Mercury	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03767	Sodium	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03768	Antimony	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03769	Thallium	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2005-03770	Selenium	30-Jun-05	Routine Major	MON	9/19/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00643	Dalapon	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00644	Di(2-Ethylhexyl) Adipate	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00645	Simazine	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00646	Di(2-Ethylhexyl) Phthalate	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00647	Picloram	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00648	Dinoseb	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00649	Atrazine	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00650	Alachlor (Lasso)	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00651	2,4-D	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00652	2,4,5-TP (Silvex)	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00653	Benzo (a) Pyrene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00654	Pentachlorophenol	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00655	Dichloromethane	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00656	o-Dichlorobenzene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00657	p-Dichlorobenzene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00658	Vinyl Chloride	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00659	1,1-Dichloroethylene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00660	trans-1,2- Dichloroethylene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00661	1,2-Dichloroethane	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00662	1,1,1-Trichloroethane	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00663	Carbon Tetrachloride	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00664	1,2-Dichloropropane	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00665	Trichloroethylene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00666	1,1,2-Trichloroethane	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00667	Tetrachloroethylene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00668	Monochlorobenzene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00669	Benzene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00670	Toluene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00671	Ethylbenzene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00672	Styrene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00673	1,2,4-Trichlorobenzene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00674	cis-1,2-Dichloroethylene	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERN LAURES AUTO CENTER INC	51	CHICKASAW	IA1970207	TNC	2006-00675	Xylenes	30-Sep-05	Routine Major	MON	10/4/2005	Compliance Achieved
VERNON HEIGHTS MOBILE HOME COURT	120	LINN	IA5700629	CWS	2006-00308	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
VERNON WATER CO	25	DUBUQUE	IA3126315	CWS	2005-02076	Lead	03-Jun-05	AL, 90th Percentile	MCL	8/26/2005	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2005-01769	Nitrate Nitrogen	28-Feb-05	Confirmation/Check Major	MON	8/25/2005	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2005-01794	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	8/25/2005	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2005-02055	Failure to submit Operation Permit Application	29-Apr-05	Non-Reported Type	RPT	9/8/2005	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2006-00496	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	1/26/2006	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2006-00900	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	1/26/2006	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2006-01096	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/26/2006	Compliance Achieved
VILLAGE CREEK BIBLE CAMP- LODGE	124	ALLAMAKEE	IA0345481	TNC	2005-01917	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	5/25/2005	Compliance Achieved
VILLAGER RESTAURANT	313	POTTAWATTAMIE	IA7872706	TNC	2005-01561	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	2/7/2005	Compliance Achieved
WAHKONSA COUNTRY CLUB	60	CEDAR	IA7078815	TNC	2006-00286	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	12/5/2005	Compliance Achieved
WALDENBURG COMMUNITY WATER SYSTEM	90	IOWA	IA4802301	CWS	2006-00941	Lead	30-Sep-05	AL, 90th Percentile	MCL	12/15/2005	BCA issued
WALFORD CITGO	100	LINN	IA0690201	TNC	2005-03147	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	8/24/2005	BCA issued
WALLACE FOUNDATION LEARNING CENTER	28	POTTAWATTAMIE	IA7856901	TNC	2005-04031	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	3/31/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WALLINGFORD MUNICIPAL WATERWORKS	210	EMMET	IA3290060	CWS	2006-00513	Copper	30-Sep-05	Routine Tap	MON	11/28/2005	NOV issued
WALLINGFORD MUNICIPAL WATERWORKS	210	EMMET	IA3290060	CWS	2006-00514	Lead	30-Sep-05	Routine Tap	MON	11/28/2005	NOV issued
WAPSIE VALLEY COM SCH- FAIRBANK	285	BUCHANAN	IA1025554	NTNC	2006-00197	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/4/2005	NOV issued
WAPSIE VALLEY COM SCH- FAIRBANK	285	BUCHANAN	IA1025554	NTNC	2006-00198	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/4/2005	NOV issued
WAPSIE VALLEY COM SCH- FAIRBANK	285	BUCHANAN	IA1025554	NTNC	2006-01309	Lead	30-Sep-05	AL, 90th Percentile	MCL	1/27/2006	NOV issued
WAPSIPINICON GOLF CLUB	33	BUCHANAN	IA1037899	TNC	2006-00199	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
WASHINGTON TWSP. ELEMENTARY SCHOOL	160	WASHINGTON	IA9233522	NTNC	2005-03988	Coliform Bacteria, Total	31-Aug-05	Routine Major	MON	9/12/2005	Compliance Achieved
WATERLOO WATER WORKS	70824	BLACK HAWK	IA0790074	CWS	2005-03599	Nitrate Nitrogen	31-Aug-05	MCL, Single	MCL	8/17/2005	NOV issued
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2005-03398	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	8/15/2005	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2005-03593	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	11/21/2005	BCA issued
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00021	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	11/21/2005	BCA issued
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00443	Coliform Bacteria, Total	30-Nov-05	MCL (TCR), Monthly	MCL	11/21/2005	BCA issued
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00475	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00476	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00477	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00478	Coliform Bacteria, Total	31-Oct-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00879	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00880	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00881	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/24/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00882	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-00883	Coliform Bacteria, Total	30-Nov-05	Repeat Major	MON	2/24/2006	Compliance Achieved
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2006-01232	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
WATERVILLE ELEMENTARY SCHOOL	156	ALLAMAKEE	IA0397551	NTNC	2006-00969	Lead	31-Dec-05	AL, 90th Percentile	MCL	1/16/2006	Compliance Achieved
WAUBONSIE ST PK (BRIDLE TRAIL)	66	FREMONT	IA3600918	TNC	2005-03667	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/8/2005	Compliance Achieved
WAUBONSIE ST PK (OVERLOOK WELL)	229	FREMONT	IA3629932	TNC	2005-03668	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	8/8/2005	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2005-02882	Coliform Bacteria, Total	30-Apr-05	Routine Major	MON	10/19/2005	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2005-03756	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	10/19/2005	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2006-00356	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	11/8/2005	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2006-01256	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/27/2006	Compliance Achieved
WEBSTER MUNICIPAL WATER WORKS	110	KEOKUK	IA5491093	CWS	2006-00785	Consumer Confidence Report	31-Jul-05	CCR	RPT	1/11/2006	Compliance Achieved
WEBSTER MUNICIPAL WATER WORKS	110	KEOKUK	IA5491093	CWS	2006-00909	Coliform Bacteria, Total	30-Nov-05	Routine Major	MON	12/6/2005	Compliance Achieved
WELLSBURG WATER SUPPLY	716	GRUNDY	IA3890097	CWS	2005-01501	Radium 226 & Radium 228	31-Mar-05	MCL, Average	MCL	6/15/2005	BCA issued
WELLSBURG WATER SUPPLY	716	GRUNDY	IA3890097	CWS	2005-02923	Radium 226 & Radium 228	30-Jun-05	MCL, Average	MCL	6/15/2005	BCA issued
WELLSBURG WATER SUPPLY	716	GRUNDY	IA3890097	CWS	2006-01566	Radium 226 & Radium 228	31-Dec-05	MCL, Average	MCL	6/15/2005	BCA issued
WEST BURLINGTON MUNI. WATER SUPPLY	3161	DES MOINES	IA2985002	CWS	2005-01715	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	8/23/2005	BCA issued
WEST BURLINGTON MUNI. WATER SUPPLY	3161	DES MOINES	IA2985002	CWS	2005-02944	Total Trihalomethanes	30-Jun-05	MCL, Average	MCL	8/23/2005	BCA issued
WEST BURLINGTON MUNI. WATER SUPPLY	3161	DES MOINES	IA2985002	CWS	2005-04049	Total Trihalomethanes	30-Sep-05	MCL, Average	MCL	8/23/2005	BCA issued
WEST BURLINGTON MUNI. WATER SUPPLY	3161	DES MOINES	IA2985002	CWS	2006-01327	Total Trihalomethanes	31-Dec-05	MCL, Average	MCL	8/23/2005	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WEST LIBERTY FOODS	1078	MUSCATINE	IA7073834	NTNC	2006-01151	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/6/2006	Compliance Achieved
WESTERN HILLS	60	KOSSUTH	IA5500820	CWS	2006-00452	Failure to meet Certified Operator Requirement	30-Nov-05	Operator Certification	STA	4/5/2006	Compliance Achieved
WESTFAIR	301	POTTAWATTAMIE	IA7820401	TNC	2005-03800	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	3/31/2006	Compliance Achieved
WHAT CHEER WATER SUPPLY	678	KEOKUK	IA5493016	CWS	2006-00786	Consumer Confidence Report	31-Jul-05	CCR	RPT	11/21/2005	NOV issued
WHISPERING OAKS	28	JOHNSON	IA5200868	CWS	2005-02949	Chlorine	31-Mar-05	Monitoring (DBP)	MON	10/14/2005	Compliance Achieved
WHITE SPRINGS	70	CLAYTON	IA2258788	TNC	2006-00210	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	12/16/2005	Compliance Achieved
WHITE SPRINGS	70	CLAYTON	IA2258788	TNC	2006-00334	Nitrate Nitrogen	30-Sep-05	Routine Major	MON	12/16/2005	Compliance Achieved
WICKIUP HILL OUTDOOR LEARNING CENTER	53	LINN	IA5765404	TNC	2005-01946	Nitrate Nitrogen	31-Mar-05	Routine Major	MON	10/20/2005	Compliance Achieved
WICKIUP HILL OUTDOOR LEARNING CENTER	53	LINN	IA5765404	TNC	2005-02998	Nitrate Nitrogen	31-May-05	Confirmation/Check Major	MON	10/20/2005	Compliance Achieved
WILSON SUBDIVISION WELL #9	45	WRIGHT	IA9905302	TNC	2006-00031	Coliform Bacteria, Total	31-Dec-05	MCL (TCR), Monthly	MCL	10/21/2005	NOV issued
WIND RIVER INC	125	HUMBOLDT	IA4641201	TNC	2005-03274	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	2/13/2006	Compliance Achieved
WIND RIVER INC	125	HUMBOLDT	IA4641201	TNC	2005-03296	Nitrate Nitrogen	30-Jun-05	Routine Major	MON	2/13/2006	Compliance Achieved
WIND RIVER INC	125	HUMBOLDT	IA4641201	TNC	2006-00094	Nitrate Nitrogen	30-Sep-05	Confirmation/Check Major	MON	2/24/2006	Compliance Achieved
WIND RIVER INC	125	HUMBOLDT	IA4641201	TNC	2006-00228	Coliform Bacteria, Total	30-Sep-05	Routine Major	MON	2/24/2006	Compliance Achieved
WINDING BROOK MOBILE HOME PARK	150	CLINTON	IA2300607	CWS	2005-02970	Failure to meet Certified Operator Requirement	30-Jun-05	Operator Certification	STA	8/18/2005	Compliance Achieved
WINGS	46	ALLAMAKEE	IA0315707	TNC	2005-03261	Coliform Bacteria, Total	30-Jun-05	Routine Major	MON	7/5/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-01575	Coliform Bacteria, Total	31-Jan-05	Routine Major	MON	9/29/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-01576	Nitrate Nitrogen	31-Jan-05	Routine Major	MON	9/29/2005	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-01690	Nitrate Nitrogen	28-Feb-05	MCL, Single	MCL	2/28/2005	NOV issued
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-01823	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	9/29/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-02059	Nitrate Nitrogen	30-Apr-05	MCL, Single	MCL	5/2/2005	NOV issued
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-03251	Coliform Bacteria, Total	30-Jun-05	Repeat Major	MON	9/29/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-03746	Coliform Bacteria, Total	31-Jul-05	Routine Major	MON	9/29/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-03747	Nitrate Nitrogen	31-Jul-05	Routine Major	MON	9/29/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2005-03823	Nitrate Nitrogen	31-Aug-05	MCL, Single	MCL	9/1/2005	NOV issued
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-00157	Coliform Bacteria, Total	30-Sep-05	Repeat Major	MON	11/8/2005	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-00630	Coliform Bacteria, Total	31-Oct-05	Routine Major	MON	2/24/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-01227	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-01228	Nitrate Nitrogen	31-Dec-05	Routine Major	MON	2/24/2006	Compliance Achieved
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2005-01702	Coliform Bacteria, Total	28-Feb-05	MCL (TCR), Monthly	MCL	3/3/2005	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2005-03157	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	7/5/2005	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2005-03503	Coliform Bacteria, Fecal	30-Jun-05	MCL (TCR), Acute	MCL	7/15/2005	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2005-03552	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	8/1/2005	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-00206	Total Trihalomethanes	31-Aug-05	Routine Major	MON	11/4/2005	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-00207	Total Haloacetic Acids	31-Aug-05	Monitoring (DBP), Major	MON	11/4/2005	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-00744	Consumer Confidence Report	31-Jul-05	CCR	RPT	2/20/2006	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-00834	Chlorine	30-Sep-05	Monitoring (DBP), Major	MON	3/31/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-00864	Chlorine	30-Jun-05	Monitoring (DBP), Major	MON	3/31/2006	Compliance Achieved
WINTERSET MUNICIPAL WATERWORKS	4768	MADISON	IA6171029	CWS	2005-02924	Nitrate Nitrogen	31-May-05	MCL, Single	MCL	12/19/2005	Compliance Achieved
WINTERSET MUNICIPAL WATERWORKS	4768	MADISON	IA6171029	CWS	2005-02953	Nitrate Nitrogen	30-Jun-05	MCL, Single	MCL	12/19/2005	Compliance Achieved
WODEN WATER SUPPLY	243	HANCOCK	IA4170033	CWS	2006-01126	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/27/2006	Compliance Achieved
WOODLAND ESTATES IMPROVEMENT ASSOCIATION	59	JOHNSON	IA5280301	CWS	2006-00456	Lead	30-Sep-05	AL, 90th Percentile	MCL	12/2/2005	BCA issued
WOODLAND HEIGHTS HOMEOWNERS ASSOC.	51	JOHNSON	IA5225309	CWS	2005-01806	Coliform Bacteria, Total	28-Feb-05	Routine Major	MON	3/21/2005	Compliance Achieved
WOODLAND HEIGHTS HOMEOWNERS ASSOC.	51	JOHNSON	IA5225309	CWS	2005-03125	Coliform Bacteria, Total	30-Jun-05	MCL (TCR), Monthly	MCL	12/1/2005	Compliance Achieved
WOODLAND HEIGHTS HOMEOWNERS ASSOC.	51	JOHNSON	IA5225309	CWS	2006-00822	Copper	30-Sep-05	Routine Tap	MON	12/1/2005	BCA issued
WOODLAND HEIGHTS HOMEOWNERS ASSOC.	51	JOHNSON	IA5225309	CWS	2006-00823	Lead	30-Sep-05	Routine Tap	MON	12/1/2005	BCA issued
WOODLAND MOBILE HOME PARK	180	LOUISA	IA5879601	CWS	2006-01149	Coliform Bacteria, Total	31-Dec-05	Routine Major	MON	1/25/2006	Compliance Achieved
WOODLAND RIDGE SUBDIVISION	50	JOHNSON	IA5225320	CWS	2005-01902	Coliform Bacteria, Total	31-Mar-05	Routine Major	MON	4/25/2005	Compliance Achieved
WOODLAND RIDGE SUBDIVISION	50	JOHNSON	IA5225320	CWS	2005-03476	Sodium	30-Jun-05	Routine Major	MON	7/6/2005	Compliance Achieved
WOODWARD RESOURCE CENTER	400	BOONE	IA0800923	CWS	2006-00815	Lead	30-Sep-05	AL, 90th Percentile	MCL	2/27/2006	Compliance Achieved
WOODWARD WATER SUPPLY	1200	DALLAS	IA2576036	CWS	2005-03175	Coliform Bacteria, Total	31-Jul-05	MCL (TCR), Monthly	MCL	7/11/2005	NOV issued
XENIA RWD (BOONE)	3590	BOONE	IA0844006	CWS	2005-01757	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	3/14/2005	NOV issued
XENIA RWD (DES MOINES)	12337	DALLAS	IA2573701	CWS	2005-01756	Total Trihalomethanes	31-Mar-05	MCL, Average	MCL	3/14/2005	NOV issued
YMCA CAMP WAPSIE	204	LINN	IA5722422	TNC	2005-01838	Coliform Bacteria, Total	31-Mar-05	MCL (TCR), Monthly	MCL	10/21/2005	Compliance Achieved
YOUNGVILLE CAFE & MUSEUM	32	BENTON	IA0603201	TNC	2005-03857	Coliform Bacteria, Total	30-Sep-05	MCL (TCR), Monthly	MCL	9/22/2005	NOV issued